

APPLICABLE CODES  
2018 IRC and 2018 IBC with Municipal amendments.

GENERAL NOTES

1. Notify Designer of any errors or discrepancies in the documents.
2. Keep the job site clean and safe. Install temporary railings at level changes.
3. Provide a portable toilet for use during construction.
4. Consult Subcontractors to identify additional work items not specifically described herein.
5. At walls greater than 10'-0" height, provide fire blocking at 10'-0" maximum spacing.

AREA SUMMARY

UNIT A	
GARAGE	405 SQ. FT.
FIRST FLOOR, LIVING AREA	490
SECOND FLOOR, LIVING AREA	765
SUBTOTAL, UNIT A, LIVING AREA	1,255
UNIT B	
GARAGE	390
FIRST FLOOR, LIVING AREA	480
SECOND FLOOR, LIVING AREA	775
SUBTOTAL, UNIT B, LIVING AREA	1,255
GRAND TOTAL	3,305

INDEX OF DRAWINGS

- G1 Cover/Notes and Index
- A1 Schedules and Notes
- A2 Spec Notes, Code Summary
- A3 Site/Landscape Plan
- A4 Overall First Floor Plan
- A5 Overall Second Floor Plan
- A6 Enlarged First Floor Plan
- A7 Enlarged Second Floor Plan
- A8 Roof Plan
- A9 North and East Elevations
- A10 South and West Elevations
- A11 Building Section A-A
- A12 Building Section B-B
- A13 Building Section C-C
- A14 Details
- A15 Details
- A16 Interior Elevations
- S1 Structural General Notes
- S2 Foundation Plan and First Floor Framing Plan
- S3 Shear Wall Plans
- S4 Second Floor/Low Roof Framing Plan and High Roof Framing Plan
- S5 Details
- S6 Details

wilshire ave.  
duplex


Owner/Contractor:  
Cook Inlet Housing Authority  
3510 Spenard Rd., Suite 100  
Anchorage, AK 99503

Jeff Cable  
Senior Construction Manager

Civil Engineer:  
Forge Engineering  
Ben Schiller  
(907) 310-9090

Structural Engineer:  
LDR Engineering Services, Inc.  
L.D. "Randy" Randolph  
(907) 227-0028

Designer:  
FRamE  
Clark Yerrington  
(907) 351-4805

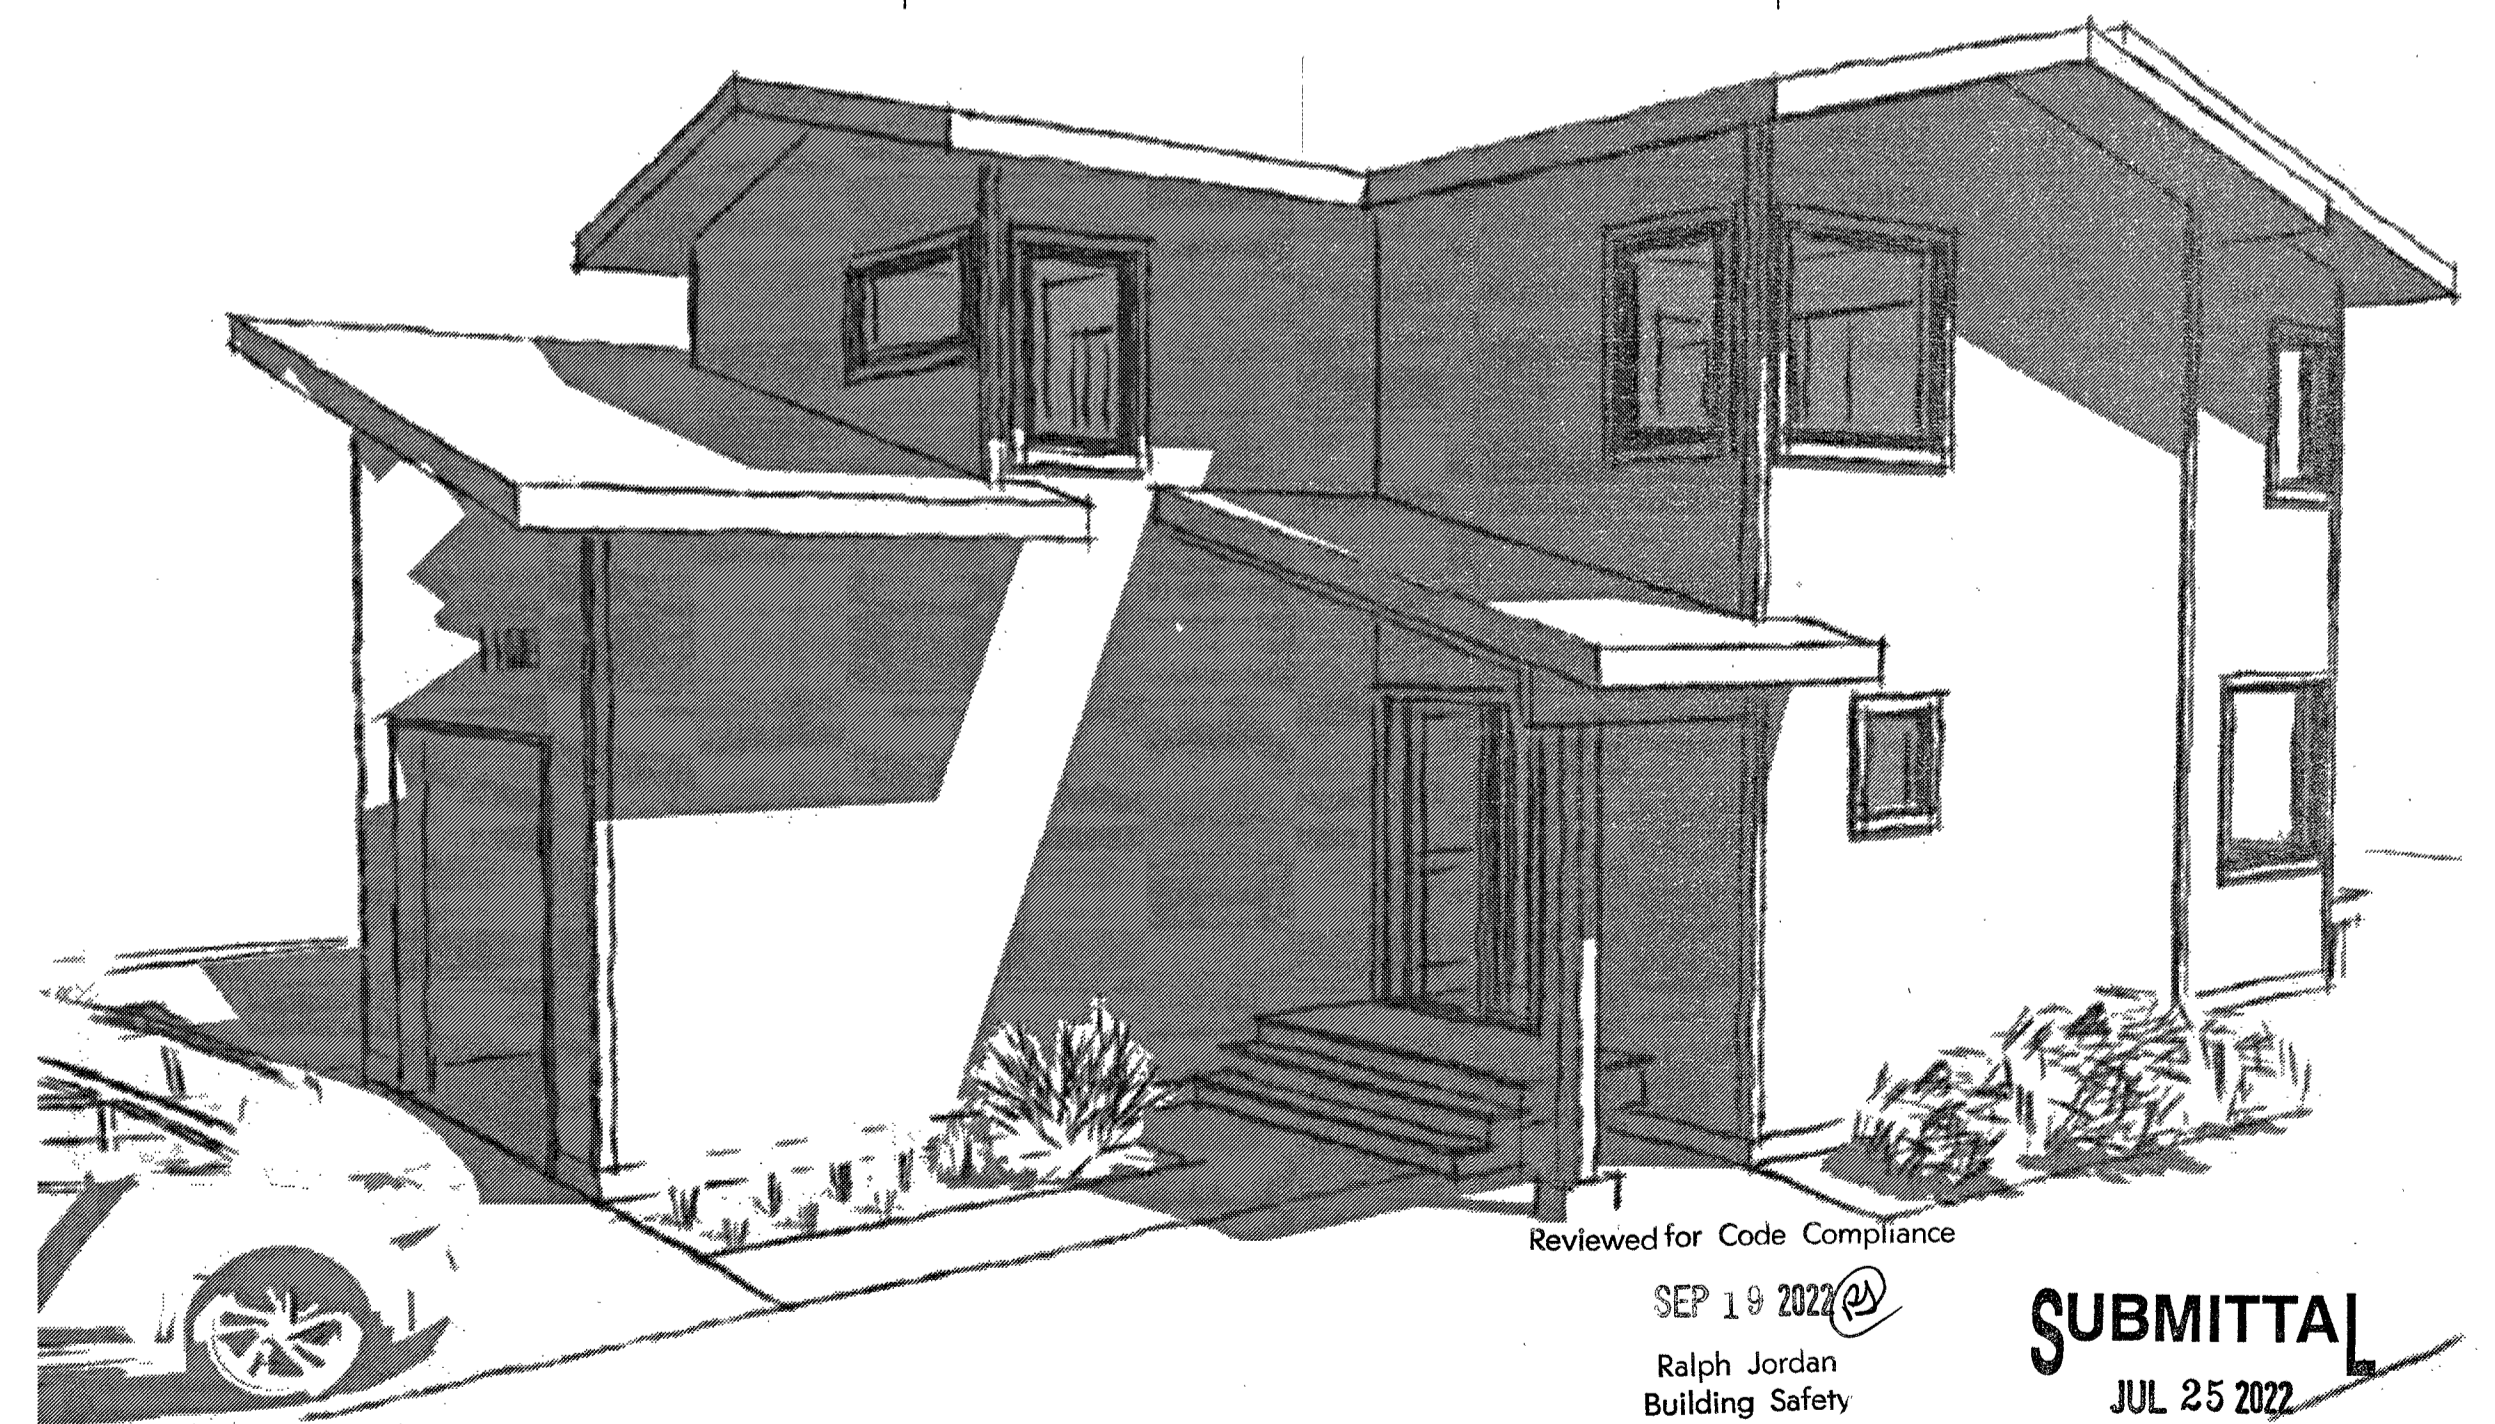

Reviewed for Code Compliance

SEP 19 2022  
Ralph Jordan  
Building Safety

**SUBMITTAL**  
JUL 25 2022  
R22-2251  
FIELD

COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
Lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

DR. BY: CLARK  
DATE: 18 JUL 22

PLUMBING SCHEDULE

description of fixture/fitting
1 gas meter
2 gas meter
3 frost-free hose bibb
4 frost-free hose bibb
5 furnace, under-stairs in garage/tankless water heater
6 furnace, under-stairs in garage/tankless water heater
7 [NOT USED]
8 [NOT USED]
9 clothes washer supply and drain box, recessed in wall
10 clothes washer supply and drain box, recessed in wall
11 small, round above-counter mounted lavatory, white, as selected/single mixing chrome faucet
12 medium-size pedestal lavatory, white, as selected/single mixing chrome faucet
14 toilet, simple low water use model, white
15 toilet, simple low water use model, white
16 deep two-compartment under-counter mounted stainless steel sink, as selected/single mixing chrome faucet with pull-out spray
17 connect disposal to drain
18 connect dishwasher supply, drain and vent
19 gas connection for range
20 water supply line for refrigerator ice maker
21 deep two-compartment under-counter mounted stainless steel sink, as selected/single mixing chrome faucet with pull-out spray
22 connect disposal to drain
23 connect dishwasher supply, drain and vent
24 gas connection for range
25 water supply line for refrigerator ice maker
26 [NOT USED]
27 small, round above-counter mounted lavatory, white, as selected/single mixing chrome faucet
28 toilet, simple low water use model, white
29 one-piece fiberglass tub with 60 inch height walls three sides, as selected/single mixing tempering shower valve, tub filler, drain fitting
30 medium-size pedestal lavatory, white, as selected/single mixing chrome faucet
31 toilet, simple low water use model, white
32 prefabricated 36x36 corner shower, glass enclosure with 45-degree corner door, fiberglass shower pan and side/back wall panels; single mixing tempering shower valve, drain fitting
33 small, round above-counter mounted lavatory, white, as selected/single mixing chrome faucet
34 toilet, simple low water use model, white
35 one-piece fiberglass tub with 60 inch height walls three sides, as selected/single mixing tempering shower valve, tub filler, drain fitting
36 small, round above-counter mounted lavatory, white, as selected/single mixing chrome faucet
37 toilet, simple low water use model, white
38 one-piece fiberglass tub with 60 inch height walls three sides, as selected/single mixing tempering shower valve, tub filler, drain fitting
39 ceiling-mounted unit heater at garage
40 ceiling-mounted unit heater at garage

ROOM FINISH LEGEND

VP 1	vinyl plank
	Manufacturer: Shaw Contract
	Style: Terrain II, 20-mil.
	Color: Root
cpt 1	carpet
	Manufacturer: Shaw Contract
	Style: Quite Canvas
	Color: Vintage
4" rubber base	
	Manufacturer: Johnsonite
	Style: Traditional Base
	Color: Pebble

WINDOW SCHEDULE

width	height	head ht.	operation	frame	glazing	notes
A	2'-0"	2'-0"	normal	fixed	vinyl	clear safety 1
B	2'-8"	2'-0"	normal	fixed	vinyl	clear safety 1, 2
C	3'-0"	4'-8"	normal	casement	vinyl	clear 1
D	4'-8"	4'-8"	normal	fixed	vinyl	clear 1
E	5'-4"	4'-8"	normal	fixed	vinyl	clear safety 1
F	4'-8"	4'-8"	normal	fixed	vinyl	clear safety 1
G	4'-8"	4'-8"	normal	fixed	vinyl	clear 1
H	2'-0"	1'-4"	normal	fixed	vinyl	clear 1
J	2'-0"	2'-0"	normal	fixed	vinyl	clear 1
K	2'-0"	3'-5"	normal	fixed over awning	vinyl	clear 1
L	4'-8"	4'-0"	normal	fixed	vinyl	clear 1
M	2'-8"	4'-0"	normal	casement	vinyl	clear 1, 3
N	2'-8"	3'-6"	normal	casement	vinyl	clear 1, 3
P	4'-8"	2'-0"	normal	fixed	vinyl	clear 1
R	2'-8"	4'-0"	normal	casement	vinyl	clear 1, 3
S	2'-8"	4'-0"	normal	fixed	vinyl	clear 1
T	6'-0"	4'-0"	normal	fixed	vinyl	clear 1
U	2'-0"	3'-0"	normal	fixed over awning	vinyl	clear safety 1
V	2'-8"	2'-0"	normal	fixed	vinyl	clear safety 1, 2
W	3'-0"	4'-0"	normal	casement	vinyl	clear 1, 3
X	2'-8"	4'-0"	normal	fixed	vinyl	clear 1
Y	7'-4"	4'-0"	normal	fixed	vinyl	clear 1
Z	2'-8"	4'-0"	normal	casement	vinyl	clear 1, 3
AA	4'-8"	4'-0"	normal	fixed	vinyl	clear 1
BB	2'-8"	4'-0"	normal	casement	vinyl	clear 1, 3
CC	6'-0"	1'-6"	normal	fixed	vinyl	clear 1

ROOM FINISH SCHEDULE

room name	floor	base	notes
101 Entry	VP 1	1/2" x 3 1/2" MDF	1
102 Garage	concrete	-	1
103 1/2 Bath	VP 1	4" rubber	1, 2
104 Living	VP 1	1/2" x 3 1/2" MDF	1
105 Dining	VP 1	1/2" x 3 1/2" MDF	1
106 Kitchen	VP 1	1/2" x 3 1/2" MDF	1, 2
107 [NOT USED]			
108 Entry	VP 1	1/2" x 3 1/2" MDF	1
109 Garage	concrete	-	1
110 [NOT USED]			
111 1/2 Bath	VP 1	1/2" x 3 1/2" MDF	1, 2
112 Living	VP 1	1/2" x 3 1/2" MDF	1
114 Dining	VP 1	1/2" x 3 1/2" MDF	1
115 Kitchen	VP 1	1/2" x 3 1/2" MDF	1, 2
201 Hall	VP 1	1/2" x 3 1/2" MDF	1
202 Main Bedroom	cpt 1	1/2" x 3 1/2" MDF	1
203 Main Bath	VP 1	4" rubber	1, 2
204 Walk-In Closet	VP 1	1/2" x 3 1/2" MDF	1
205 Bedroom Two	cpt 1	1/2" x 3 1/2" MDF	1
206 Bath	VP 1	4" rubber	1, 2
207 Bedroom Three	cpt 1	1/2" x 3 1/2" MDF	1
208 Hall	VP 1	1/2" x 3 1/2" MDF	1
209 Bath	VP 1	4" rubber	1, 2
210 Bedroom Three	cpt 1	1/2" x 3 1/2" MDF	1
211 Bedroom Two	cpt 1	1/2" x 3 1/2" MDF	1
212 Main Bedroom	cpt 1	1/2" x 3 1/2" MDF	1
214 Main Bath	VP 1	4" rubber	1, 2
215 Walk-In Closet	VP 1	1/2" x 3 1/2" MDF	1

DOOR SCHEDULE

width	ht.	type	material	finish	hardware	glazing	notes
101	9'-0"	8'-8"	garage	insul. met.	paint	factory	none 4
102	9'-0"	8'-8"	garage	insul. met.	paint	factory	none 4
103	3'-0"	6'-8"	exterior	fiberglass	paint	lockset, deadbolt	none 1, 3
104	3'-0"	6'-8"	exterior	fiberglass	paint	lockset, deadbolt	none 1, 3
105	2'-8"	6'-8"	exterior	fiberglass	paint	lockset, deadbolt	clear safety 1
106	2'-8"	6'-8"	exterior	fiberglass	paint	lockset, deadbolt	clear safety 1
107	2'-8"	6'-8"	flush	wood	paint	latchset	none 5
108	2'-8"	6'-8"	flush	wood	paint	latchset	none 5
109	2'-4"	6'-8"	flush	wood	paint	privacy lock	none 2
110	2'-4"	6'-8"	flush	wood	paint	privacy lock	none 2
111	5'-0"	6'-8"	bipassing	wood	paint	trolley track/pull	none -
112	2'-4"	6'-8"	flush	wood	paint	latchset	none -
114	3'-0"	6'-8"	flush	wood	paint	latchset	none -
115	2'-4"	6'-8"	flush	wood	paint	latchset	none -
201	2'-8"	6'-8"	flush	wood	paint	privacy lock	none -
202	2'-6"	6'-8"	flush	wood	paint	privacy lock	none -
203	2'-8"	6'-8"	flush	wood	paint	privacy lock	none -
204	2'-4"	6'-8"	flush	wood	paint	privacy lock	none 2
205	2'-4"	6'-8"	flush	wood	paint	privacy lock	none 2
206	6'-0"	6'-8"	bipassing	wood	paint	trolley track/pull	none -
207	5'-0"	6'-8"	bipassing	wood	paint	trolley track/pull	none -
208	1'-6"	6'-8"	bipassing	wood	paint	latchset	none -
209	2'-0"	6'-8"	bipassing	wood	paint	latchset	none -
210	2'-6"	6'-8"	flush	wood	paint	privacy lock	none -
211	2'-6"	6'-8"	flush	wood	paint	privacy lock	none -
212	2'-6"	6'-8"	flush	wood	paint	privacy lock	none -
214	2'-4"	6'-8"	flush	wood	paint	privacy lock	none 2
215	2'-4"	6'-8"	flush	wood	paint	privacy lock	none 2
216	5'-0"	6'-8"	bipassing	wood	paint	trolley track/pull	none -
217	6'-0"	6'-8"	bipassing	wood	paint	trolley track/pull	none -
218	2'-4"	6'-8"	flush	wood	paint	latchset	none -

DOOR SCHEDULE NOTES

- Weatherstripping and threshold.
- Polished stainless hardware finish at bathroom side for bathroom use.
- Entry door in wood frame with integral single or double full height safety glass side lite/s as shown on floor plan. Confirm rough opening required. Flush panel door and plain rectangular side lite.
- Door bottom gasket; brush seal at head and jambs; furnished with all necessary hardware and accessories including track, spring or other counterbalance mechanism, opener, sensors, wall button, remotes, key lock. Thermacore, model 495 with flush wood grain panel finish, manufactured by Overhead Door, color as selected - or approved substitution.
- 20-minute rated door/frame with weatherstripping, smoke/vapor seal, threshold and closer.

ROOM FINISH SCHEDULE NOTES

- Walls and ceilings shall be painted gypsum board, typical.
- Substitute cementitious tile backer board for gypsum board at kitchen/laundry backsplash walls and tub/showers where ceramic wall tile occurs.

WINDOW SCHEDULE GENERAL NOTE

Sizes in Window Schedule are rough openings. Confirm frame size required with manufacturer, to allow for required insulation and shim space.

WINDOW SCHEDULE NOTES

- Vinyl frame windows shall be high quality residential grade with insulated double glazing, low E and argon. Frame color black. Provide screens at operating windows.
- Obscured glass.
- Meet all applicable requirements for sleeping room egress, including min. 5.7 square feet net clear opening area; 24 inch min. net clear height; 20 inch min. net clear width (R310.2.1); max. 44 inch sill height (R310.2.2) and operating hardware complying with R310.1.1.

LIGHT FIXTURE SCHEDULE

Not included in this set of drawings.

COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
lot 4, Spenard East subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

DR. BY: CLARK  
DATE: 18 JUL 22

A1  
2 OF 23



340 N. Flower St.  
Anchorage, AK 99508  
(907) 351-4805  
www.frame-ak.com

Reviewed for Code Compliance

SEP 19 2022

Ralph Jordan  
Building Safety

#### EXCAVATION AND FILL

Slope finish grade away from buildings 6 inches minimum for a distance of 10'-0".  
Place any large rocks unearthed during excavation near the driveway.

#### SITE UTILITIES

Connect water service line to water main.  
Connect drain lines to sanitary sewer main.  
Provide natural gas service entrance and meter.  
Provide 200 amp electrical service entrance and meter.  
Provide service entrance for Cable TV/Internet.

#### SITE WORK AND LANDSCAPING

Preserve existing natural vegetation to the extent possible.  
Provide house numbers and unit numbers as shown on Elevations.

#### HEATING

Design of the heating and ventilation systems shall be by Contractor.  
Permits shall be acquired and paid for by the Contractor.  
Inspections shall be scheduled by the Contractor and/or Subcontractor.  
Provide natural gas fired furnace for each living unit, with minimum output of 50 BTU/h per square foot of area served.  
Locate mechanical equipment in Garage 102 and Garage 109.

#### ELECTRICAL

Design of the electrical systems shall be by Contractor.  
Permits shall be acquired and paid for by the Contractor.  
Inspections shall be scheduled by the Contractor and/or Subcontractor.  
Rough in all boxes and conduct a walk-through review of the locations of all power outlets, switches, light fixtures and any other electrical items with Owner prior to wiring.  
Provide concealed Cable TV/Internet wiring and wall boxes from service entrance to locations indicated on Floor Plan.  
Switched outlets shall be half switched.  
Confirm power requirements for all Owner-furnished items.  
Provide smoke detectors in each bedroom and on each floor level at high point of ceiling. Provide carbon monoxide detector on each level. Detectors shall be hardwired in a series, so if one sounds they all do, with battery backup.  
Provide hardwired doorbell at Doors 103 and 108; locate chimes close to bottom of stairs.

#### SIDING

Install all siding over air infiltration retarder.  
Provide a sample of each type of siding to be used prior to installation or ordering of materials.  
Provide corrugated metal siding, as selected where shown/noted.  
Provide OSB lap siding, as selected where shown/noted. Align horizontal joints all around the building.  
Provide fiber-cement panel siding where shown/noted.  
Provide all necessary trim, flashing, terminations and accessories, whether shown/noted or not.

#### EXTERIOR TRIM

Provide 2x8 cedar fascia, or fiber cement plank same dimension.  
Provide window trim, corner trim and other trim as shown/noted.

#### INSULATION

Provide foundation insulation as shown/noted in Sections and details.  
Provide minimum R-20 insulation at foundation walls (allowed to be omitted at garage).  
Provide minimum R-21 insulation, batt or blown-in cellulose at exterior walls.  
Provide minimum R-30 insulation, foam in place at rim joist.  
Provide minimum R-49 insulation, batt or blown-in cellulose at roofs, with minimum 2" vent space above.  
Provide minimum R-38 insulation, foam in place at floor cantilevers.  
Provide bird screen and insect screen at vent openings.  
Vent area shall be equivalent to 1/150th of roof area, 50% at each side at end walls.  
Provide 6-mil vapor retarder at warm side of all wall and roof insulation.

#### ROOFING

Provide asphalt composition shingles over ice and water shield (self-adhering modified bitumen membrane).  
Provide continuous embedded edge metal flashing at roof edges.  
Provide gutter and downspout/s according to best standard local practice. Locate downspout outlets 5'-0" beyond exterior wall.

#### DRYWALL AND PAINT

Provide 1/2" gypsum board at walls.  
Provide 5/8" gypsum board at ceilings.  
Provide 5/8" type X fire rated gypsum board at wall and ceiling between garage and house.  
Provide samples of wall texture and paint/stain color samples, prior to commencement of work or ordering of materials.  
Provide exterior grade primer and paint at fiber cement panel siding; and exterior soffit and fascia.  
Provide exterior-grade stain at exposed truss tails and underside of sheathing.  
Provide primer and two coats of water based latex enamel at interior.

#### INTERIOR TRIM

Typical base trim and door trim shall be rectangular MDF or 4" rubber base as selected (see Room Finish Schedule). Prime and paint MDF with two coats semi-gloss, color to match adjacent walls.  
Window trim shall be min. 3/4" rectangular clear hem-fir, poplar or MDF sill with gypsum board returns at jambs and head. Gypsum board returns four sides OK for high windows.

#### CRAWL SPACE VENTILATION

Crawl spaces shall be mechanically ventilated.  
Provide constant velocity fan with 1 CFM per square foot of crawl space footprint.  
Transfer grilles, floor openings located opposite of fan/discharge to pull air across crawl space.  
Design and installation by Contractor.  
Comply with IRC 408.3, 2.1.

#### ATTIC VENTILATION

See Insulation section.

#### BUILDING CODE SUMMARY

International Residential Code, 2018 edition

Use - two family dwelling R101.2

Allowable number of stories - 3  
Actual number of stories - 1

Exterior walls are not required to be fire rated, min. 5'-0" fire separation at property line. Table R302.1 (1)

Garage required to be separated from attic and habitable rooms above.  
All garage walls and ceilings shall have 5/8" type X fire rated gypsum board. R302.6 and Municipal amendments.

Smoke alarms are required. R314

Address identifying signage is required. R319

Minimum stairway width, 36". R311.7.1  
Stairway maximum riser height, 7-3/4"; minimum tread depth, 10". R311.7.5.1, R311.7.5.2  
Handrails - one side of stair runs only. Handrails are not required at stair flights with three or fewer risers. R311.7.8  
Handrail height - 34" above nosings, except at transitions as allowed by R311.7.8.1, exception 2.  
Guard height - minimum 34" above stair nosings. R312.1.2, exception 1  
Guard height - minimum 36" at deck railing and any other locations not along stair runs. R312.1.1

#### ZONING CODE SUMMARY

Title 21, Anchorage Municipal Code

Zoning district: R-2M  
Property area: 8,775 sq. ft.  
Building footprint [including porches, decks and patios]: 2,030 sq. ft.  
Lot coverage, allowed: 40% Table 21.06-1  
Lot coverage, proposed: 23%  
Height, allowed: 30 ft. Table 21.06-1  
Height, proposed: 22'-6"

21.07.110, C - Multifamily/Town House Residential standards.

#### Sub-part 3 - Windows Facing the Street

This project complies with 21.07.110, C, 3, a/b - min. 10% of wall area shall be windows and primary entrance door. Total of windows and entrance door proposed are 10.6% of wall area - typical at North Elevation [windows and entry doors facing Wilshire Ave.].

#### Sub-part 6 - Building and Site Orientation

This project complies with the following sub-parts:

- 21.07.110, C, 6, b/d - total of windows and entrance door proposed are 12% of wall area.
- 21.07.110, C, 6, h - garage width, 27'-4" is 62% of total width, 44'-0" [North Elevation].
- 21.07.110, C, 6, k, i. - the primary entrances of both dwelling units face Wilshire Ave.

#### Sub-part 7 - Building Articulation

This project complies with the following sub-parts:

- 21.07.110, C, 7, a - wall interval dimensions of 6'-0", 13'-4", 14'-0" and 10'-8" with recess depth of 8'-0", 18'-0" and 26'-0" [North Elevation] comply with the intent of the sub-part.
- 21.07.110, C, 7, c - the second story is set back a minimum of 8'-0" for the entirety of the front [North] elevation.
- 21.07.110, C, 7, d - two siding materials are used on all four elevations.
- 21.07.110, C, 7, m - variation of form and scale proposed complies with the intent of the sub-part.

#### Sub-part 9 - Entry Way Treatment

This project complies with the following sub-parts:

- 21.07.110, C, 9, a - proposed covered porch, 27 sq. ft. at each unit.
- 21.07.110, C, 9, b - both wall modulation and material changes are proposed.
- 21.07.110, C, 9, c - entry door with adjacent side lite.
- 21.07.110, C, 9, d - steps, three risers/two treads from porch down to walkway/grade.

#### Sub-part 10 - Landscaping

This project complies with 21.07.110, C, 10, a and d, i., (B) - landscape planting bed with shrubs and tree at each dwelling unit.

Parking. Table 21.07-4

Use: Household Living; two family dwelling

One space per 1-BR dwelling unit.

+ 0.5 additional spaces each additional bedroom

+ 0.15 guest spaces, each dwelling unit with Town House style construction

Total required: 4 for dwelling units; 1 for guests - total, 5

Total provided: 4 for dwelling units; 2 for guests - total, 6

**FRAME**  
RESIDENTIAL DESIGN  
340 N. Flower St.  
Anchorage, AK 99508  
(907) 351-4805  
www.frame-ak.com

Reviewed for Code Compliance

SEP 19 2022

Ralph Jordan  
Building Safety


**SUBMITTAL**  
SEP 07 2022

R22-2251

COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
Lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

1 8/26/22  
DR. BY: CLARK  
DATE: 18 JUL 22

**A2**  
3 of 23

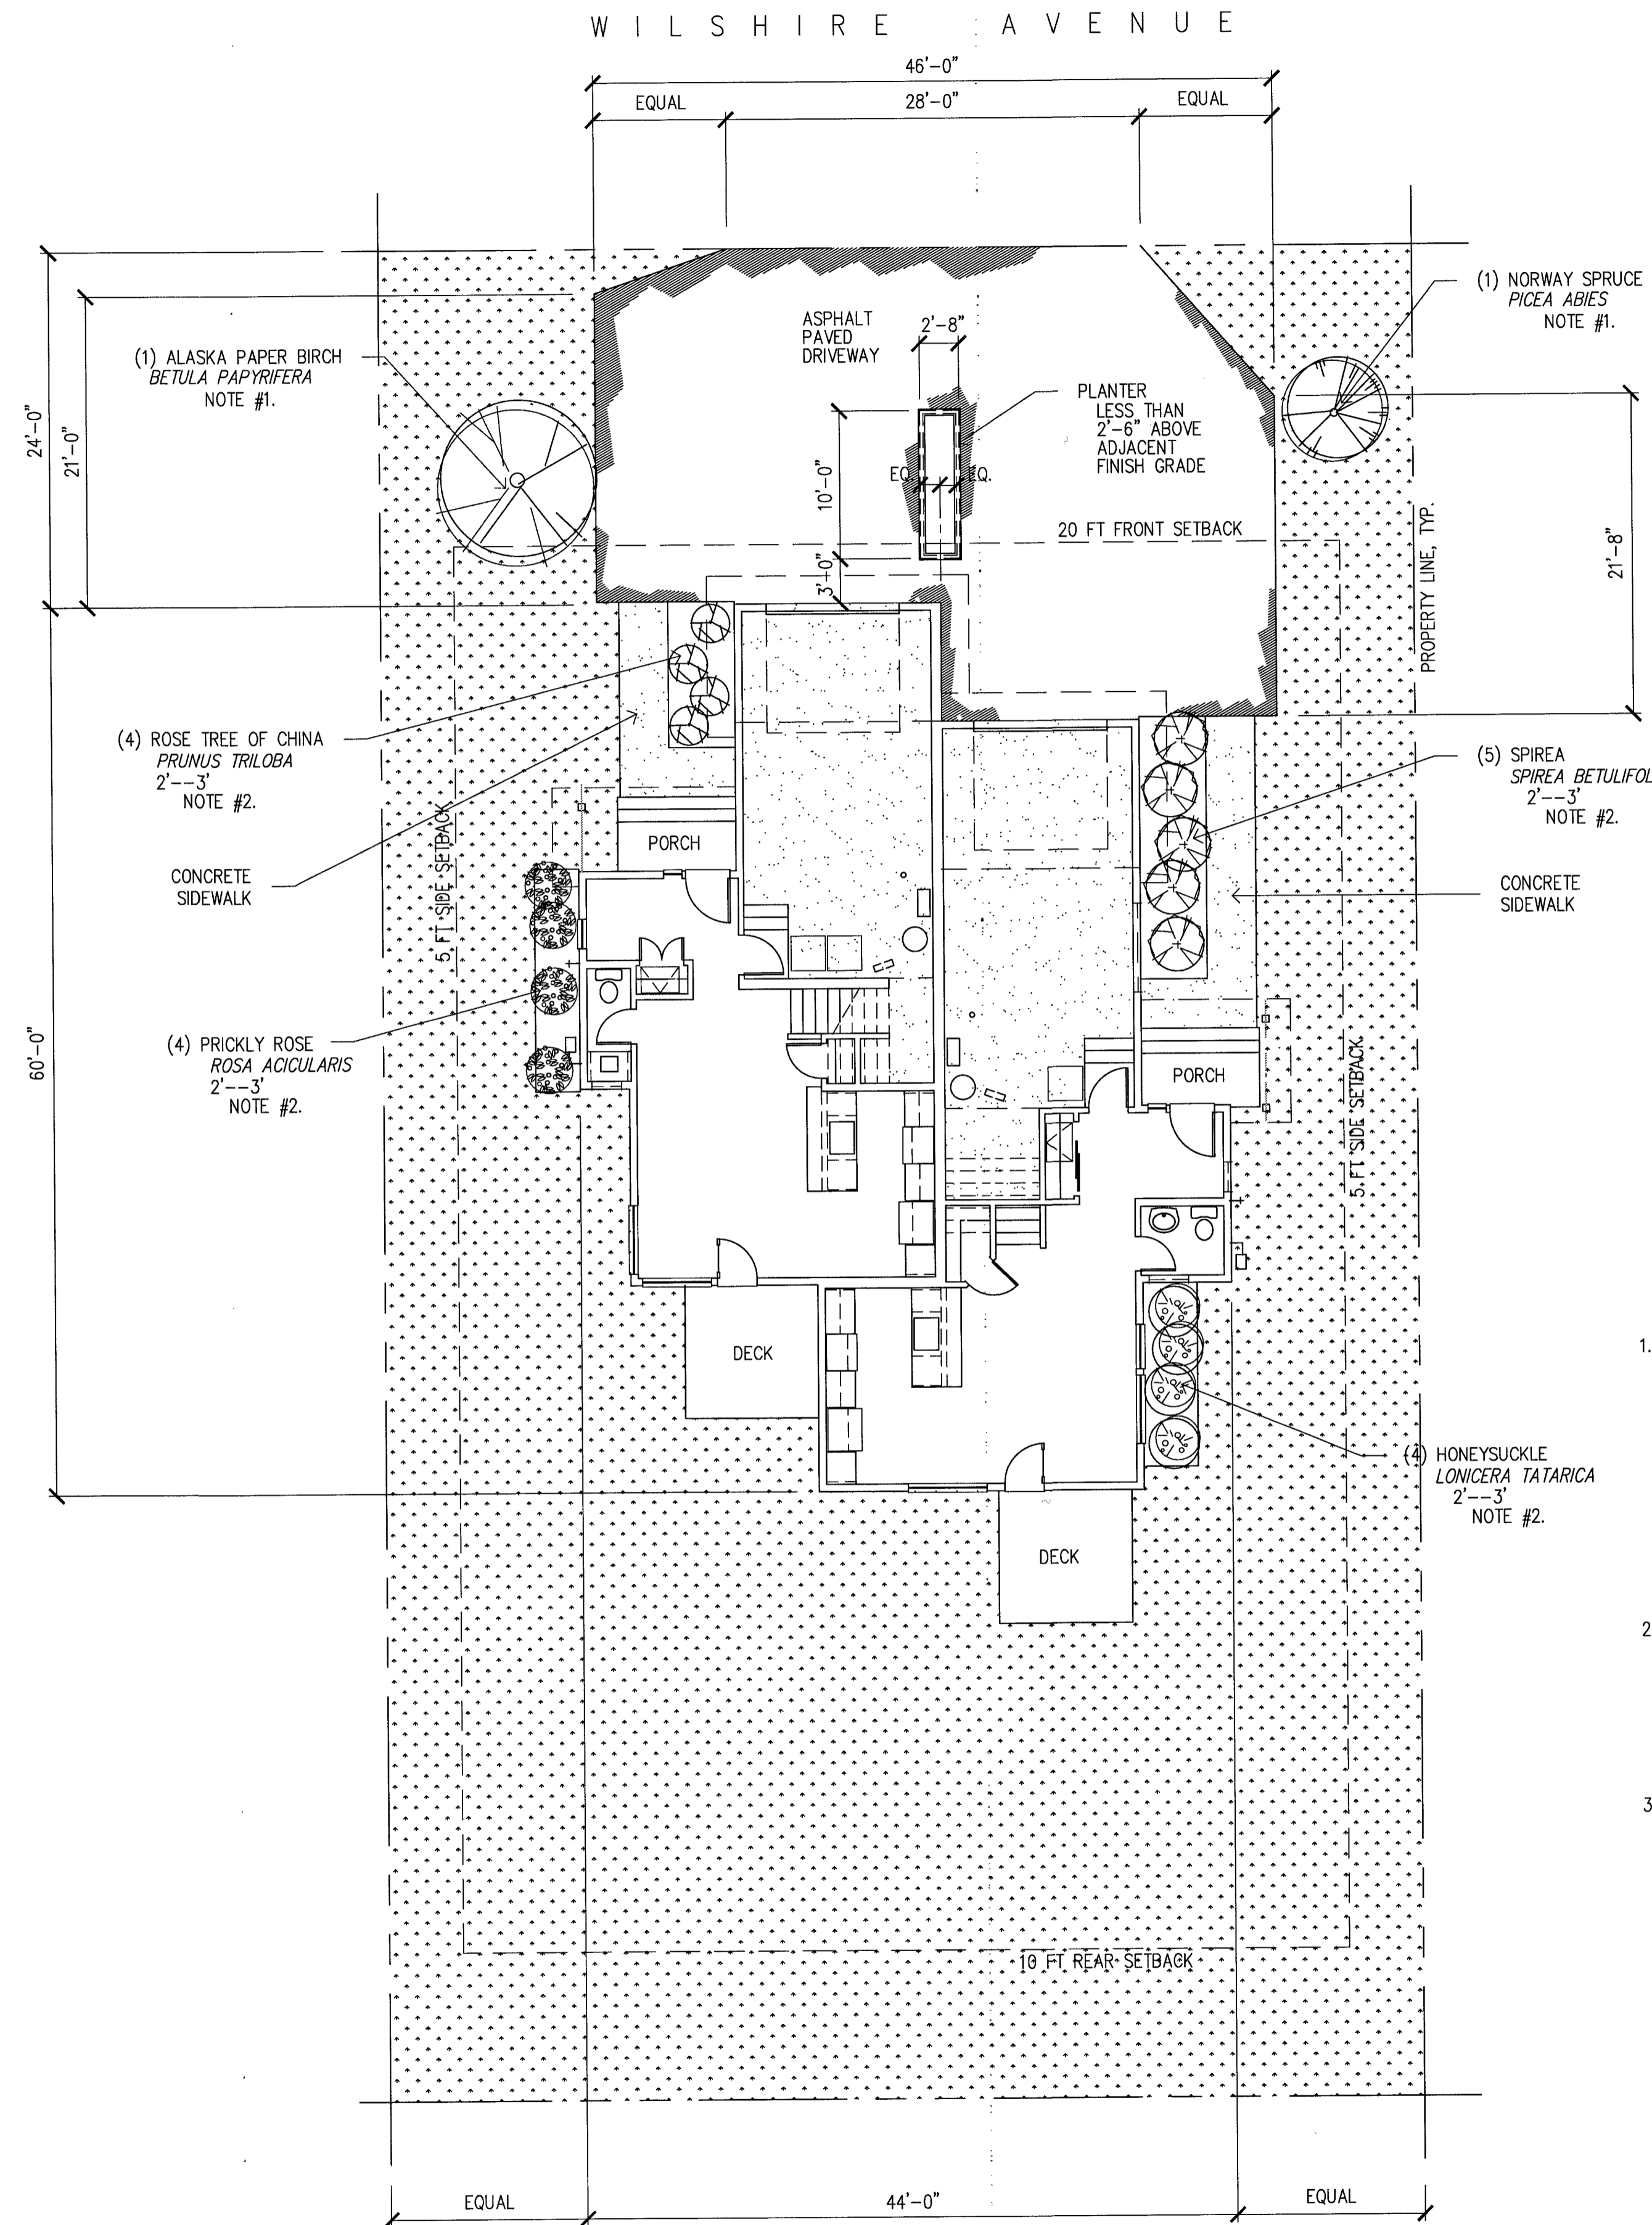

**LEGEND**


LAWN GRASS  
ALL AREAS OF SITE NOT OCCUPIED BY ASPHALT PAVING, CONCRETE SIDEWALK, PORCH/STEPS, PATIO, BUILDING FOOTPRINT OR LANDSCAPE BED

**NOTES**

- TREE PLANTING:**  
PLANT PIT DIAMETER 3 X ROOT BALL DIAMETER.  
SET ROOT BALL ON SOLID UNEXCAVATED SOIL PEDESTAL TO PREVENT SETTLING. LOOSEN SOIL AROUND PEDESTAL TO ENCOURAGE ROOT GROWTH.  
STAKE WITH (3) 2 X 2 X 6 FT LONG CEDAR STAKES; EMBED 2 FT AND DO NOT PENETRATE ROOT BALL.  
GUY AT 1/3 TREE HEIGHT USING FLEXIBLE MATERIAL TO ALLOW MOVEMENT IN THE WIND. REMOVE GUY AFTER ONE YEAR.  
PLANT TREE WITH TRUNK FLARE 1" ABOVE ADJACENT FINISH GRADE.  
MINIMUM TREE HEIGHT 8 FT.  
MINIMUM CALIPER 1 INCH.
- SHRUB PLANTING:**  
PLANT PIT DIAMETER 3 X ROOT BALL DIAMETER.  
SET ROOT BALL ON SOLID UNEXCAVATED SOIL PEDESTAL TO PREVENT SETTLING. LOOSEN SOIL AROUND PEDESTAL TO ENCOURAGE ROOT GROWTH.  
PLANT SHRUB WITH TRUNK FLARE 1" ABOVE ADJACENT FINISH GRADE.  
MINIMUM SHRUB HEIGHT 1'-6".
- CONCRETE FLAT WORK:**  
CONCRETE SIDEWALKS AND PATIO/STOOP SHALL SLOPE AWAY FROM BUILDING AT DOOR THRESHOLD AT MAX. 1:48; SHALL BE LEVEL/FLAT OR MAX. 1:48 CROSS SLOPE AT 45 AND 90 DEGREE TURNS; AND AT STRAIGHT RUNS ELSEWHERE SHALL SLOPE MAX. 1:20.

Reviewed for Code Compliance

SEP 19 2022  
Ralph Jordan  
Building Safety




**Site/Landscape Plan**

**COOK INLET HOUSING AUTHORITY**  
**WILSHIRE AVE. DUPLEX**  
lot 4, Spenard East subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

DR. BY: CLARK  
DATE: 18 JUL 22


100  
50  
25  
10  
5  
0

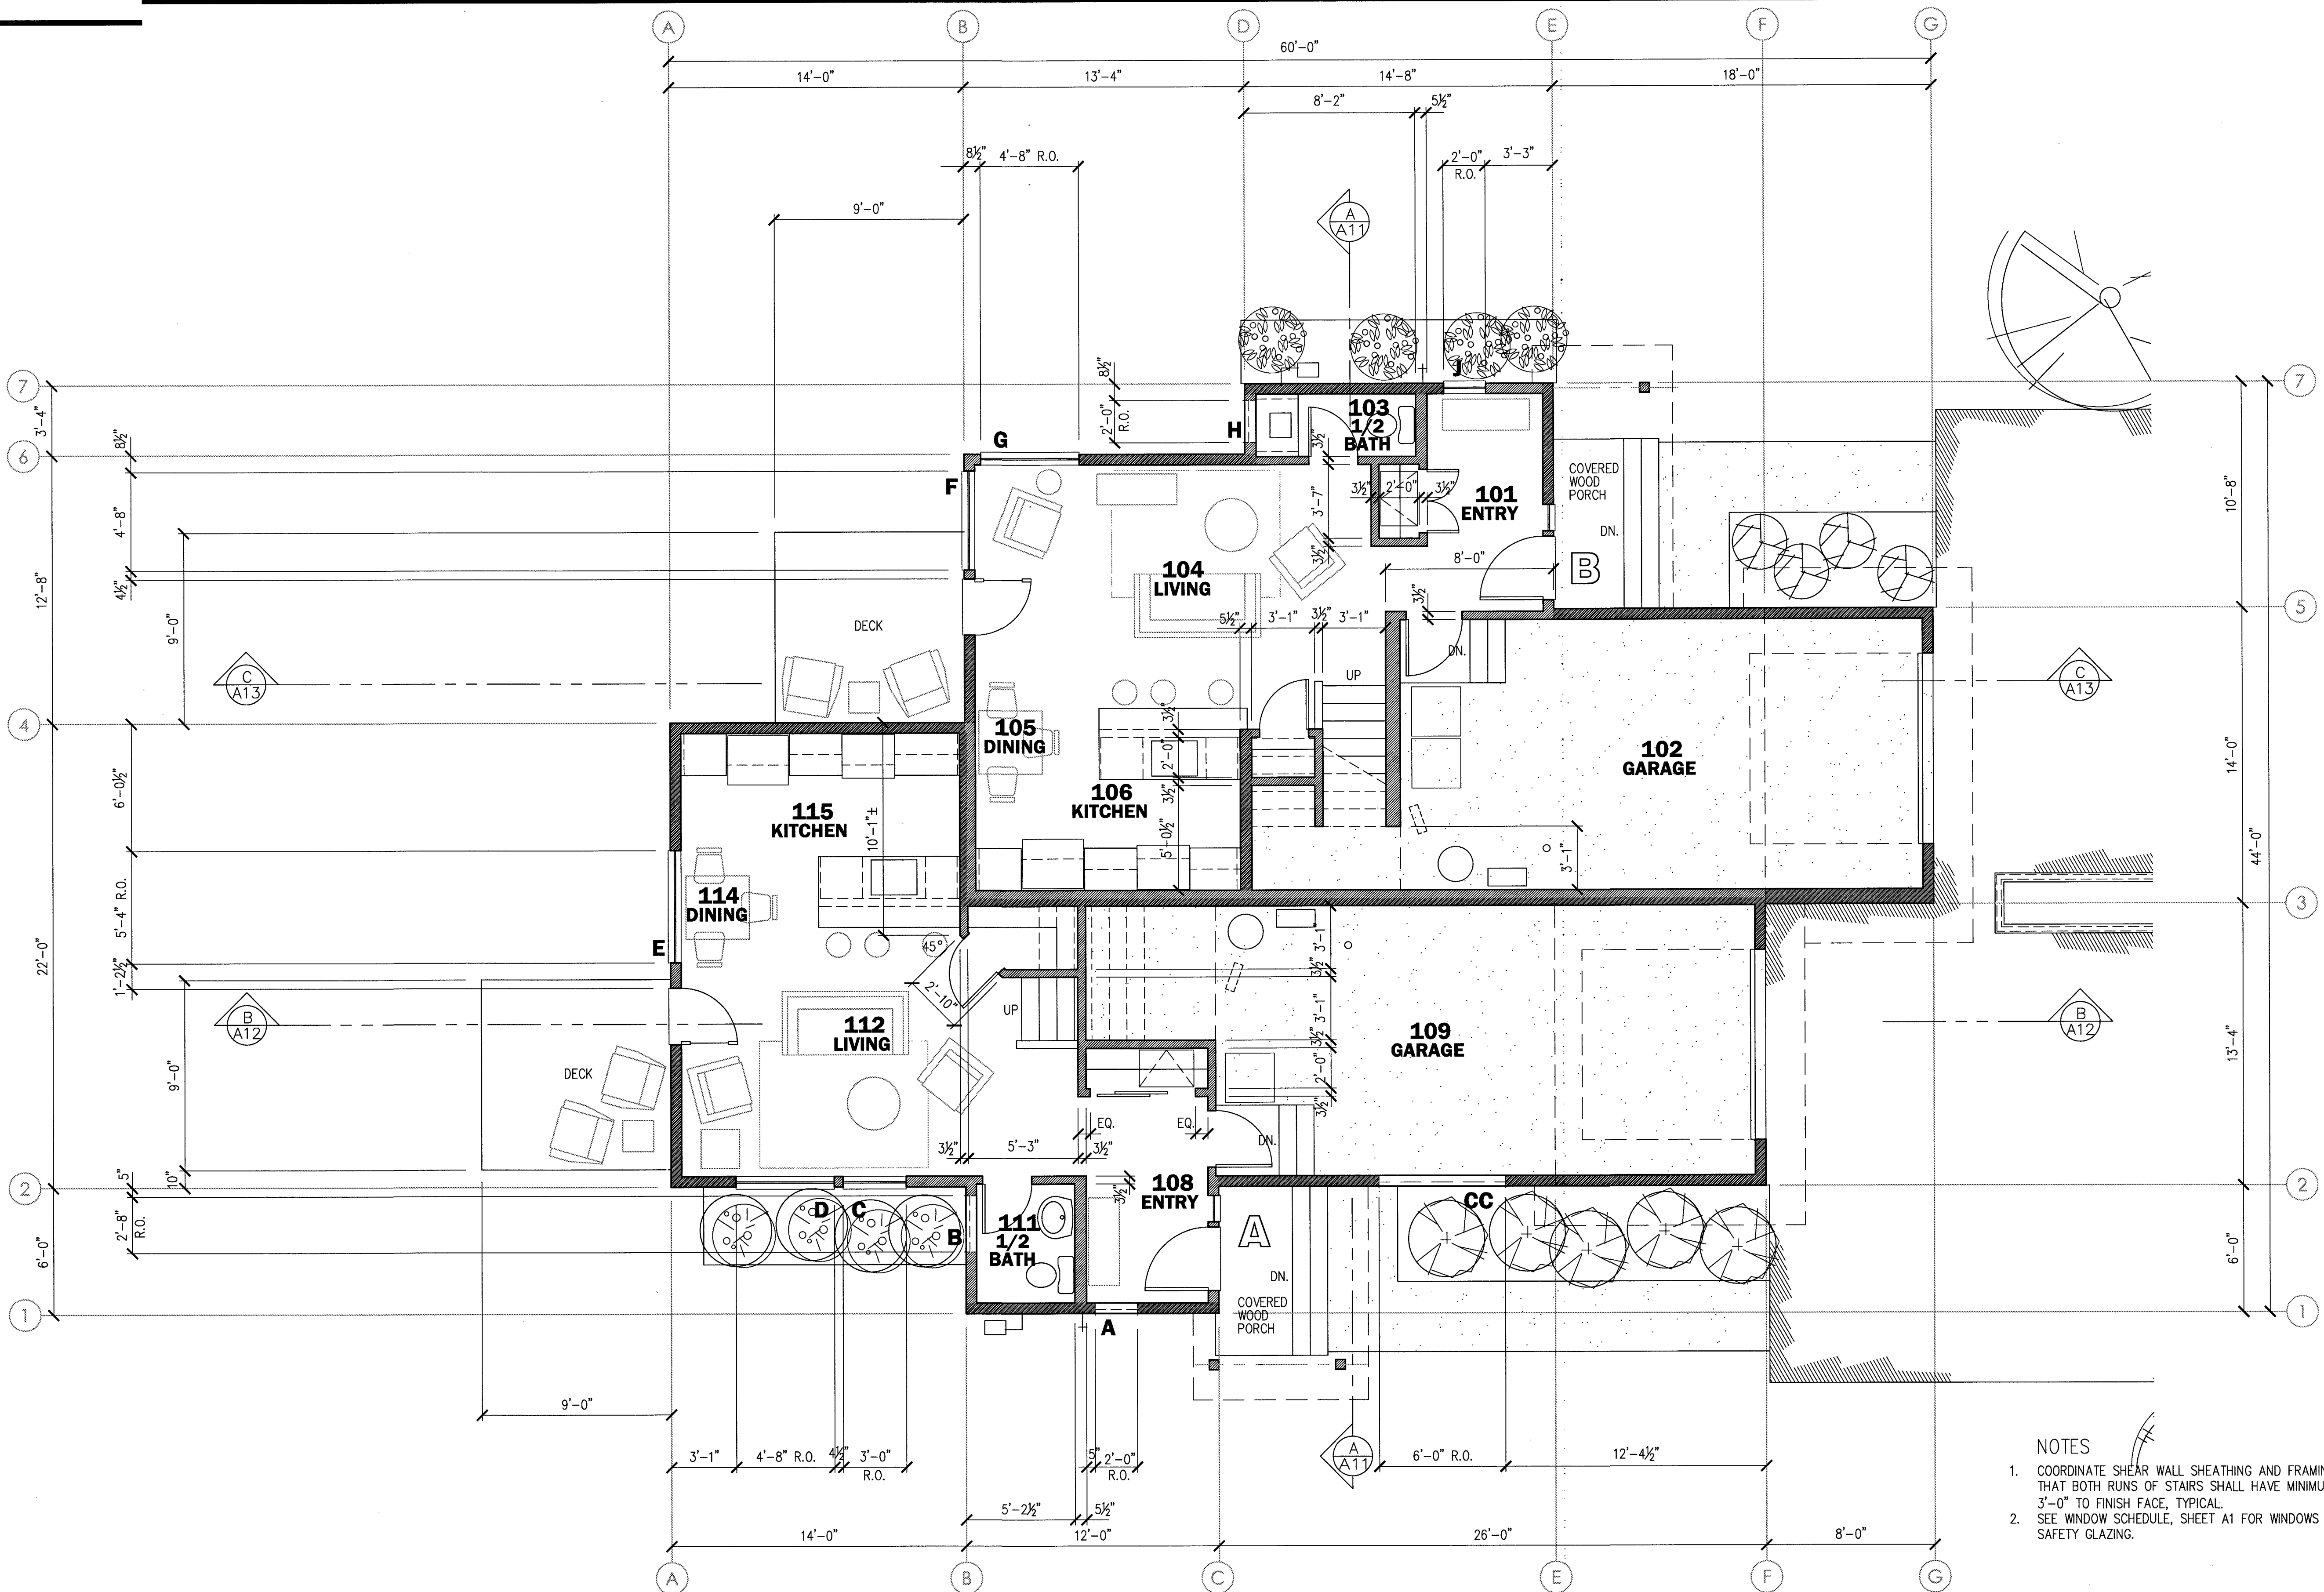

Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety


- NOTES**
- COORDINATE SHEAR WALL SHEATHING AND FRAMING DIMENSIONS IN ORDER THAT BOTH RUNS OF STAIRS SHALL HAVE MINIMUM CLEAR DIMENSION OF 3'-0" TO FINISH FACE, TYPICAL.
  - SEE WINDOW SCHEDULE, SHEET A1 FOR WINDOWS REQUIRED TO HAVE SAFETY GLAZING.

**Overall  
First Floor Plan**



**COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
Lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA**


DR. BY: CLARK  
DATE: 18 JUL 22

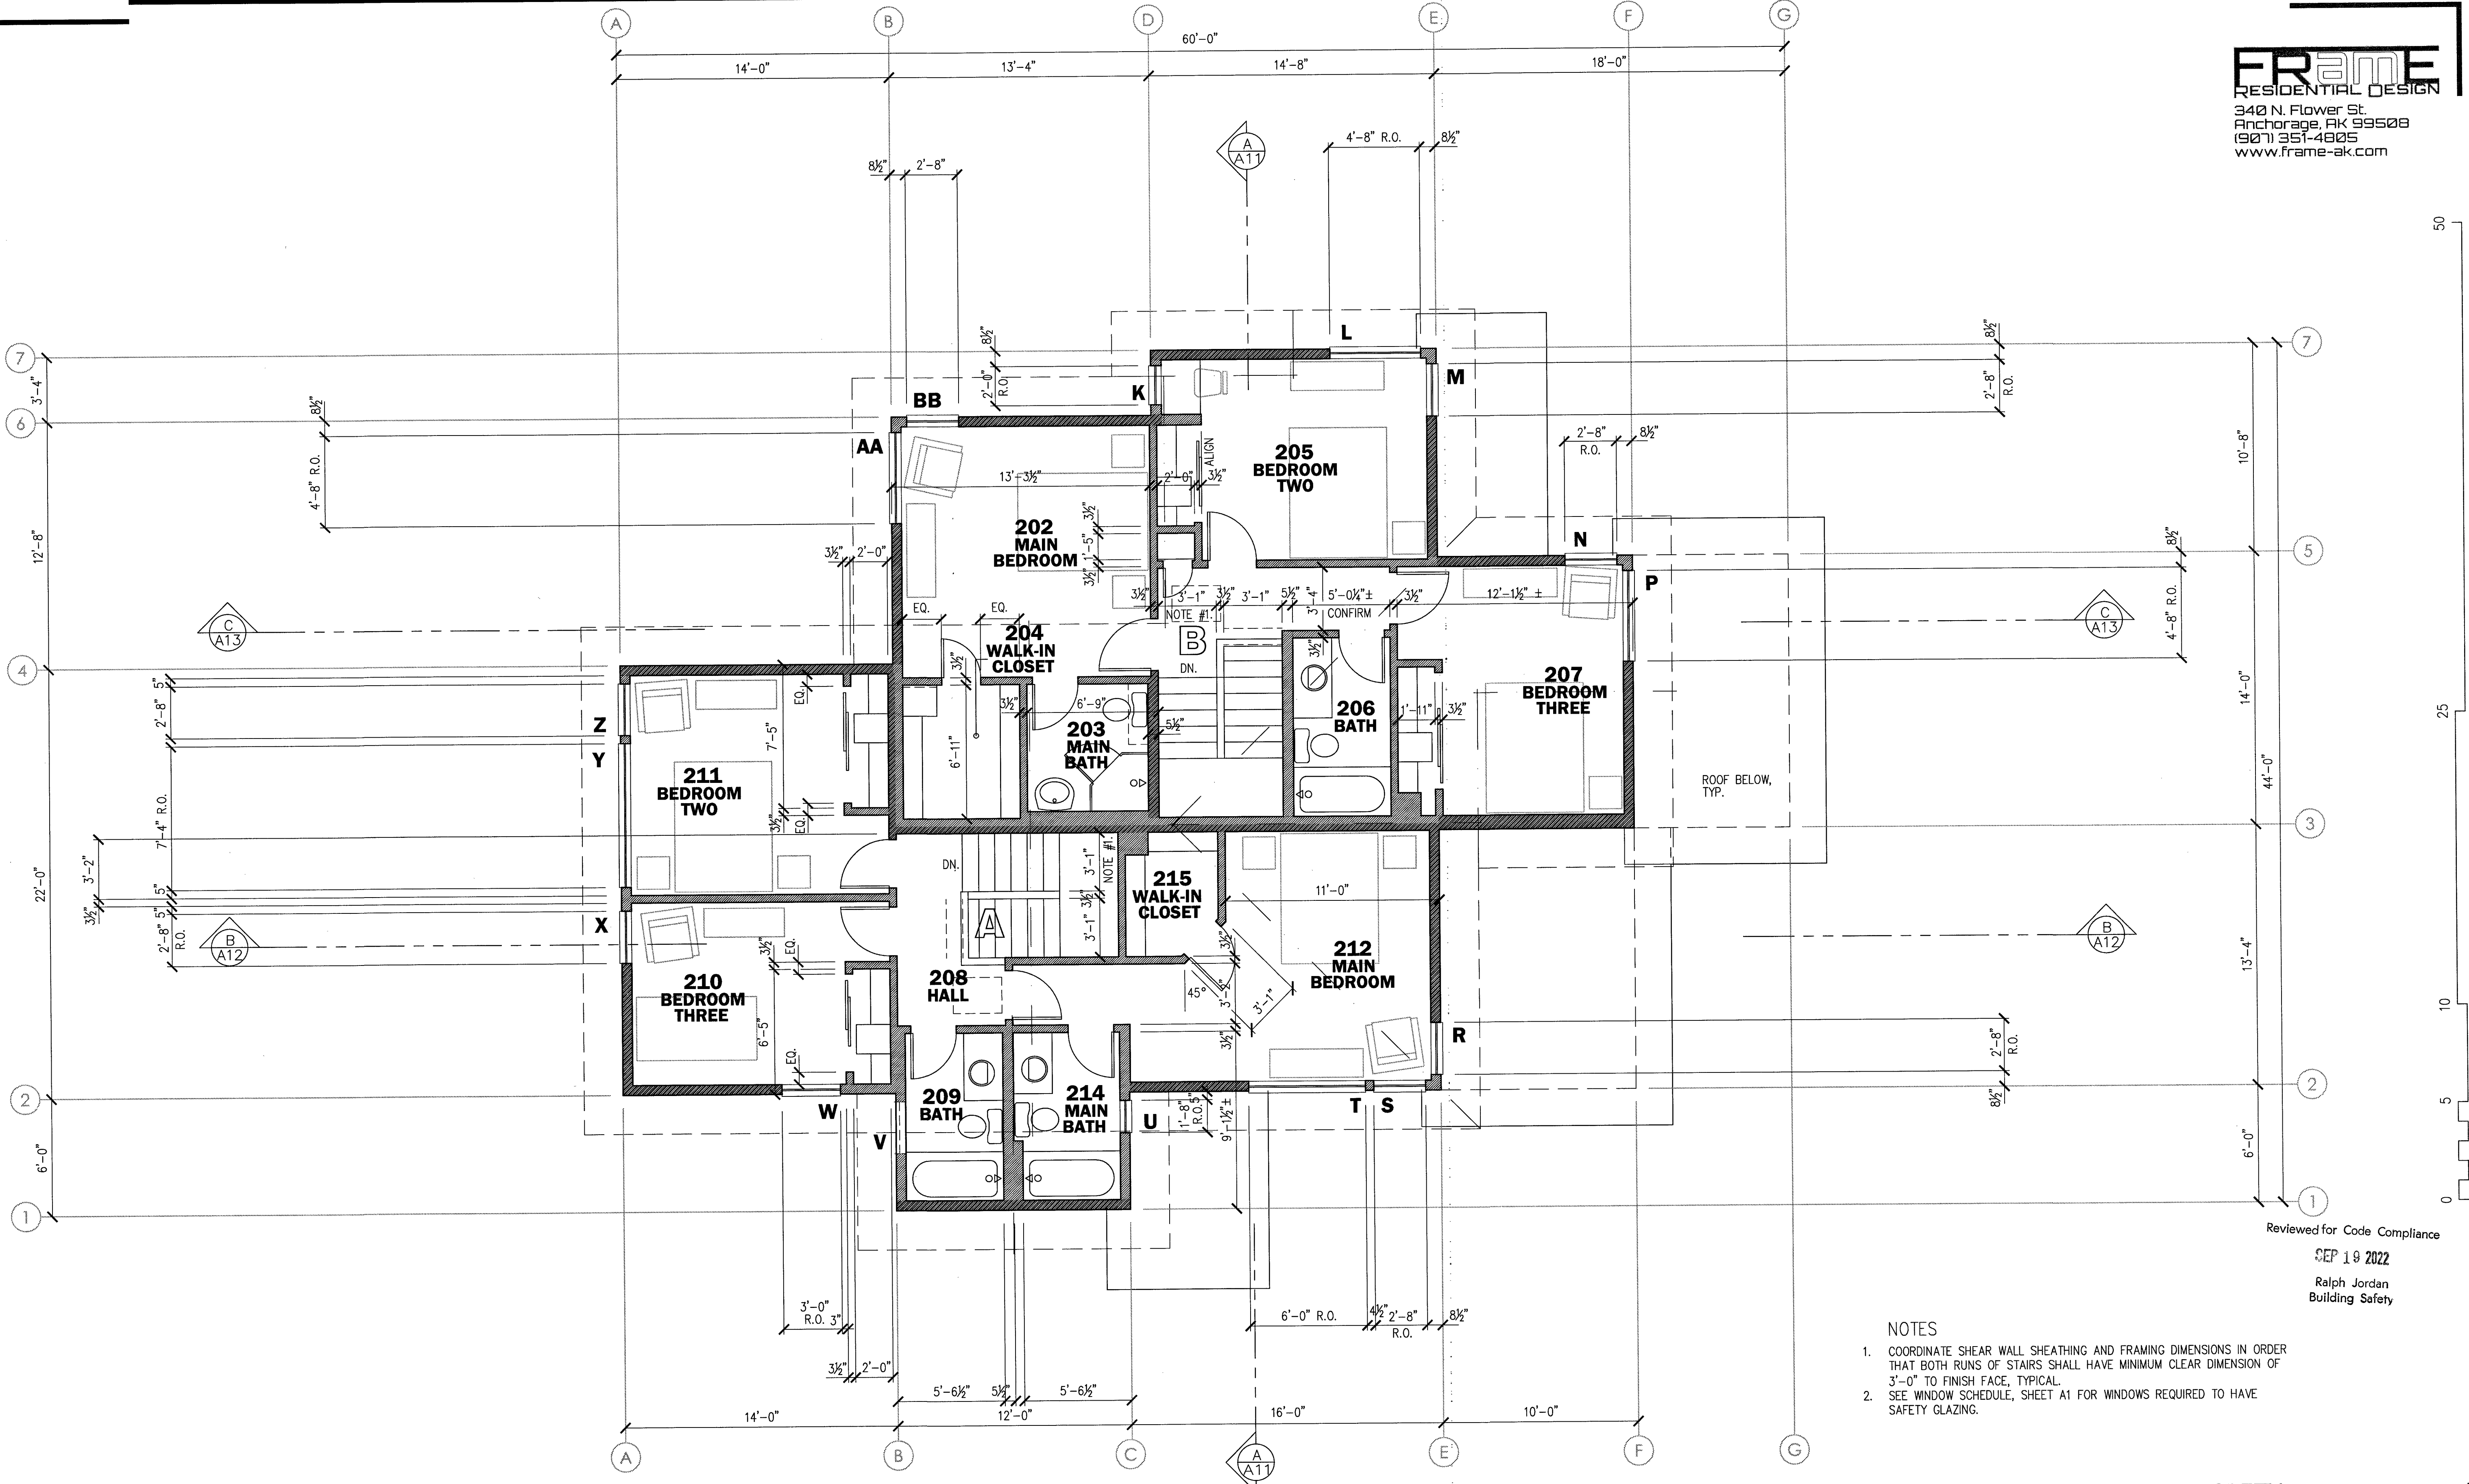

Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety

- NOTES**
- COORDINATE SHEAR WALL SHEATHING AND FRAMING DIMENSIONS IN ORDER THAT BOTH RUNS OF STAIRS SHALL HAVE MINIMUM CLEAR DIMENSION OF 3'-0" TO FINISH FACE, TYPICAL.
  - SEE WINDOW SCHEDULE, SHEET A1 FOR WINDOWS REQUIRED TO HAVE SAFETY GLAZING.



Overall  
Second Floor Plan




COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
101 4, Spenard East subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

DR. BY: CLARK  
DATE: 18 JUL 22

**A5**  
6 of 23

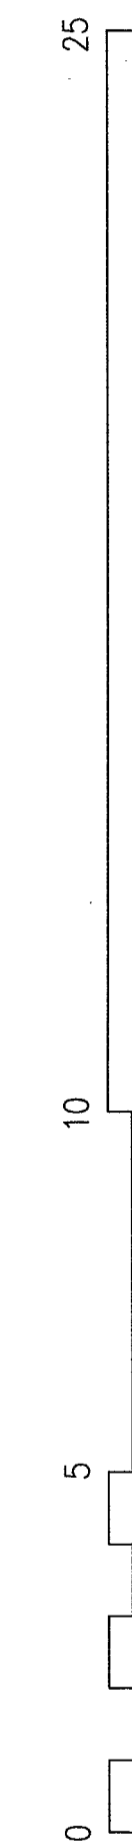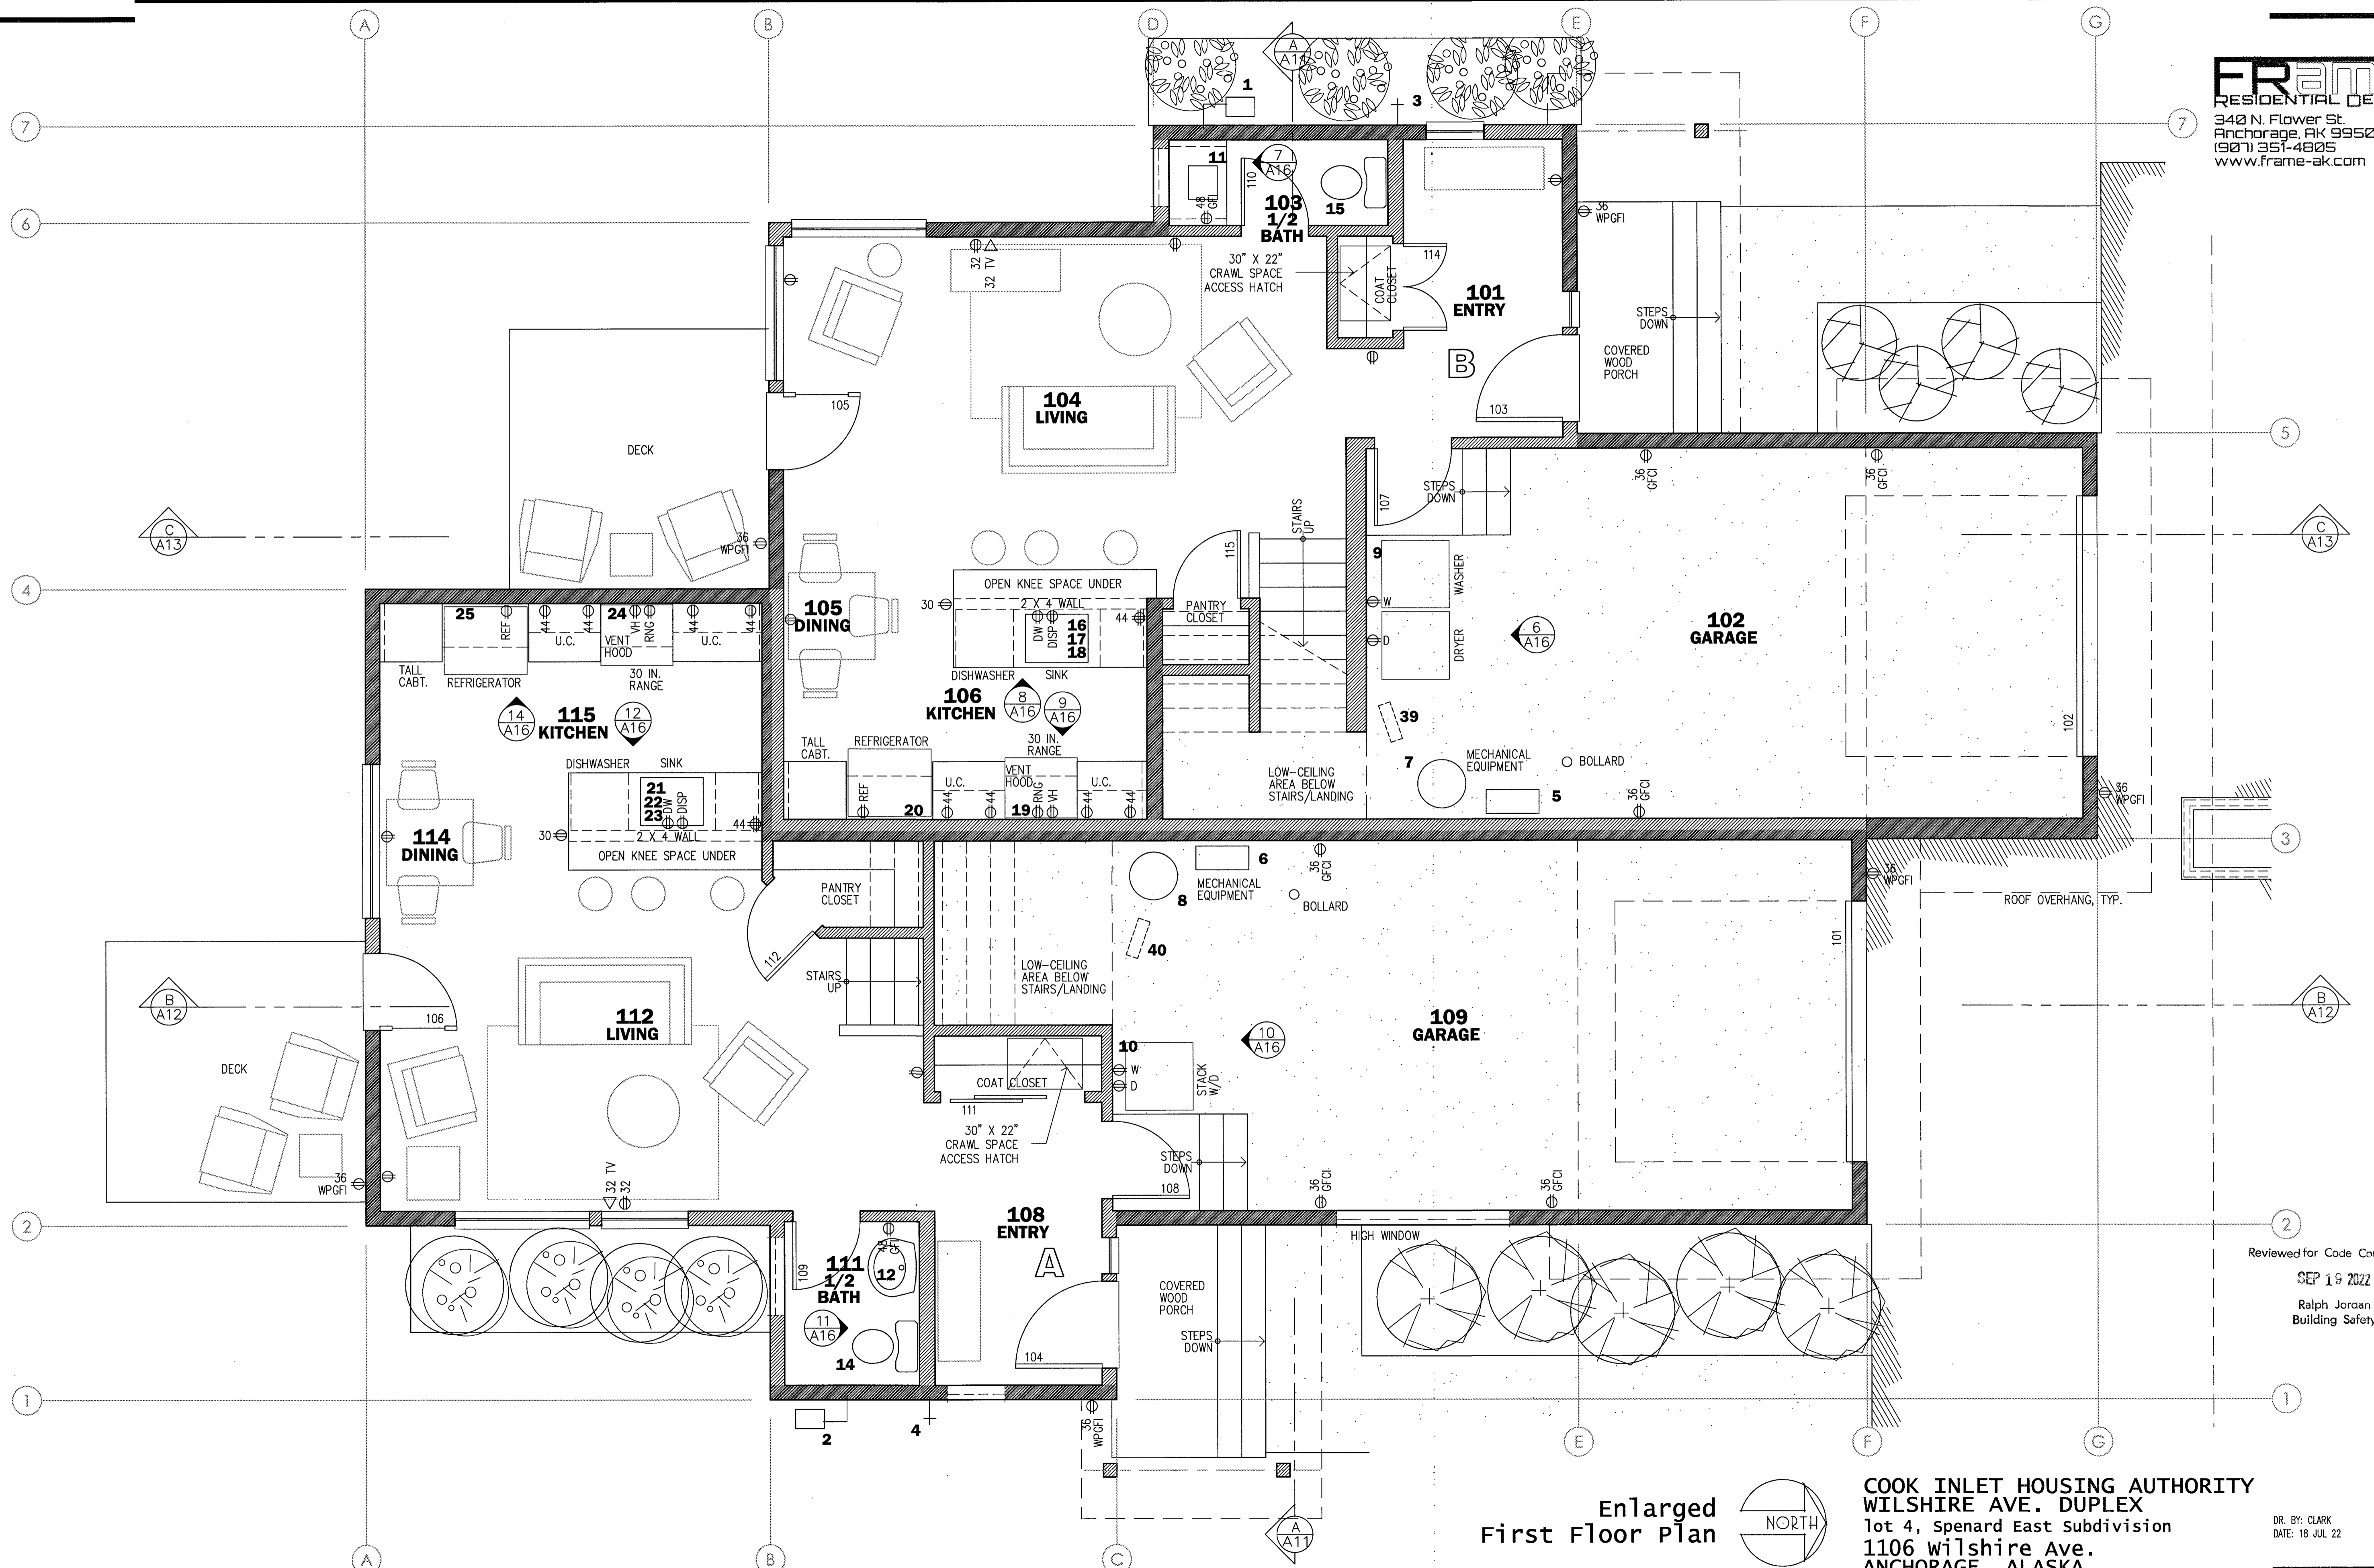


Enlarged  
First Floor Plan



COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety

DR. BY: CLARK  
DATE: 18 JUL 22

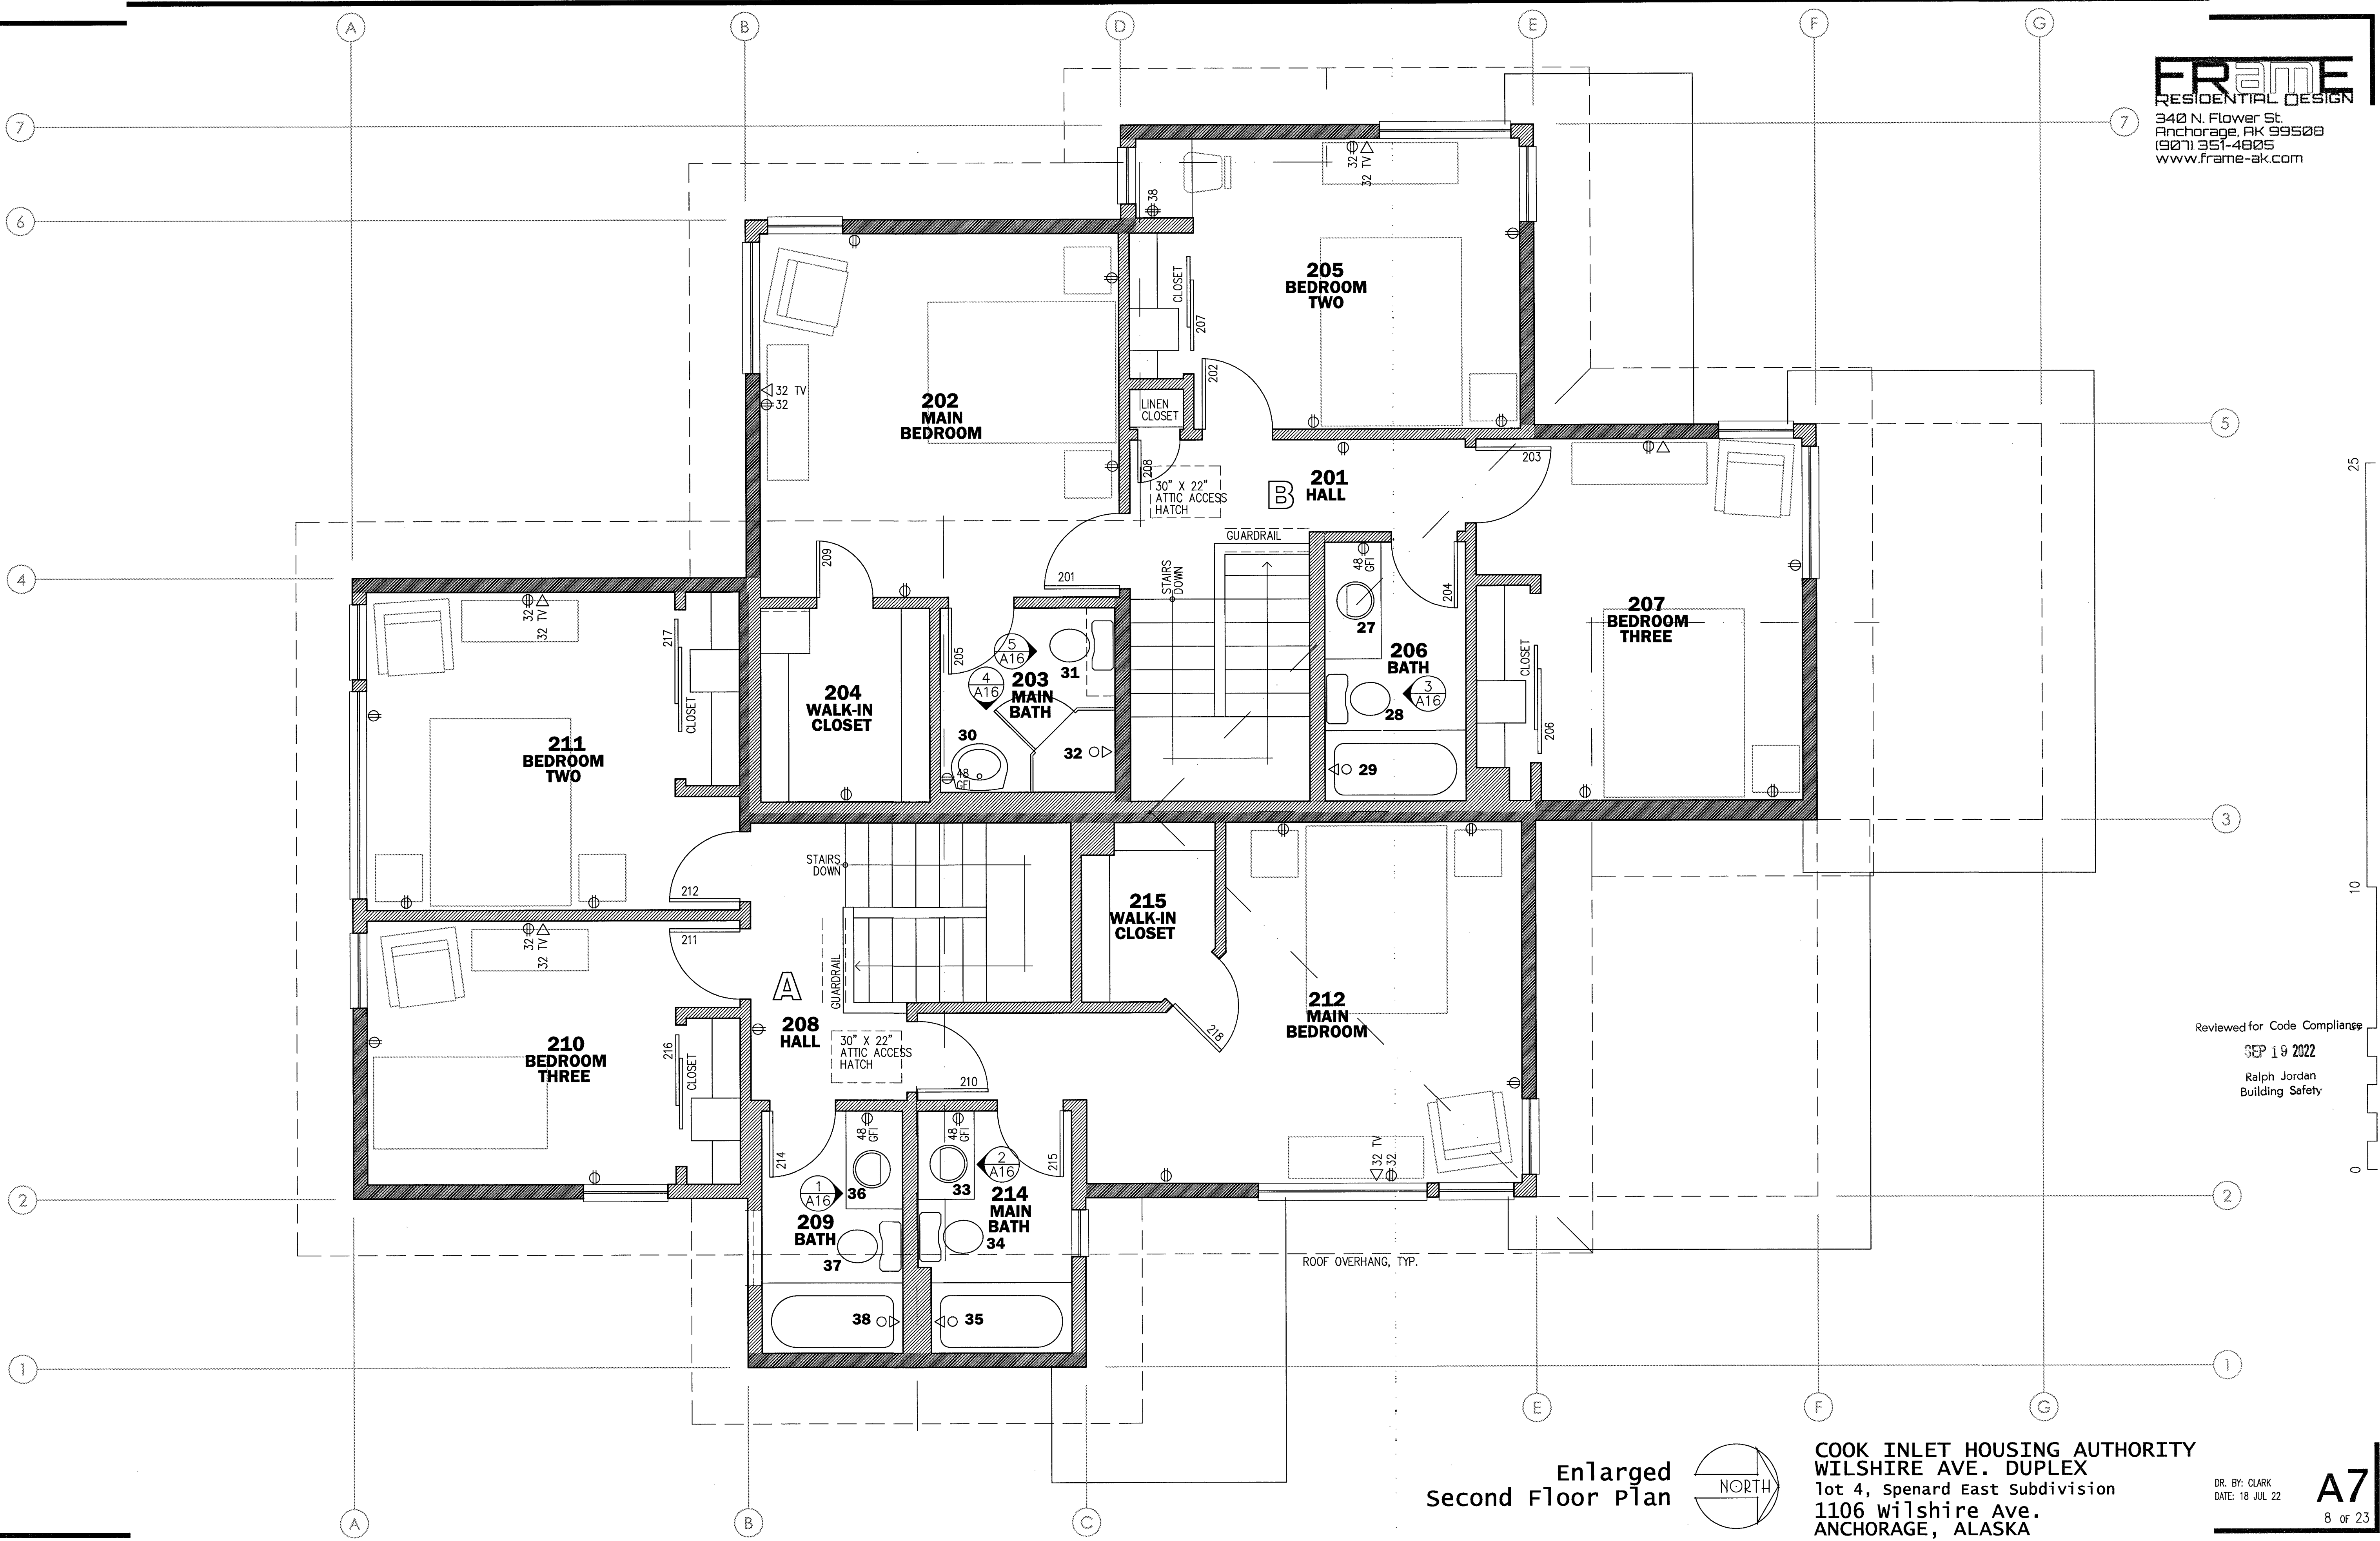


Reviewed for Code Compliance

SEP 19 2022  
Ralph Jordan  
Building Safety


25  
10  
0

Enlarged  
Second Floor Plan



COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

DR. BY: CLARK  
DATE: 18 JUL 22

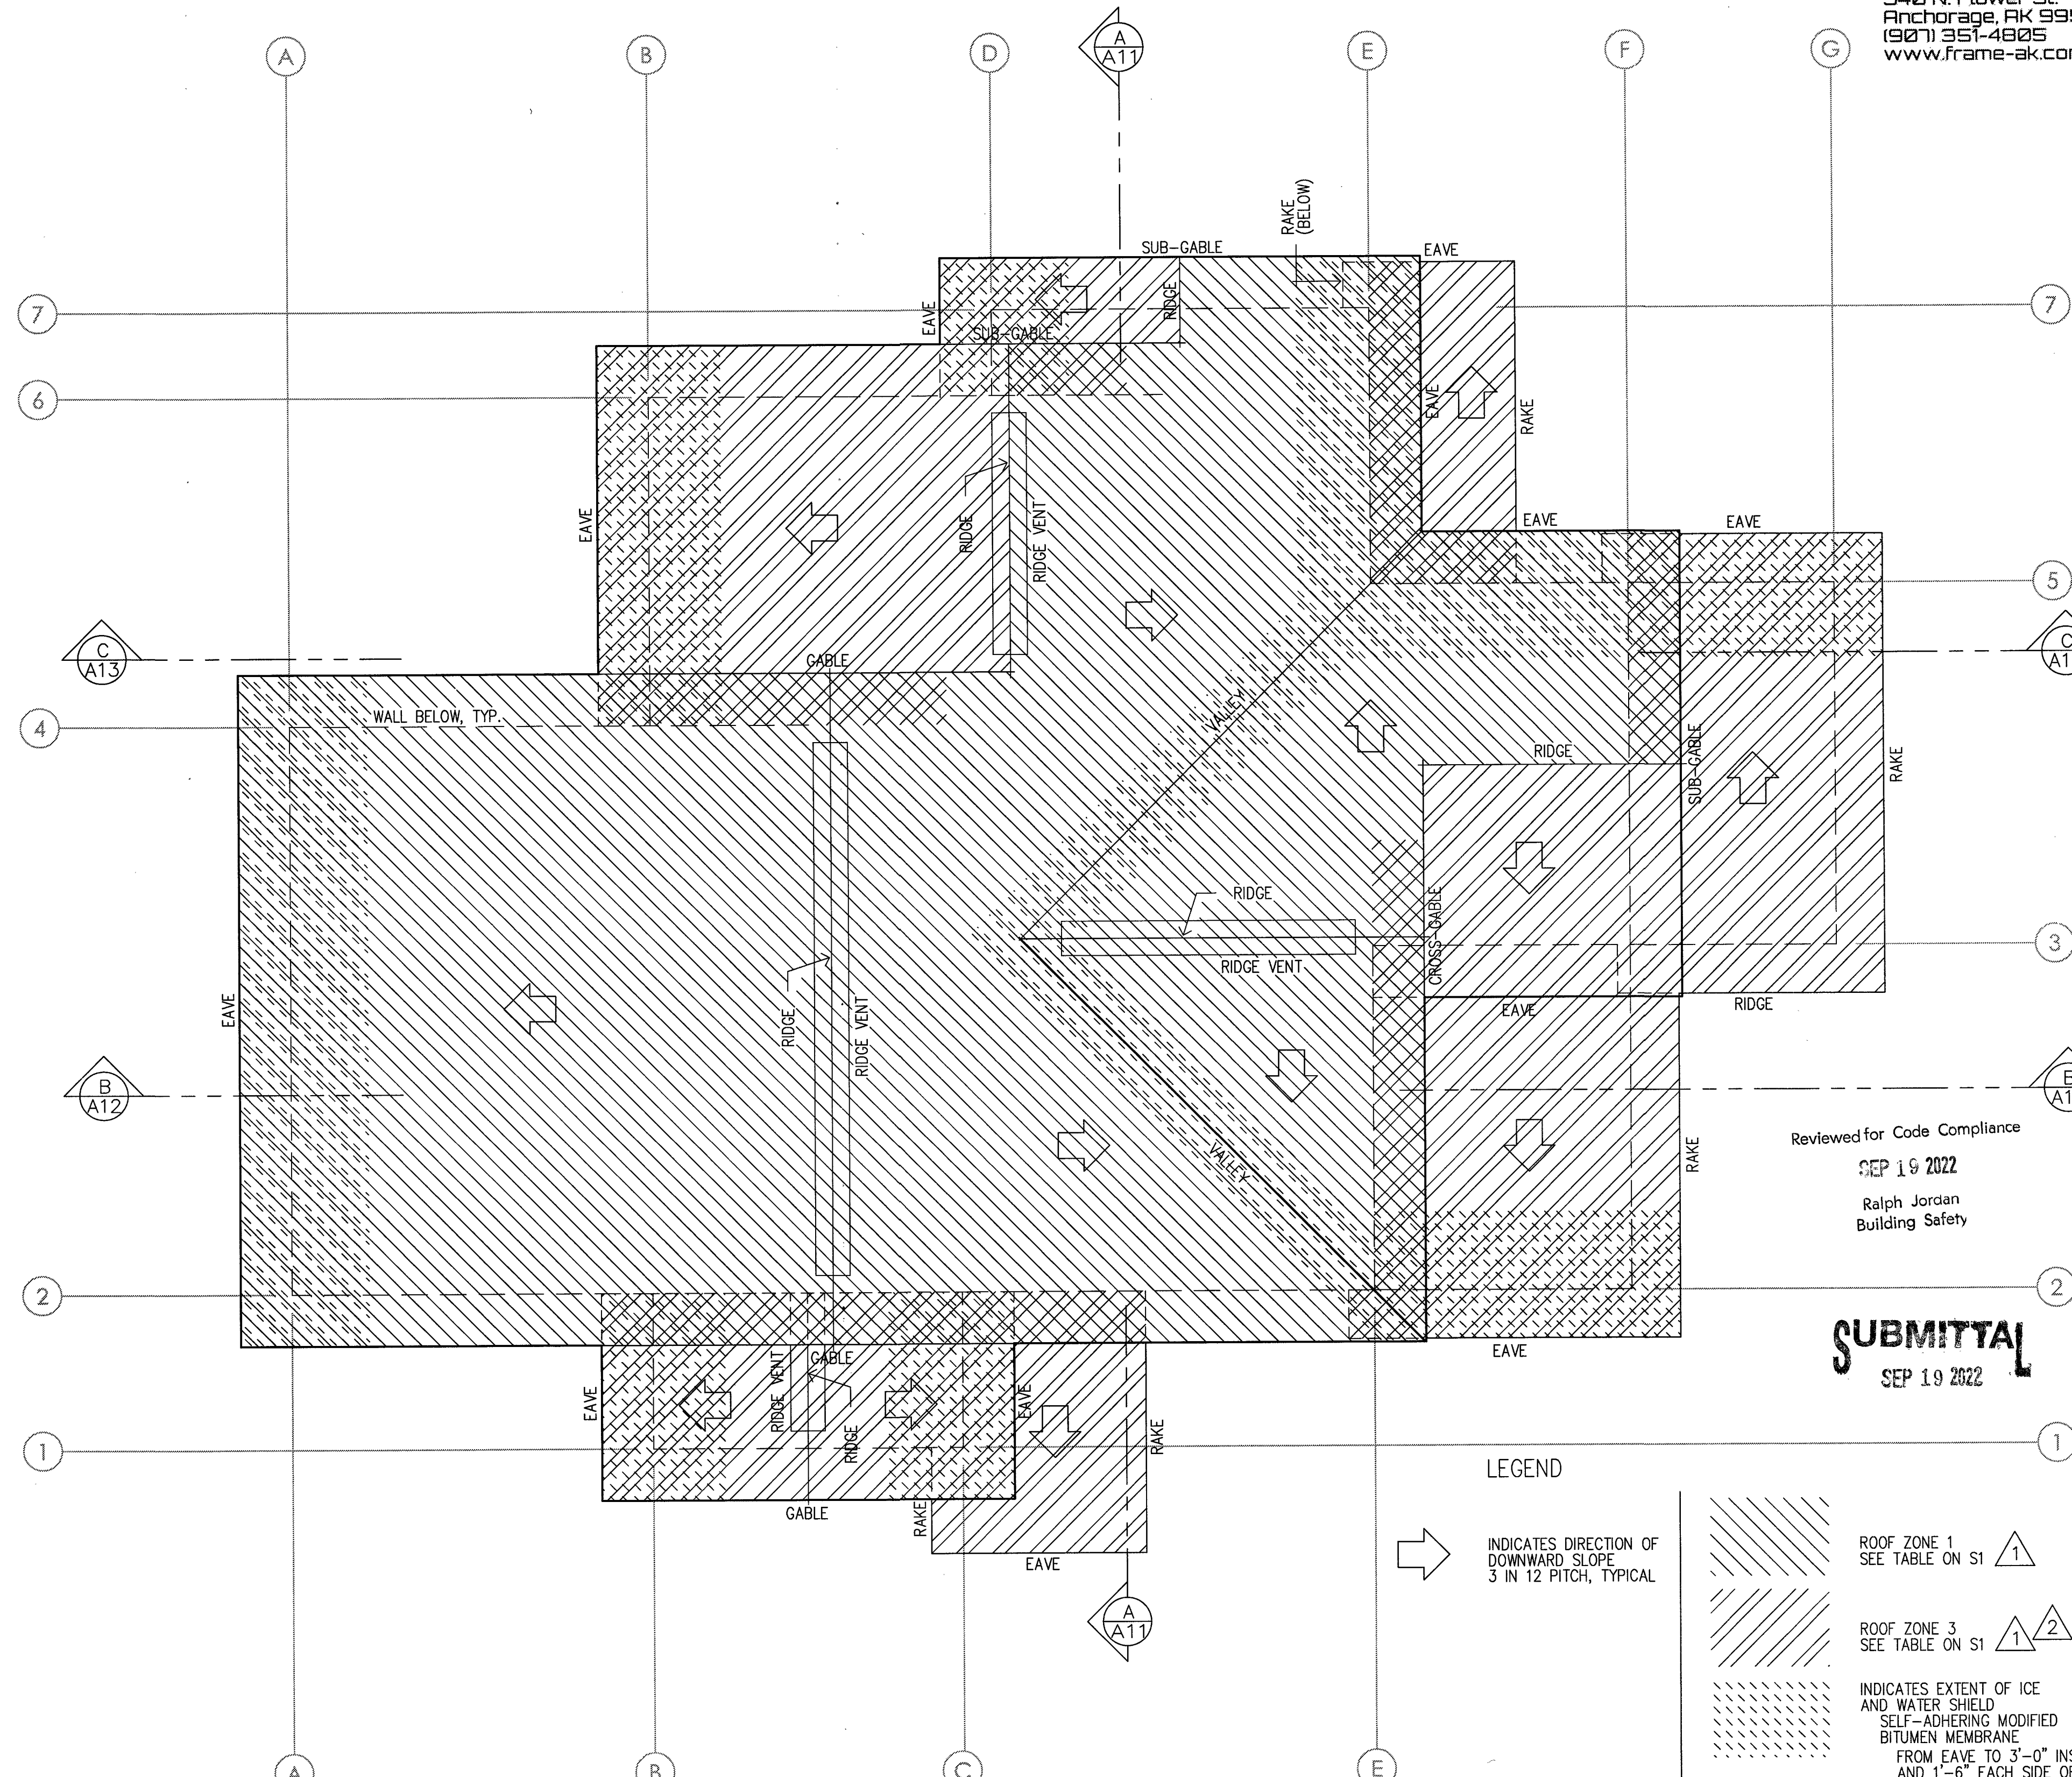

Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety


**SUBMITTAL**  
SEP 19 2022

**LEGEND**



- ➡ INDICATES DIRECTION OF DOWNWARD SLOPE 3 IN 12 PITCH, TYPICAL
- ▨ ROOF ZONE 1 SEE TABLE ON S1
- ▩ ROOF ZONE 3 SEE TABLE ON S1
- ▧ INDICATES EXTENT OF ICE AND WATER SHIELD SELF-ADHERING MODIFIED BITUMEN MEMBRANE FROM EAVE TO 3'-0" INSIDE EXT. WALLS AND 1'-6" EACH SIDE OF VALLEYS

**Roof Plan**

**COOK INLET HOUSING AUTHORITY**  
**WILSHIRE AVE. DUPLEX**  
lot 4, Spenard East subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA



2 9/16/22  
1 8/26/22  
DATE: 18 JUL 22

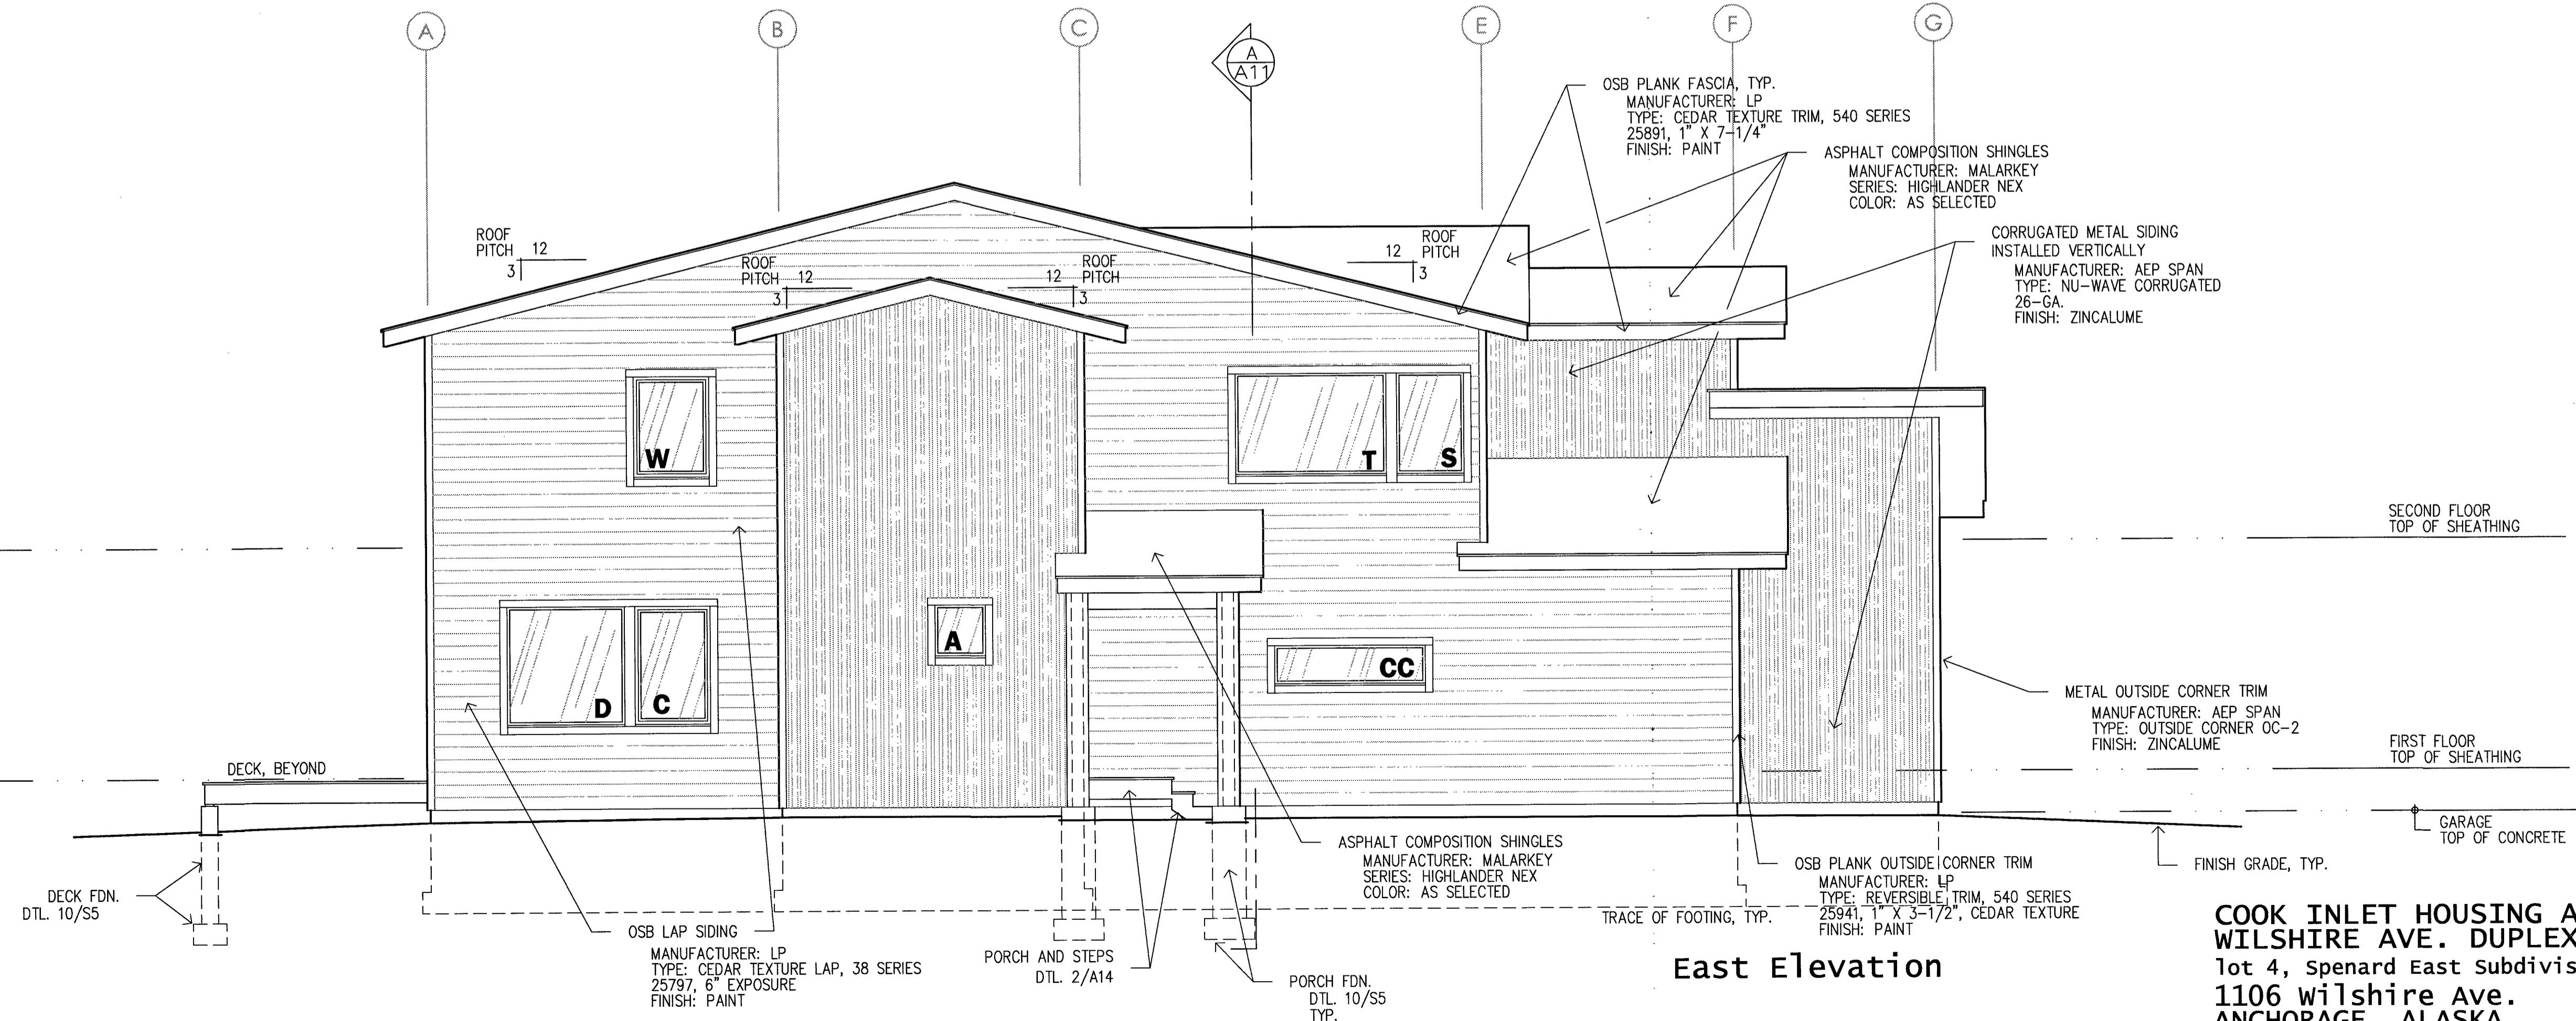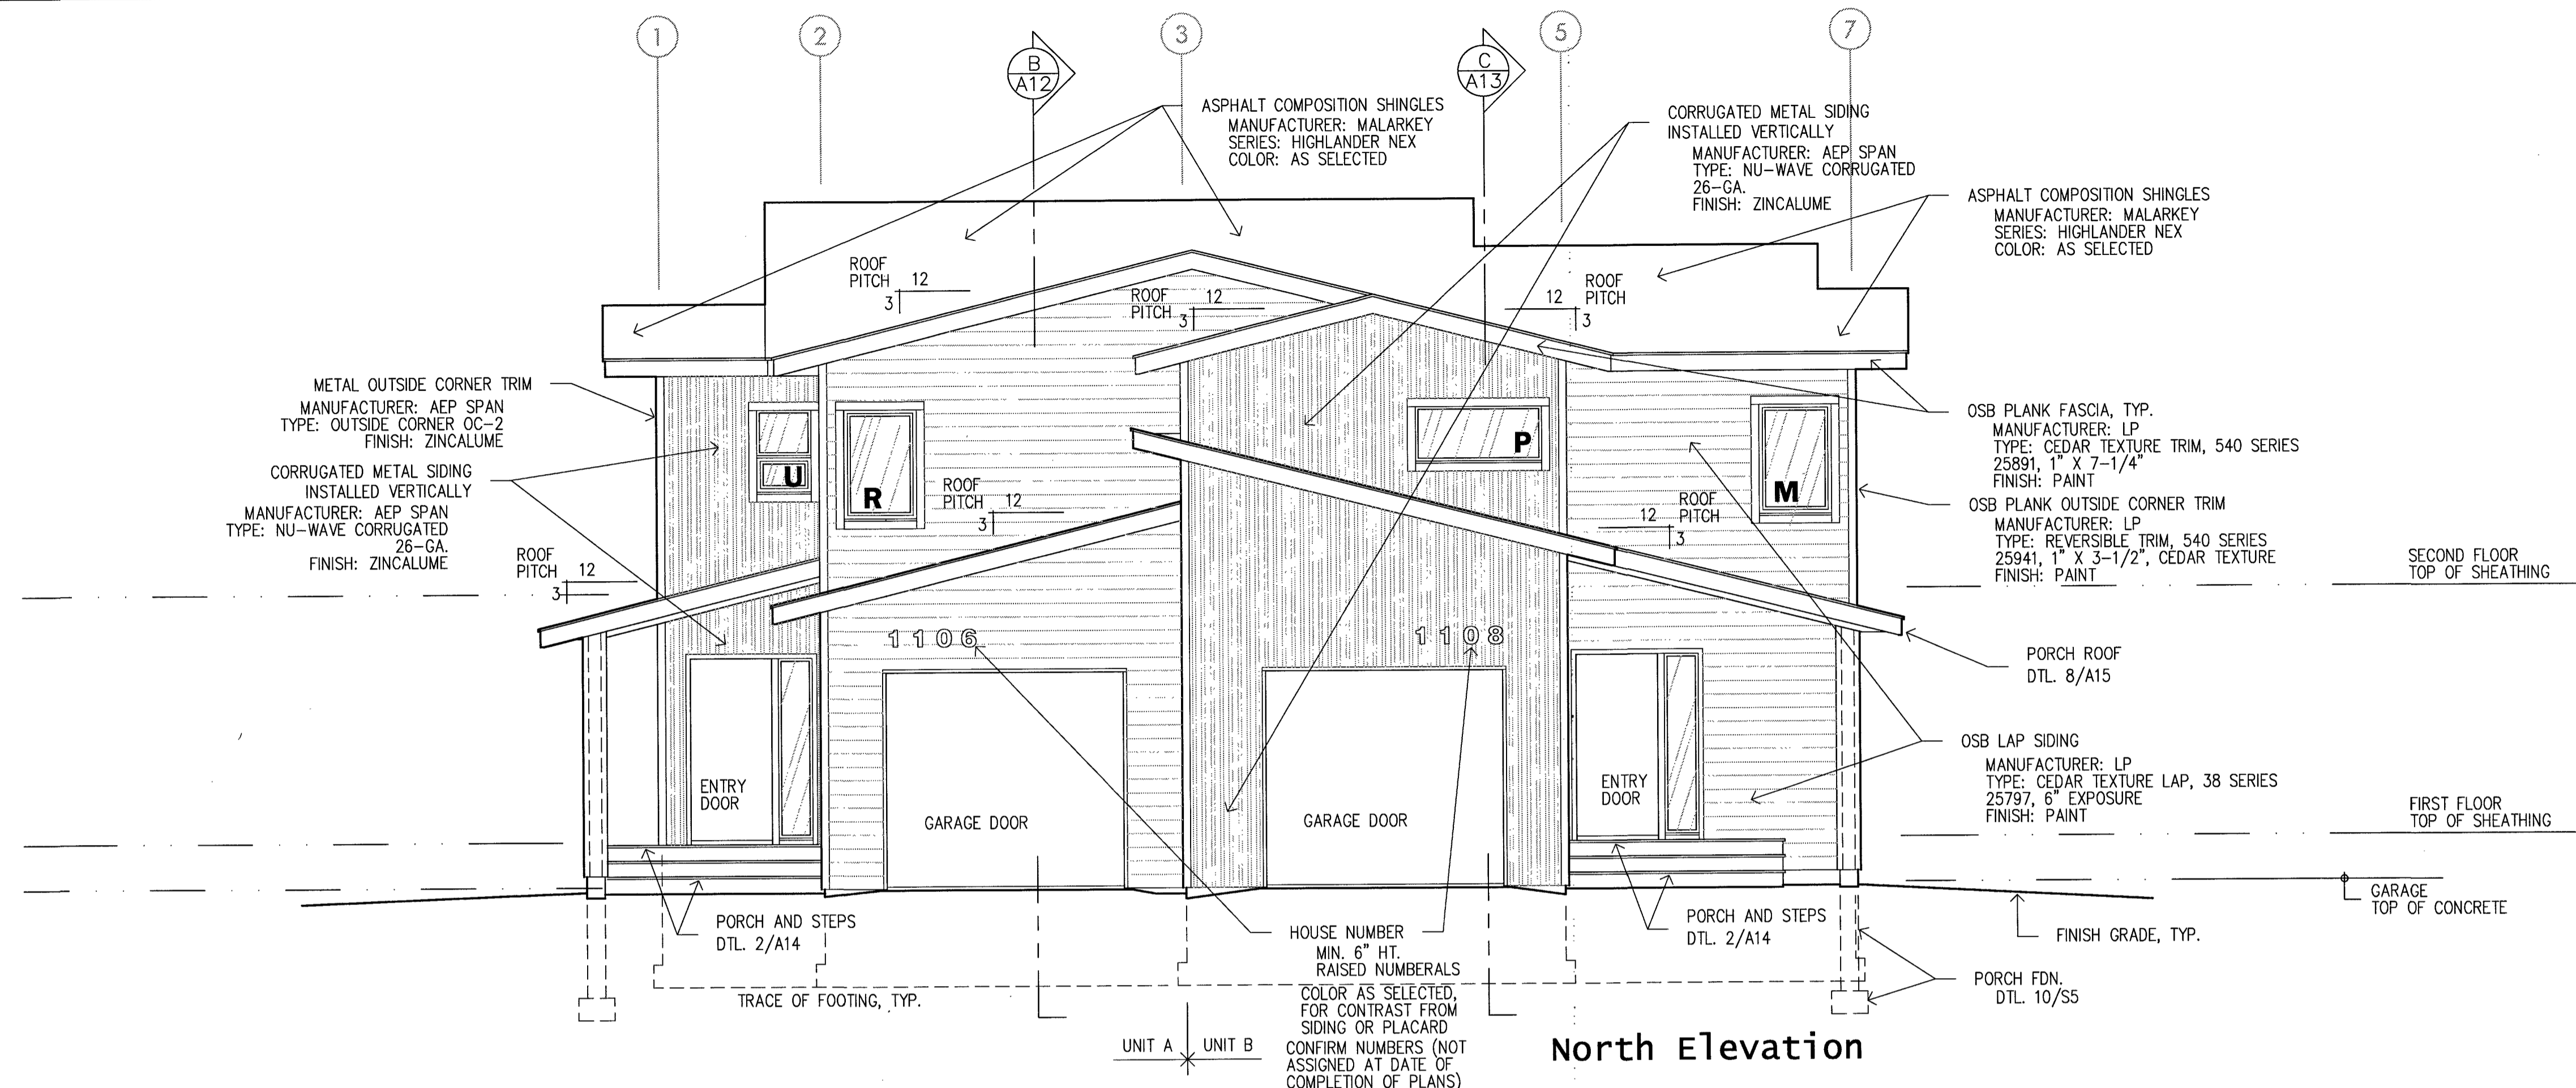


Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety

COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
Tot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

DR. BY: CLARK  
DATE: 18 JUL 22



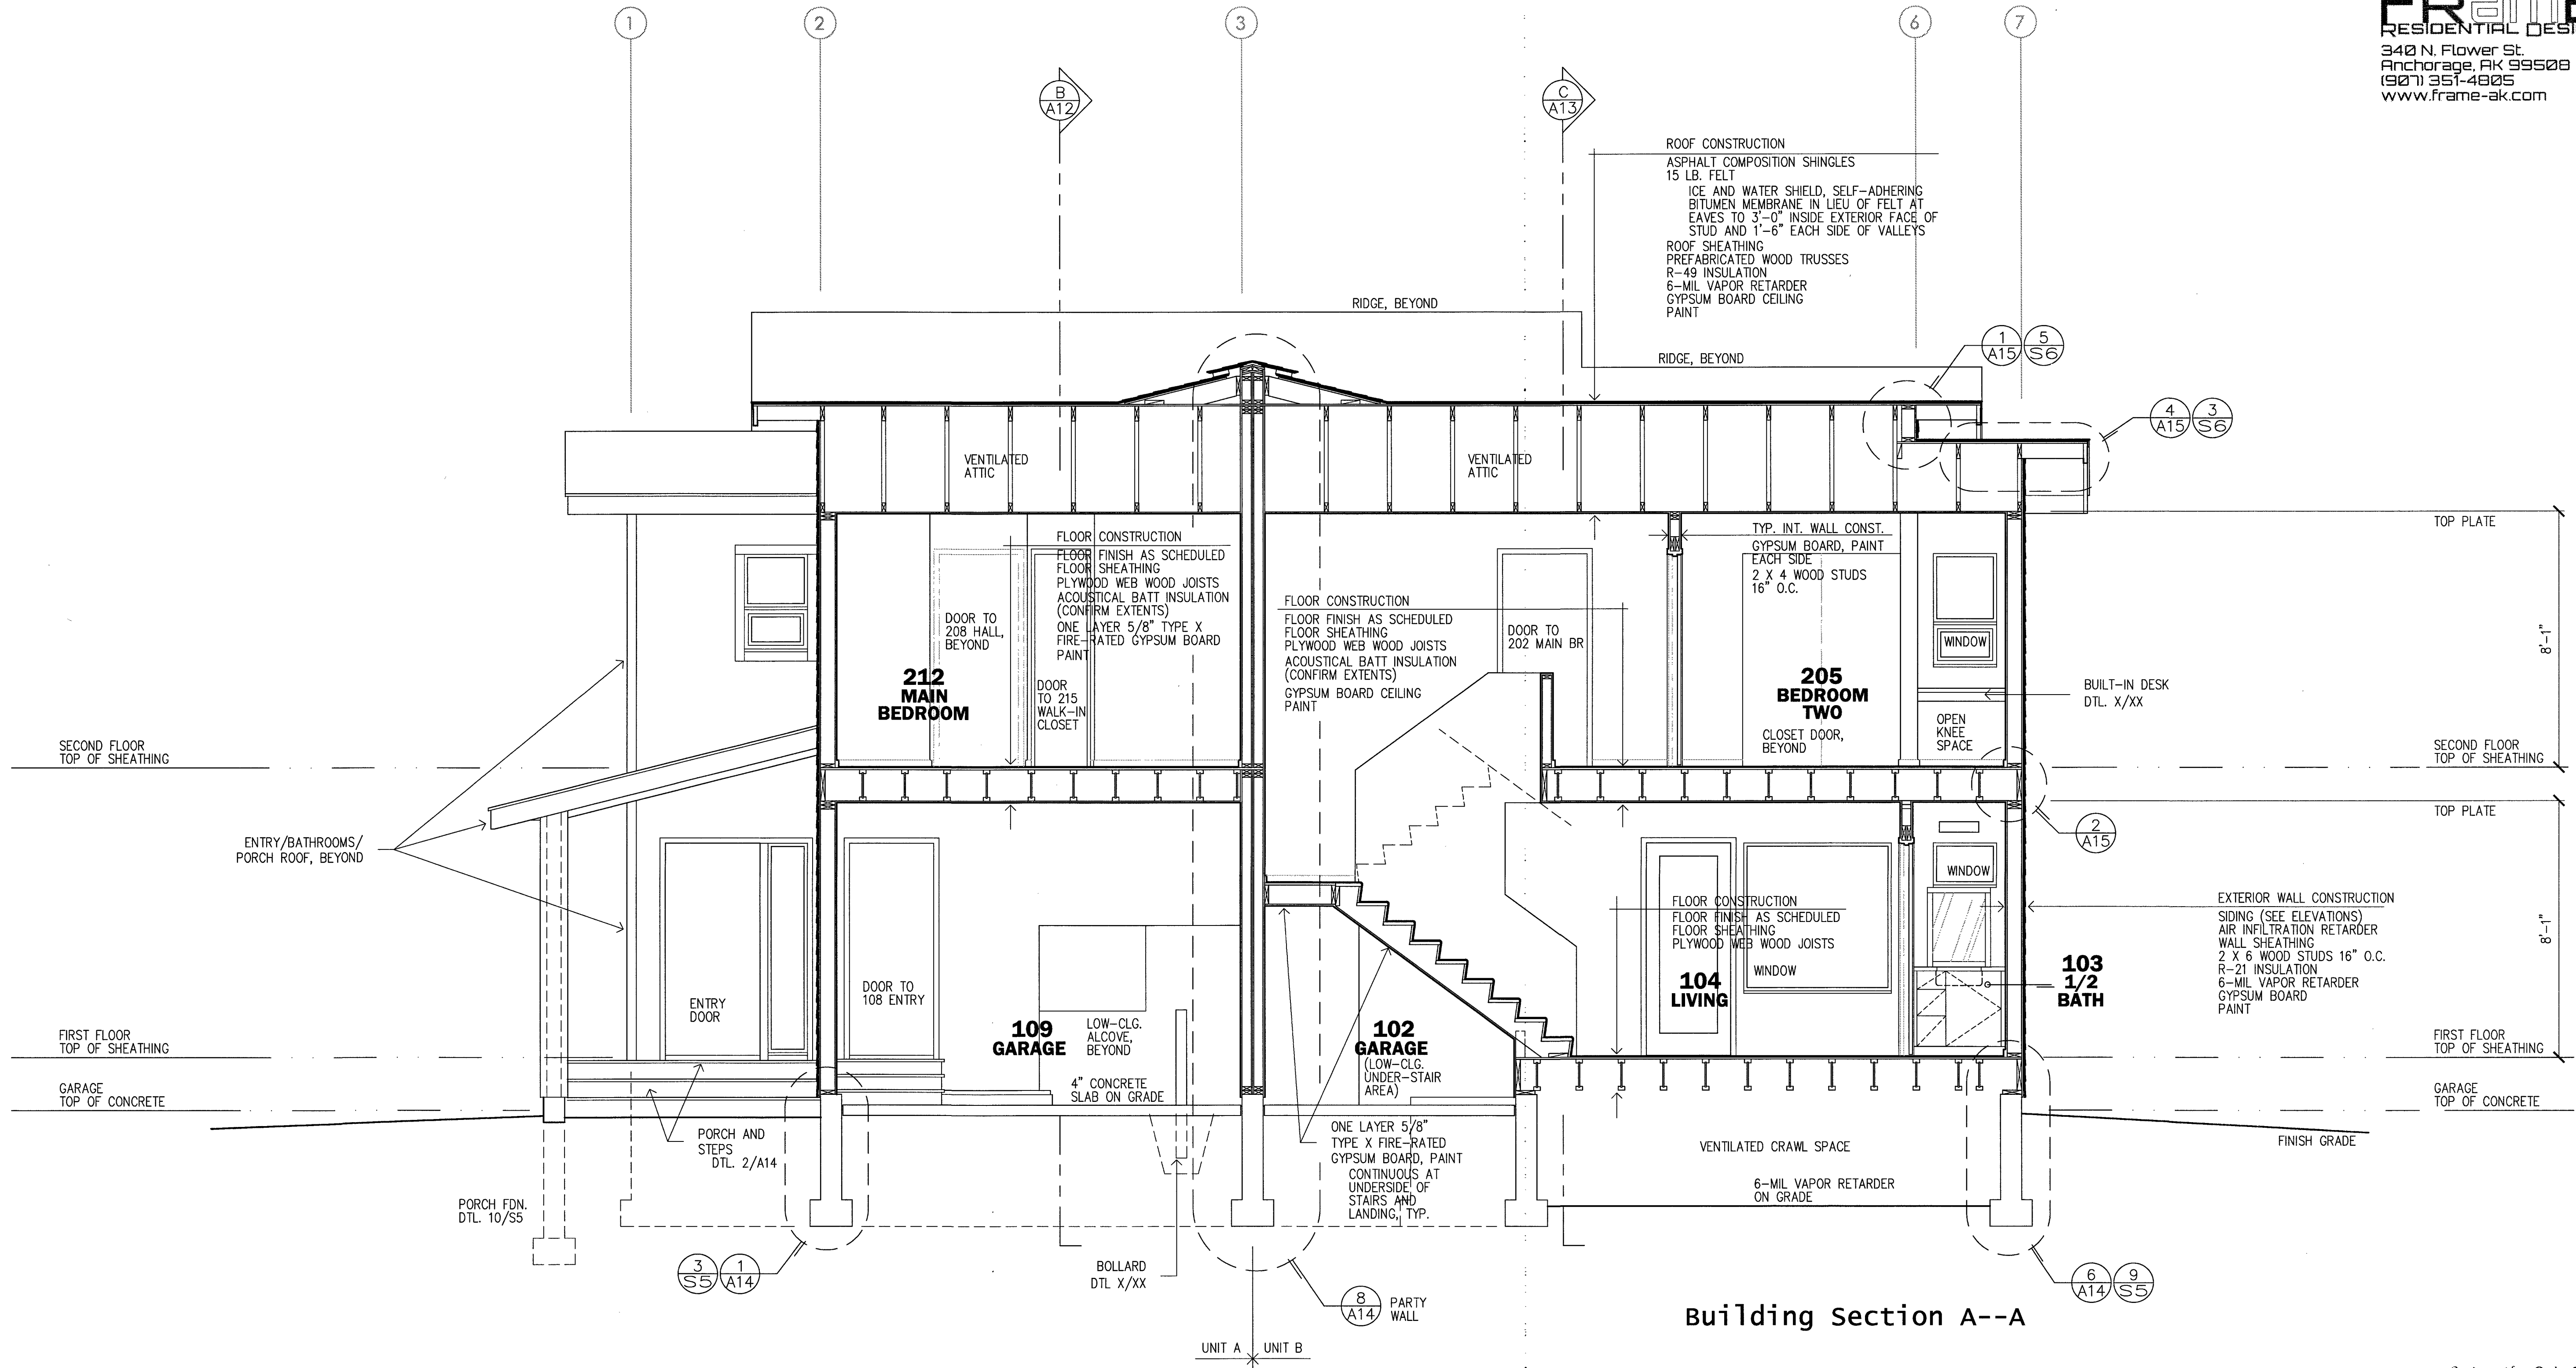


Building Section A--A

Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety

COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
Lot 4, Spenard East subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

DR. BY: CLARK  
DATE: 18 JUL 22  
**A11**  
12 OF 23

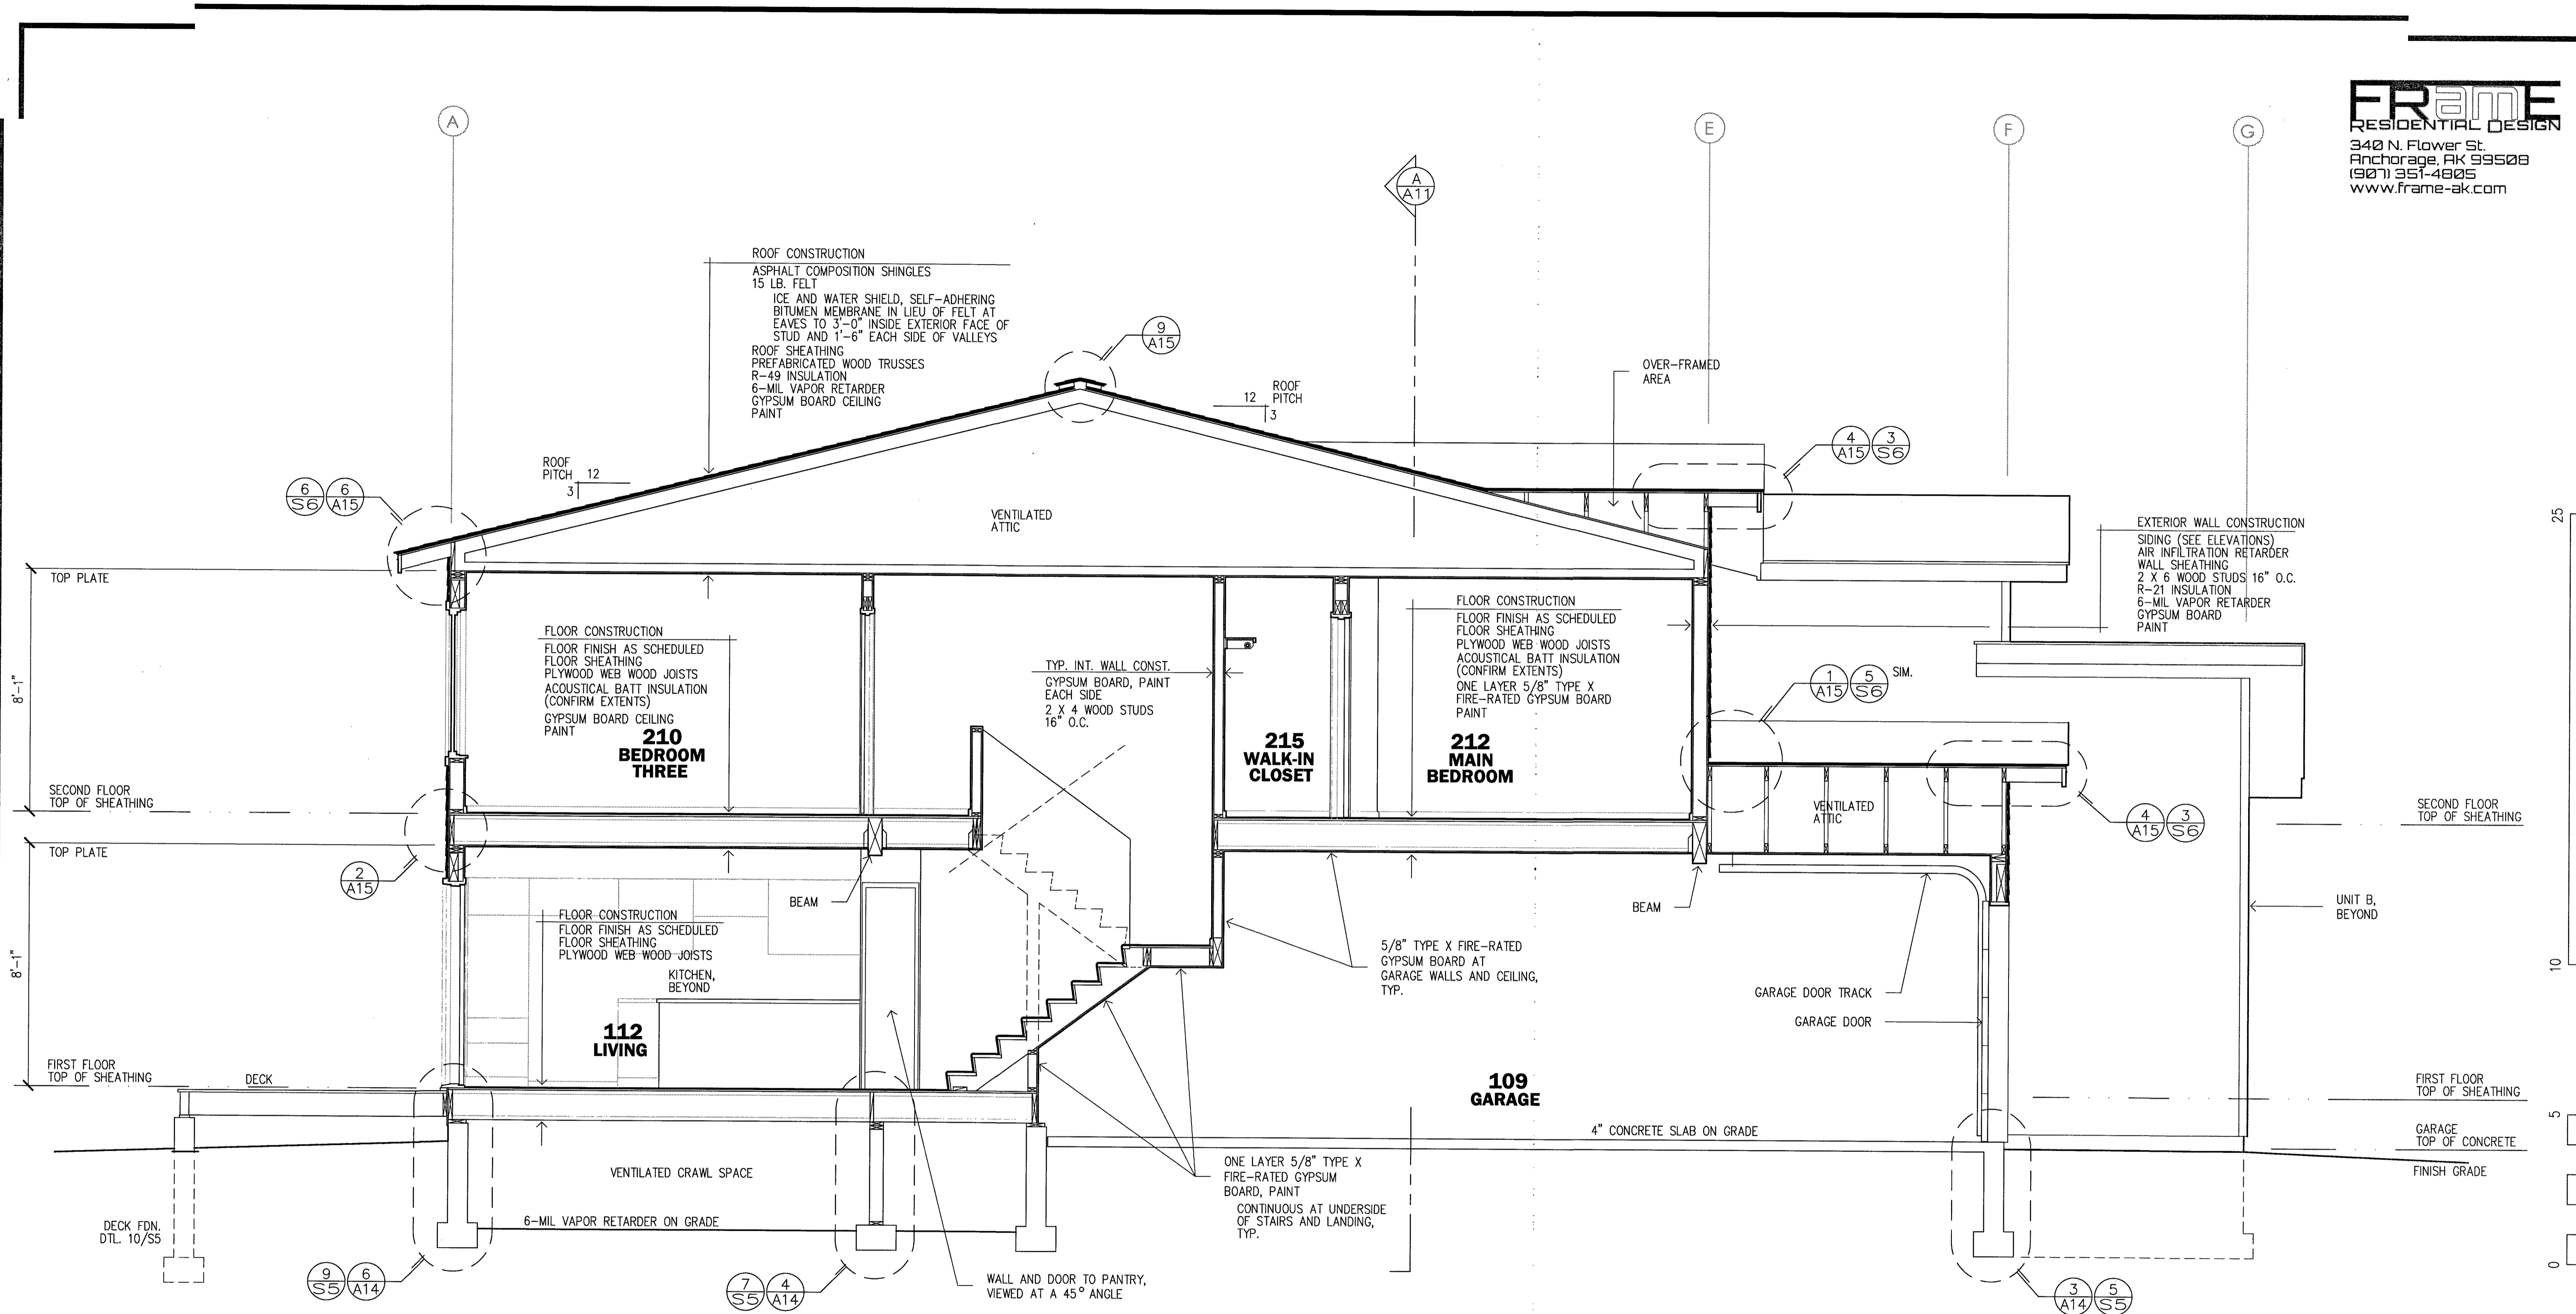


**Building Section B--B**  
UNIT A

Reviewed for Code Compliance  
SEP 18 2022  
Ralph Jordan  
Building Safety

**COOK INLET HOUSING AUTHORITY**  
**WILSHIRE AVE. DUPLEX**  
lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

DR. BY: CLARK  
DATE: 18 JUL 22

**A12**  
13 OF 23

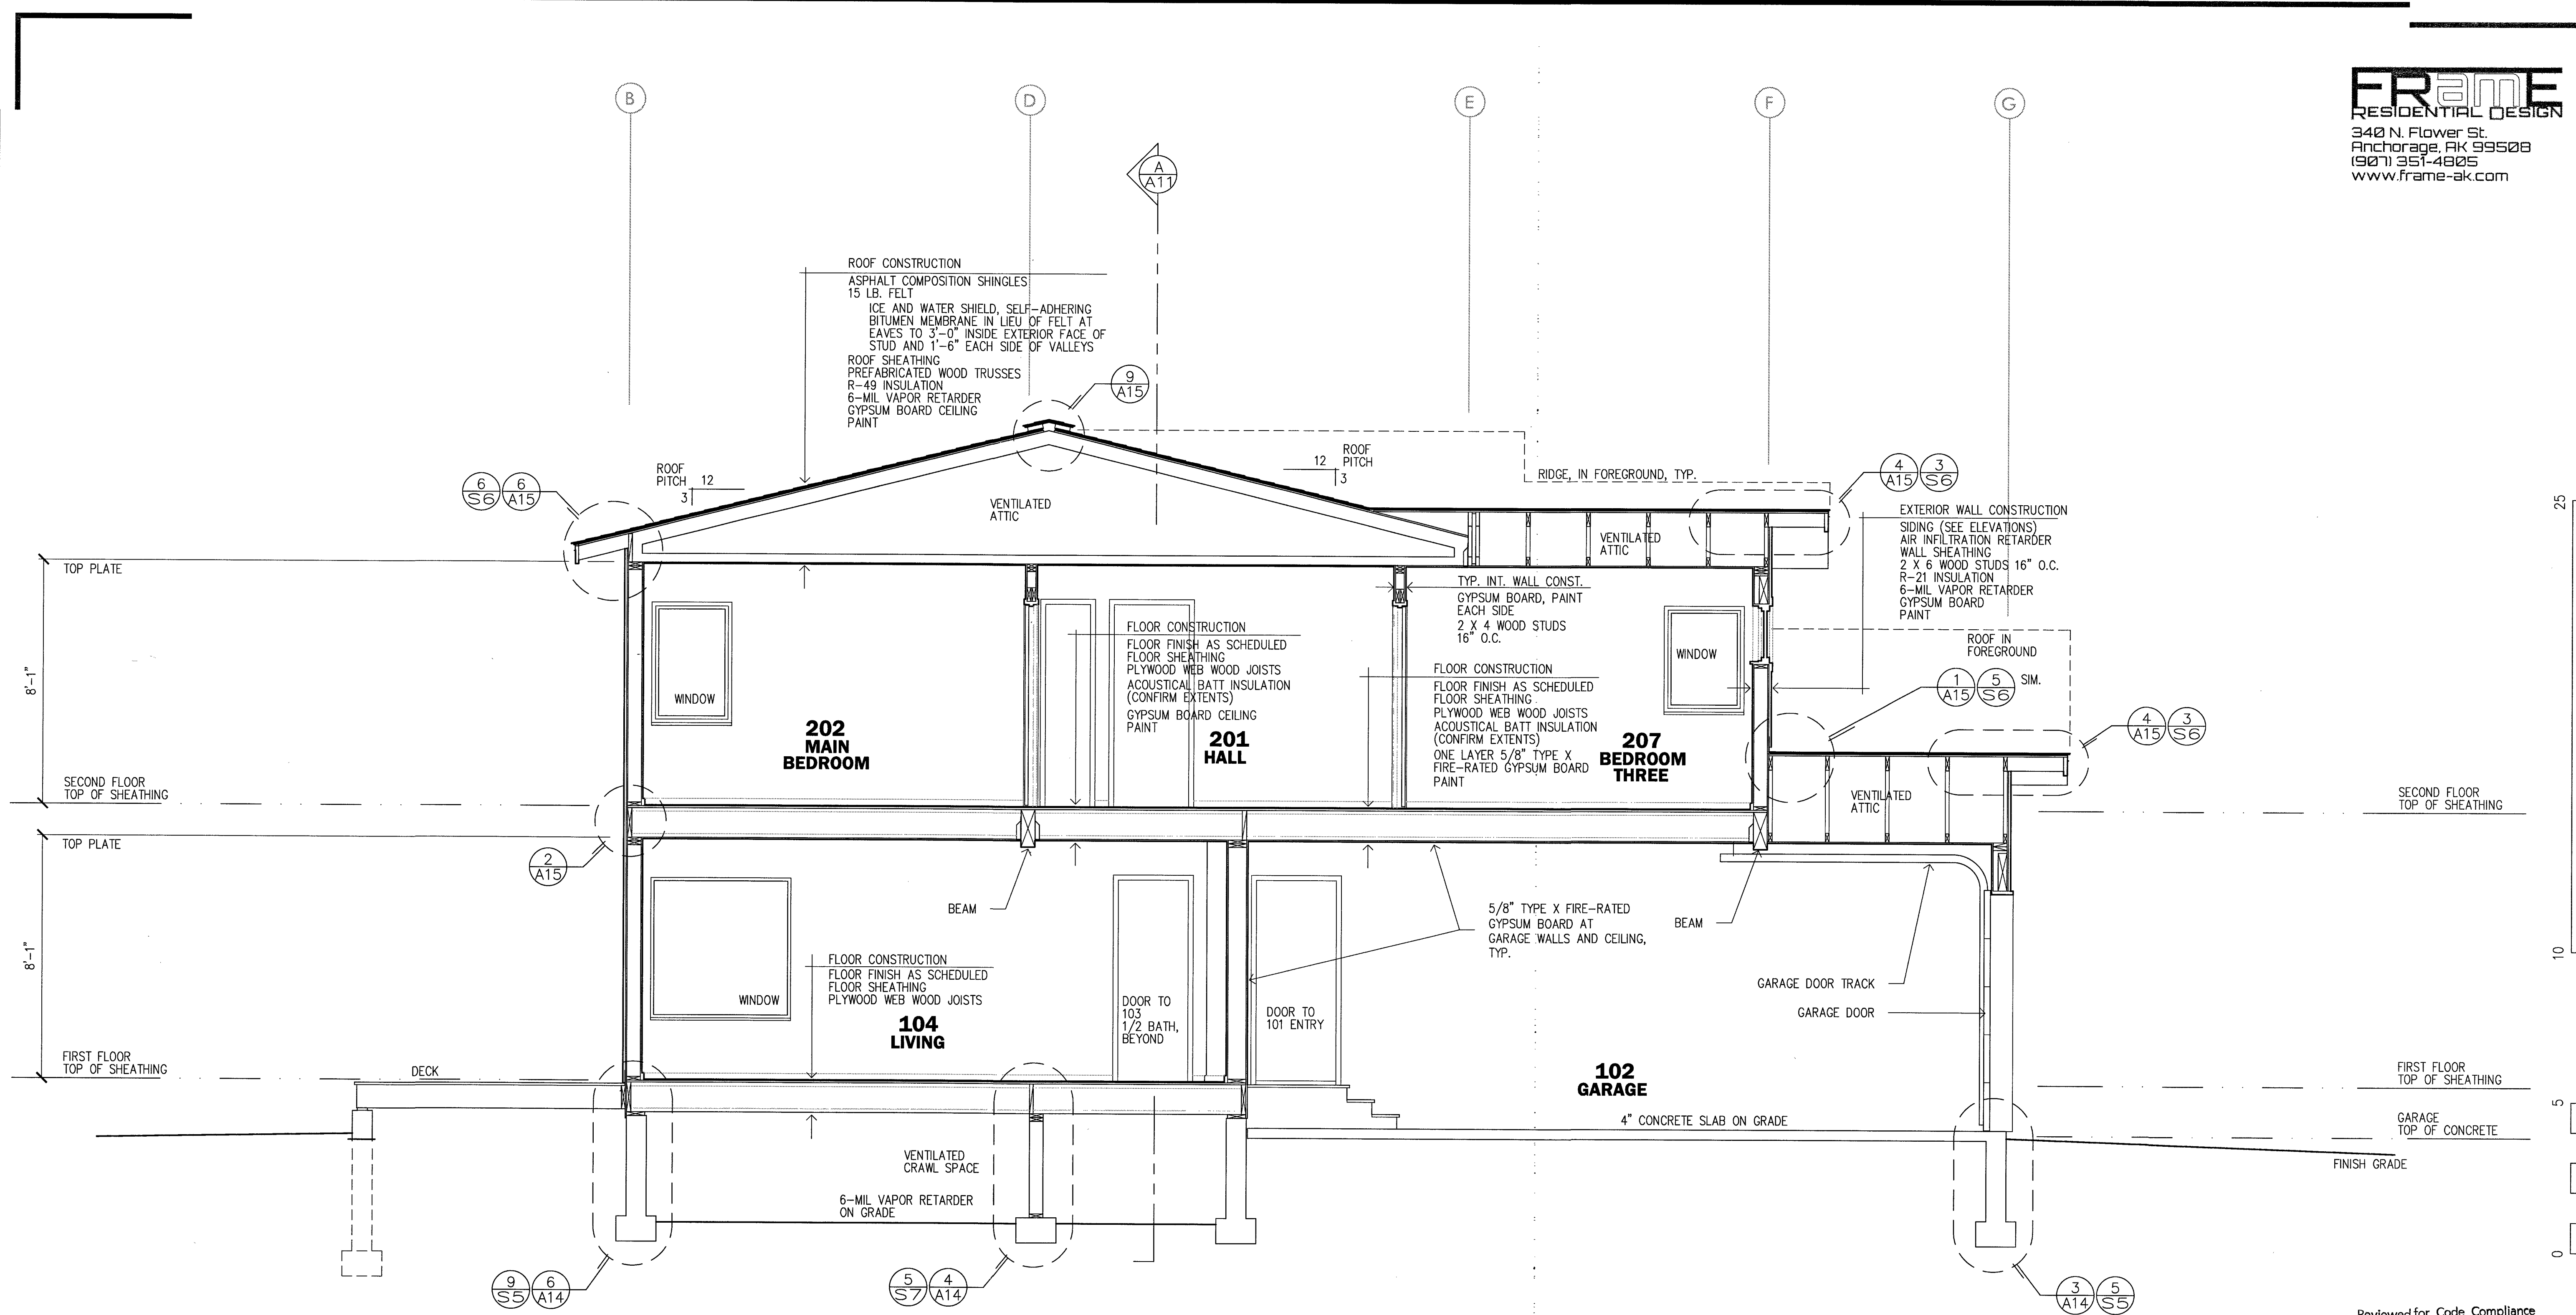

**Building Section C--C**  
UNIT B















Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety

**COOK INLET HOUSING AUTHORITY**  
WILSHIRE AVE. DUPLEX  
lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

**SUBMITTAL**

SEP 07 2022


R 22-2251

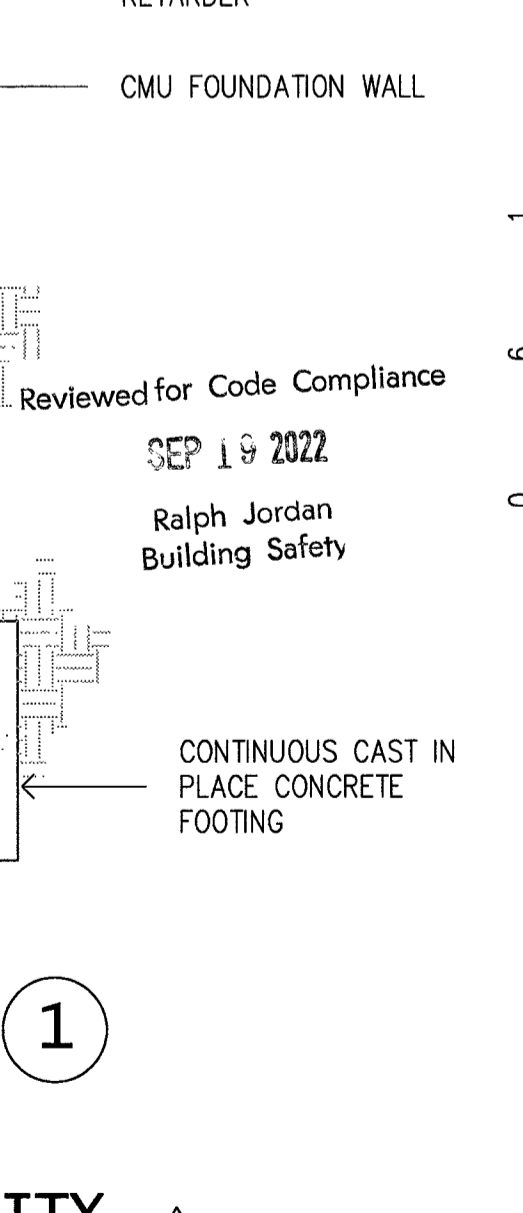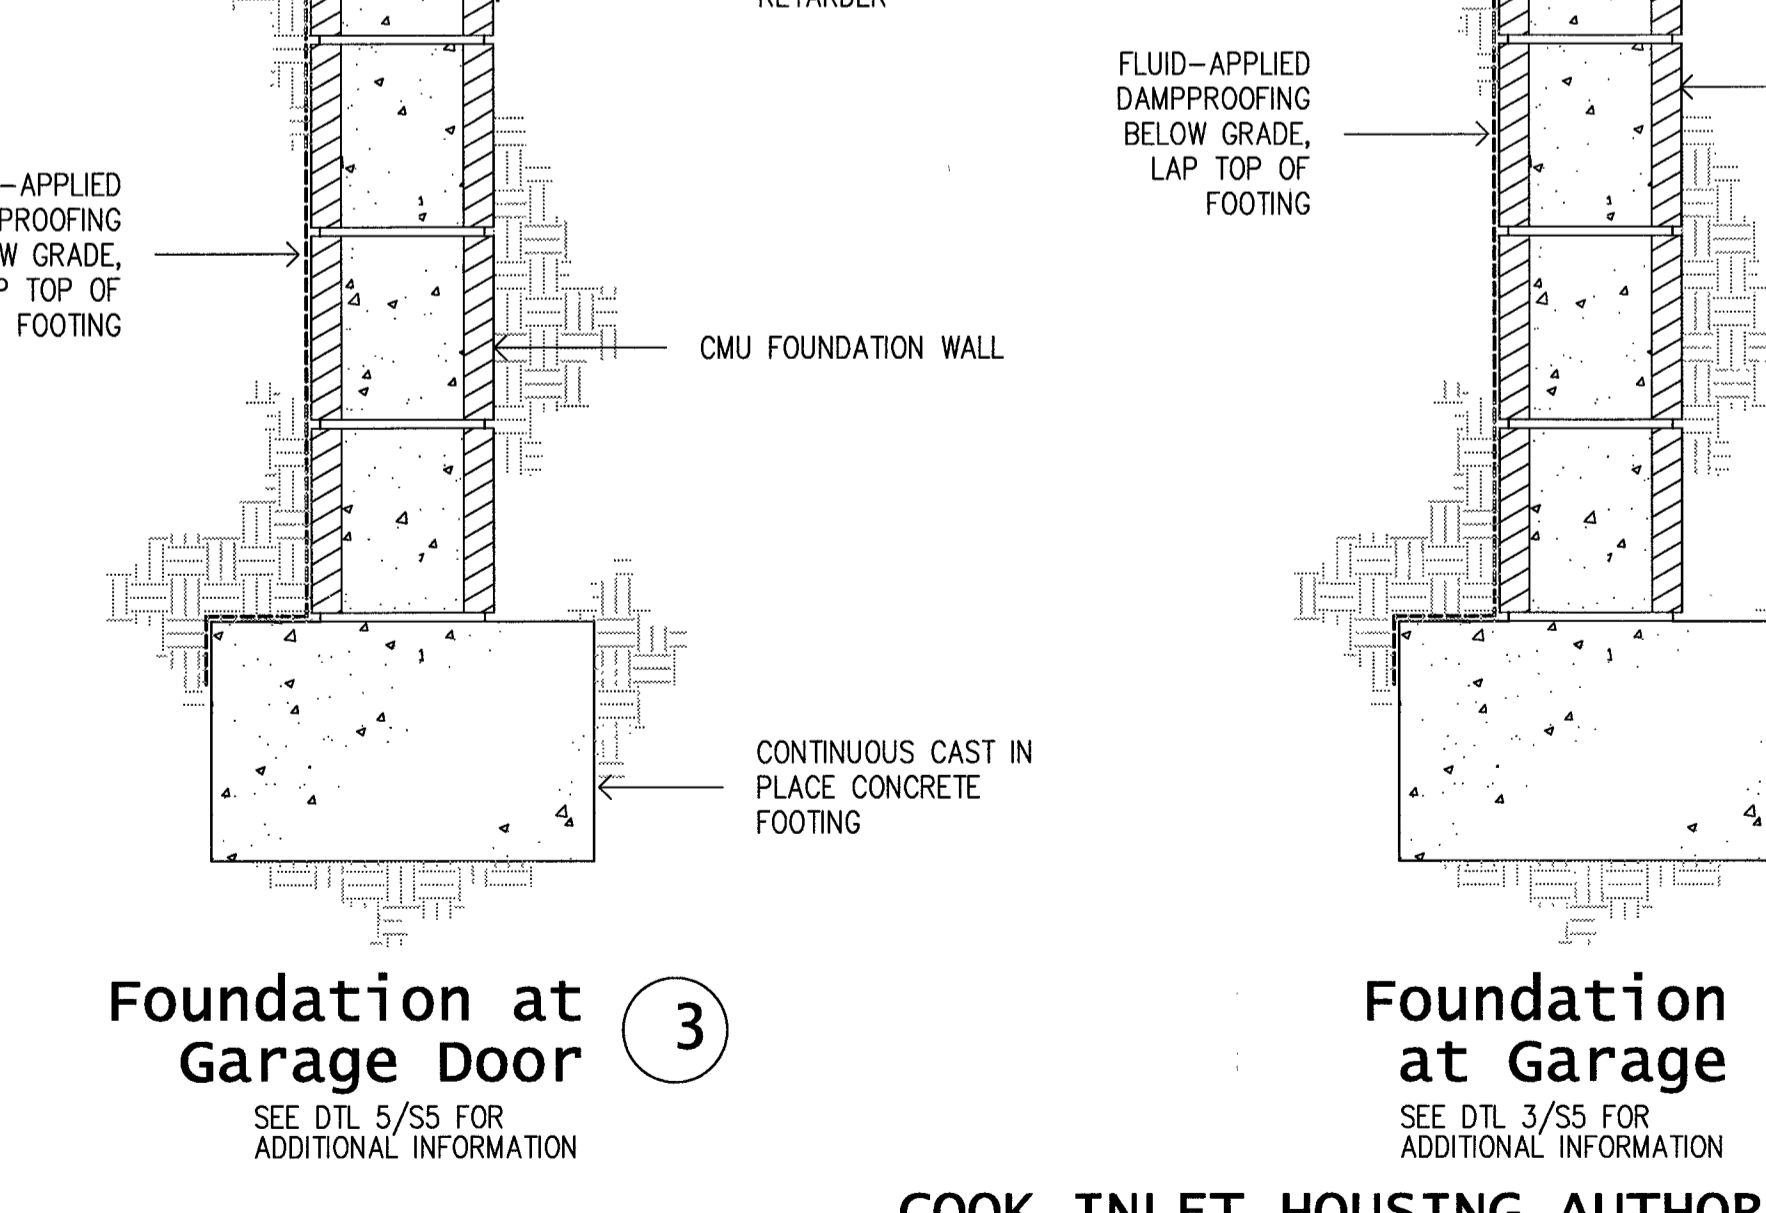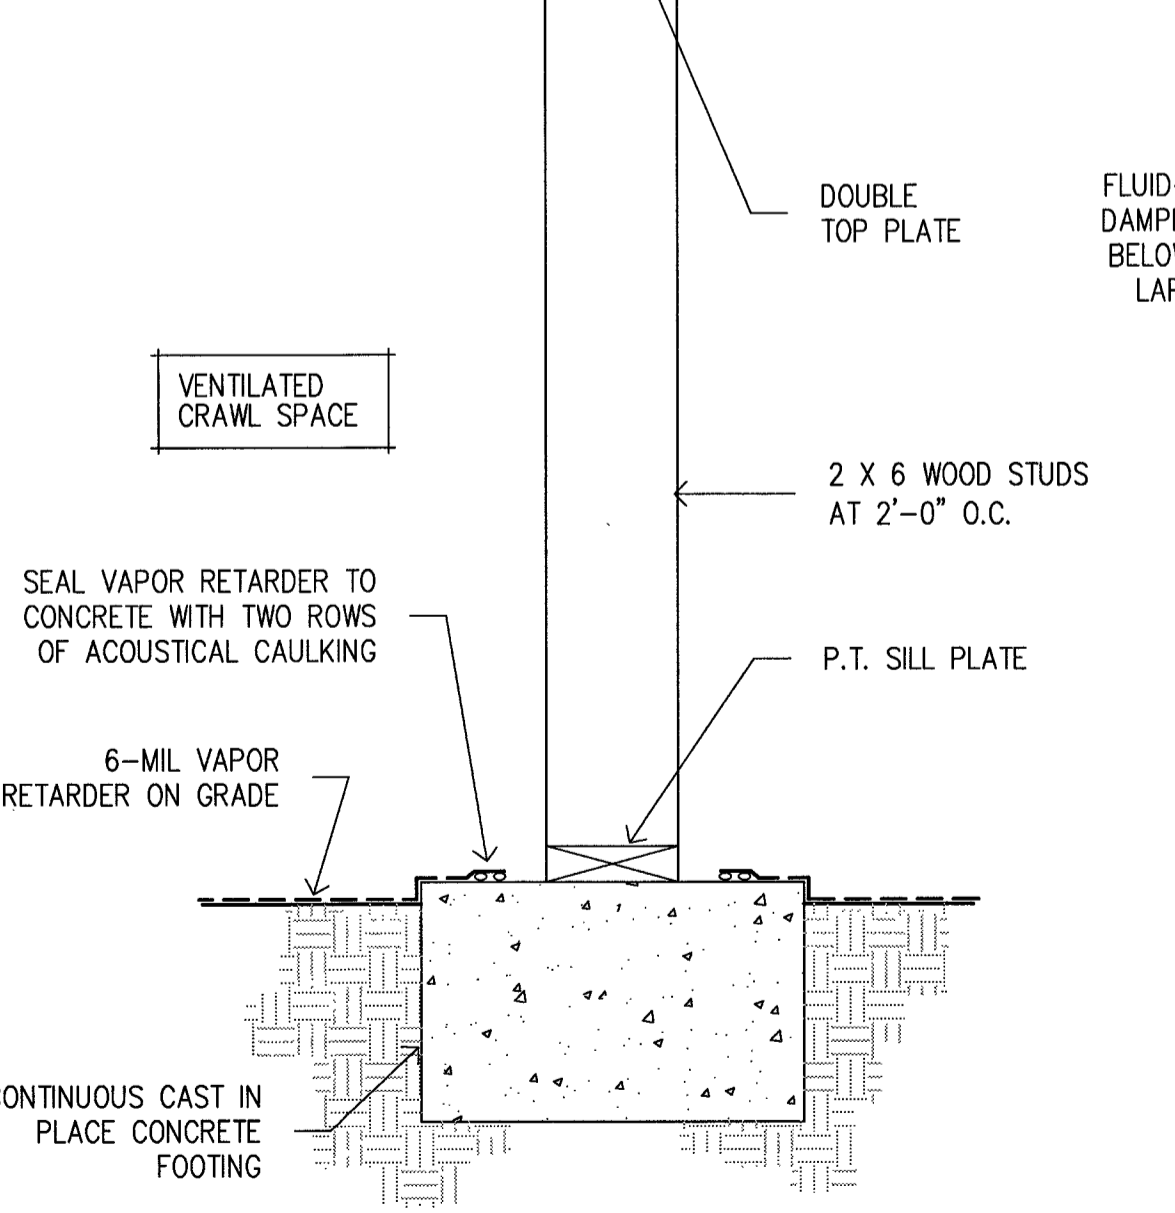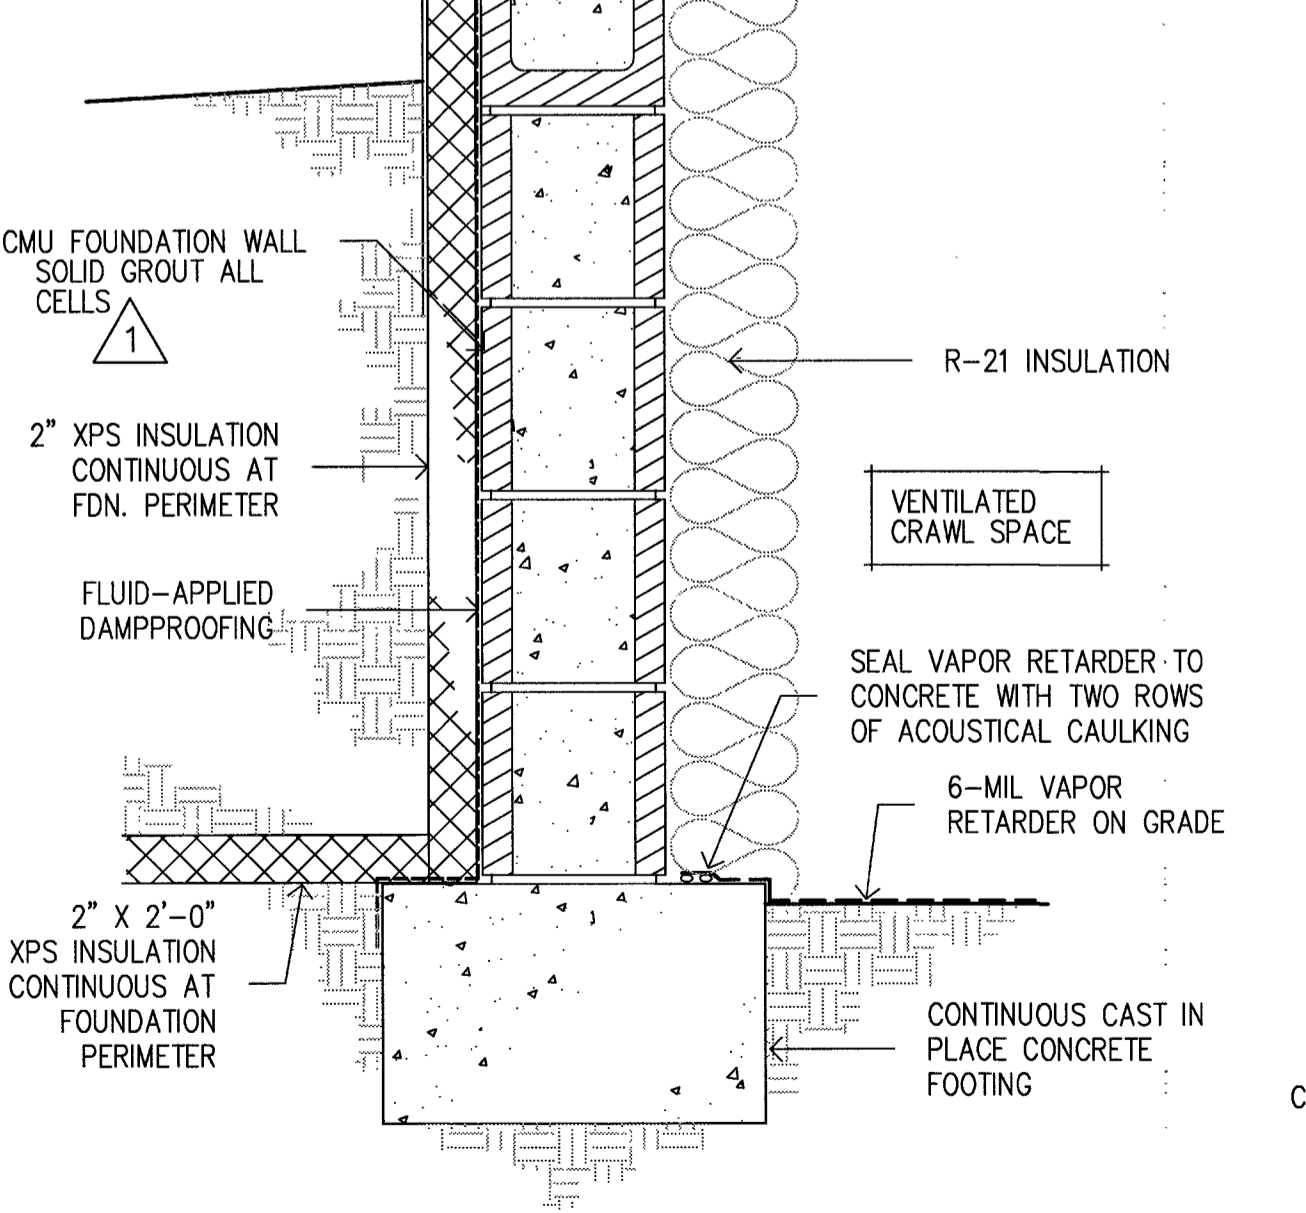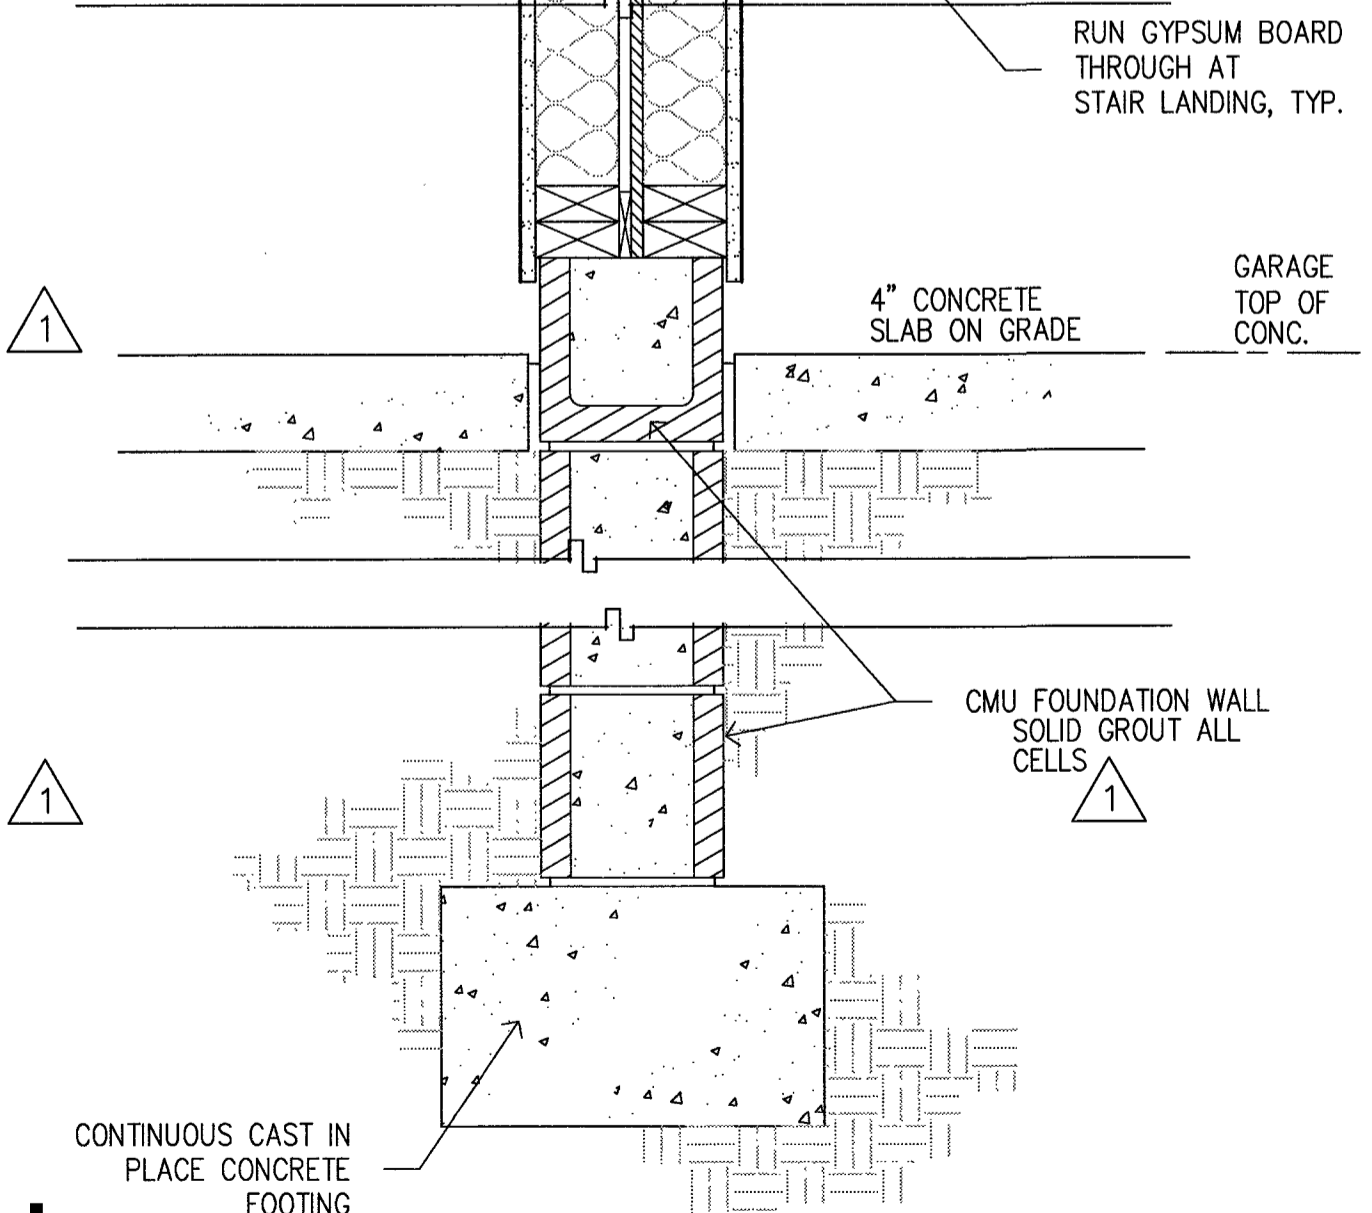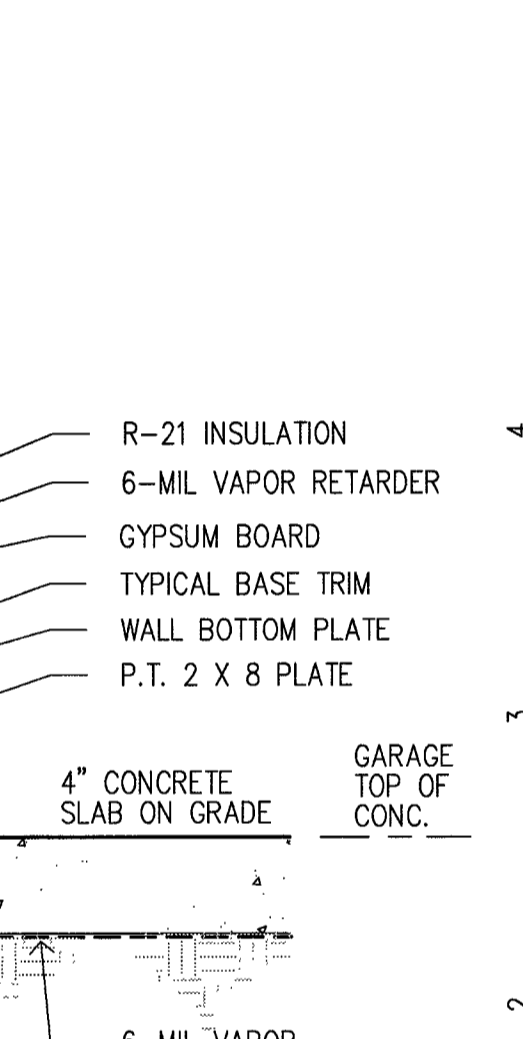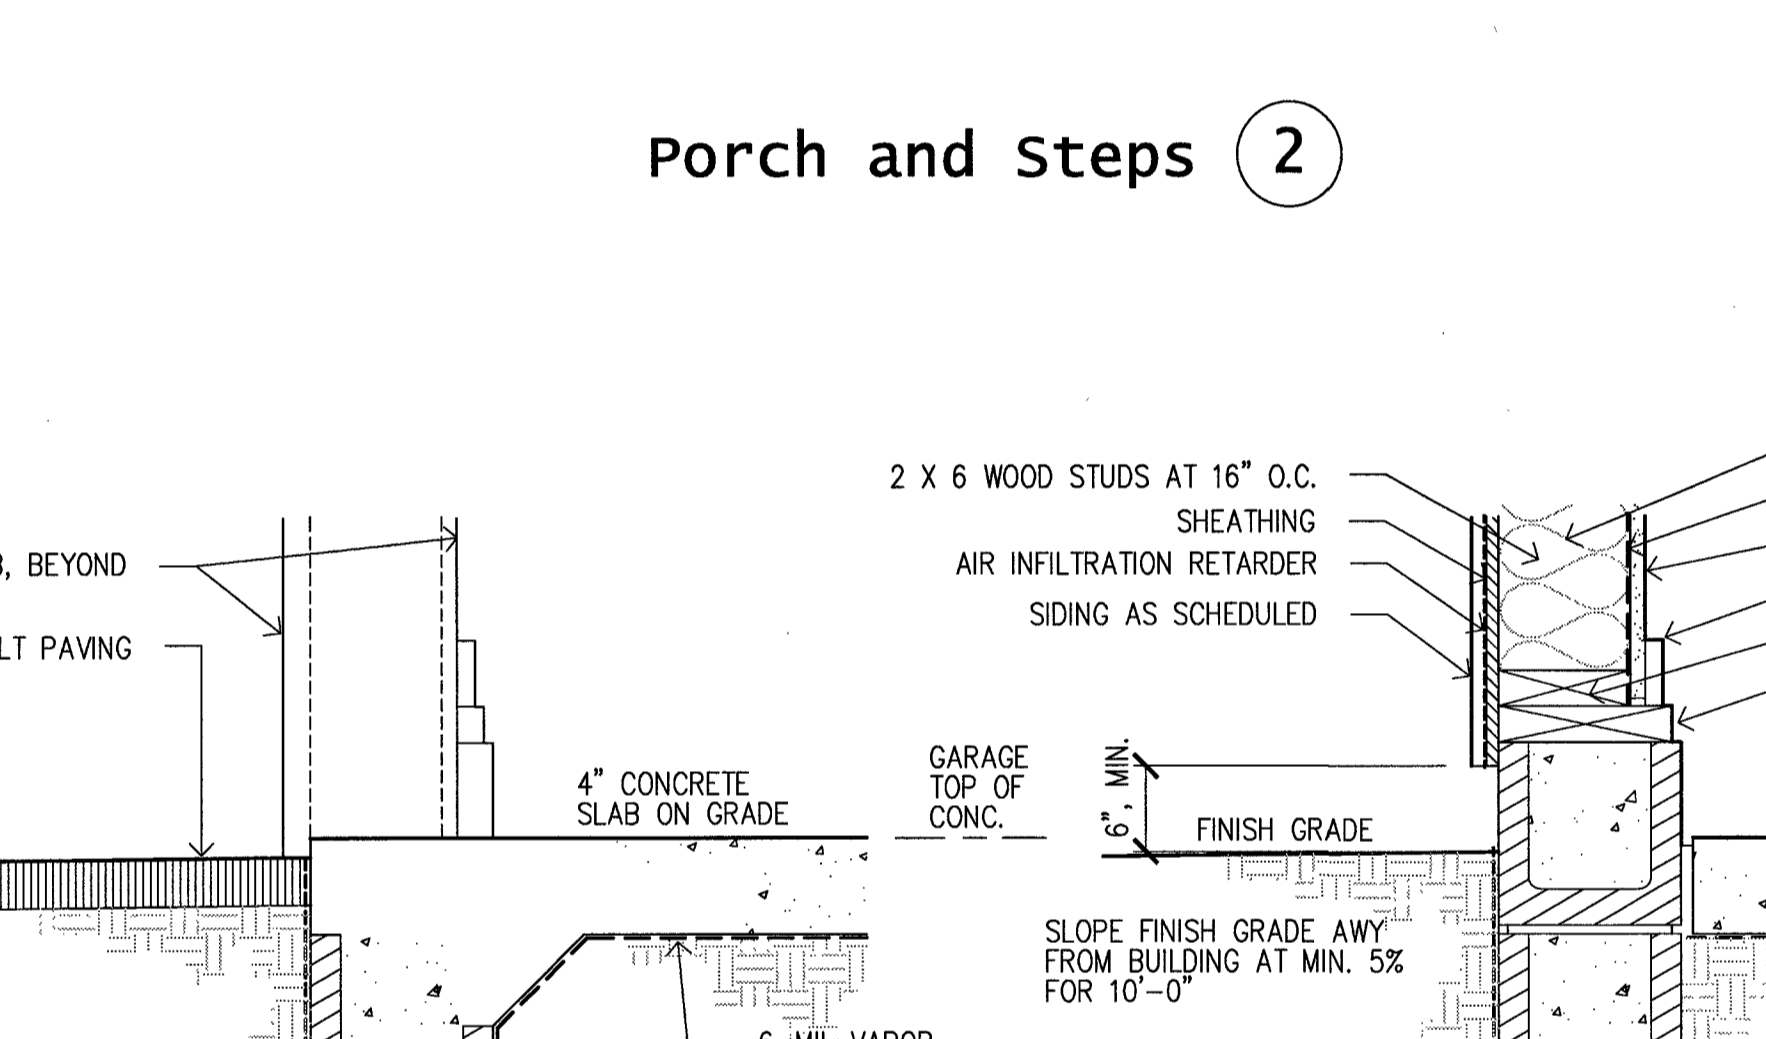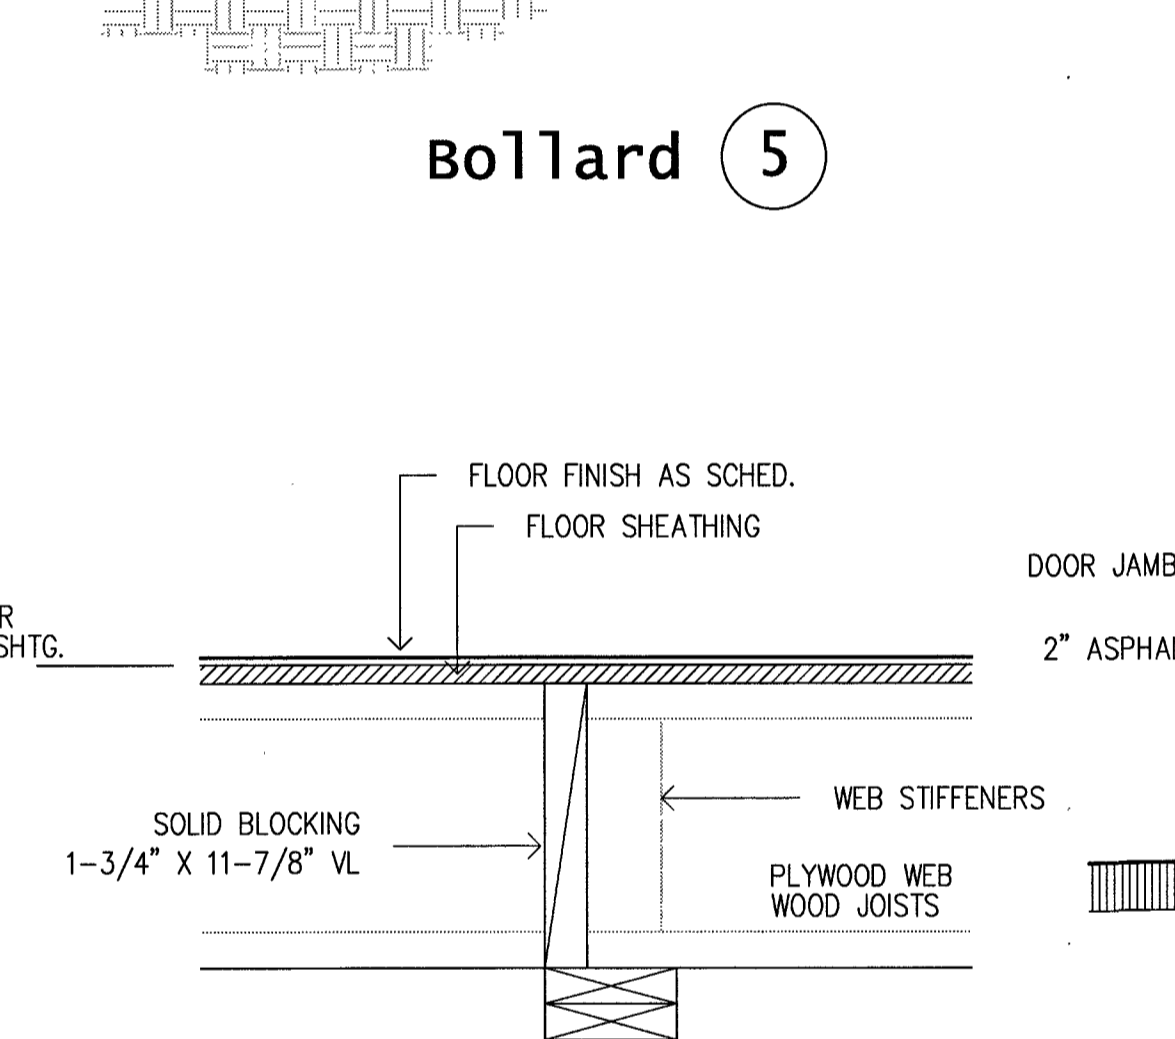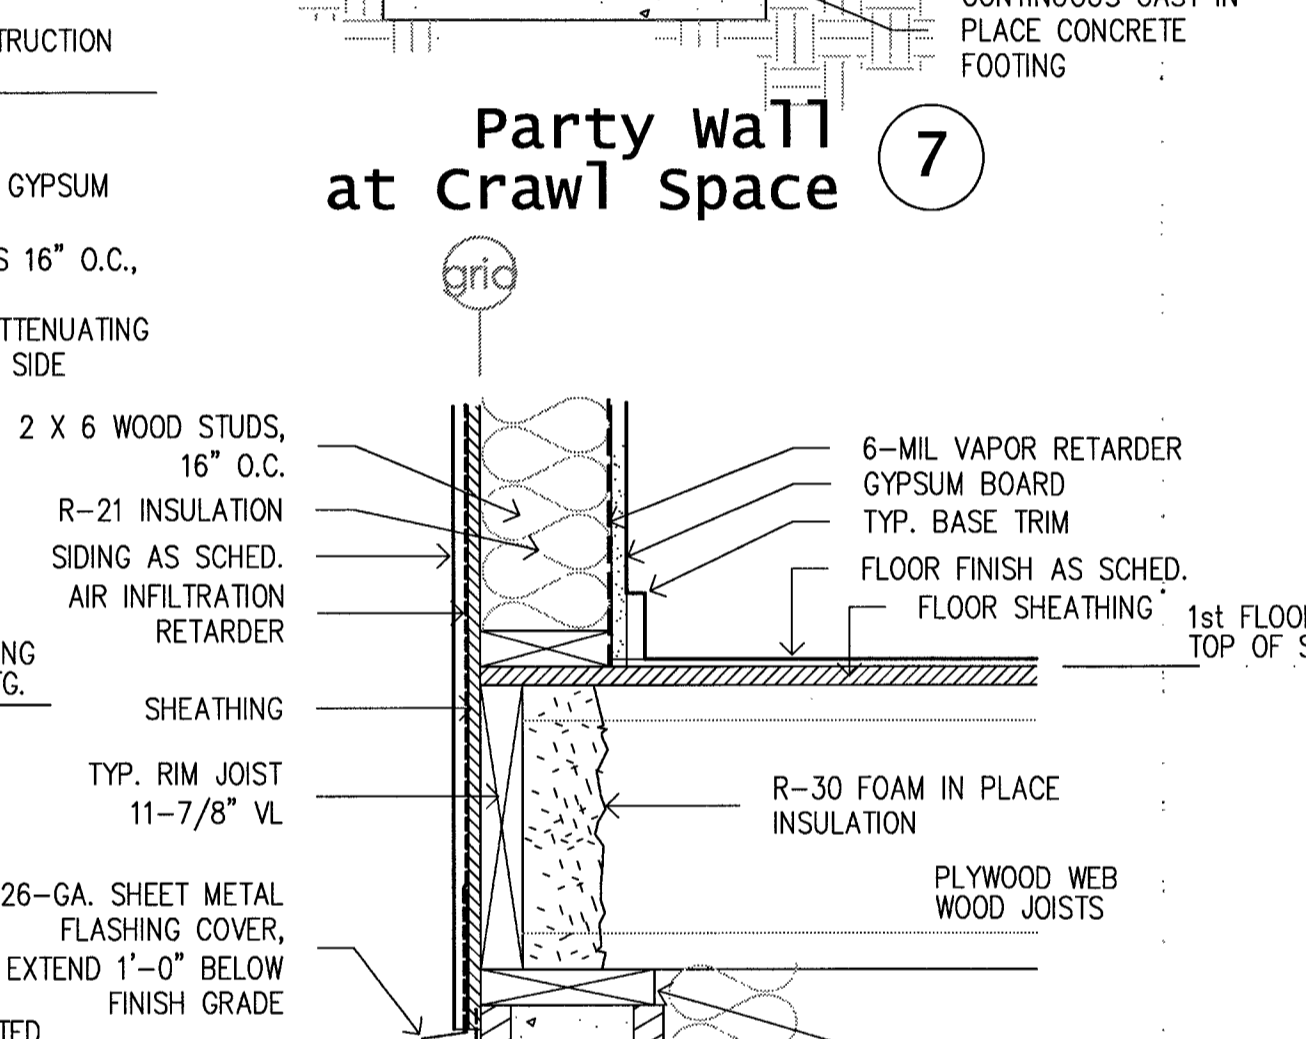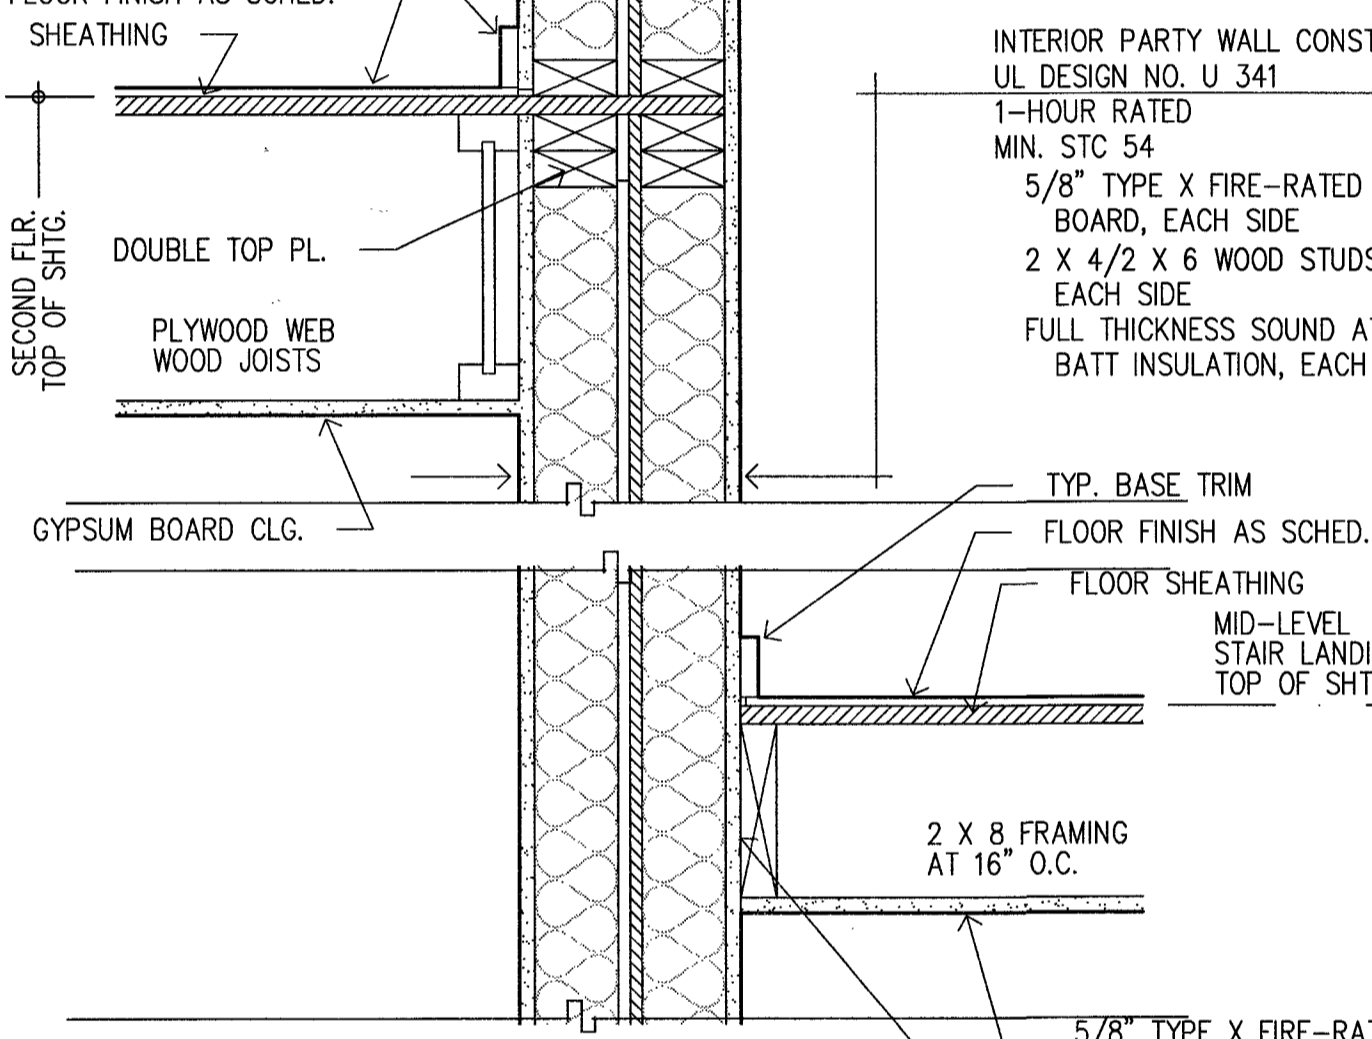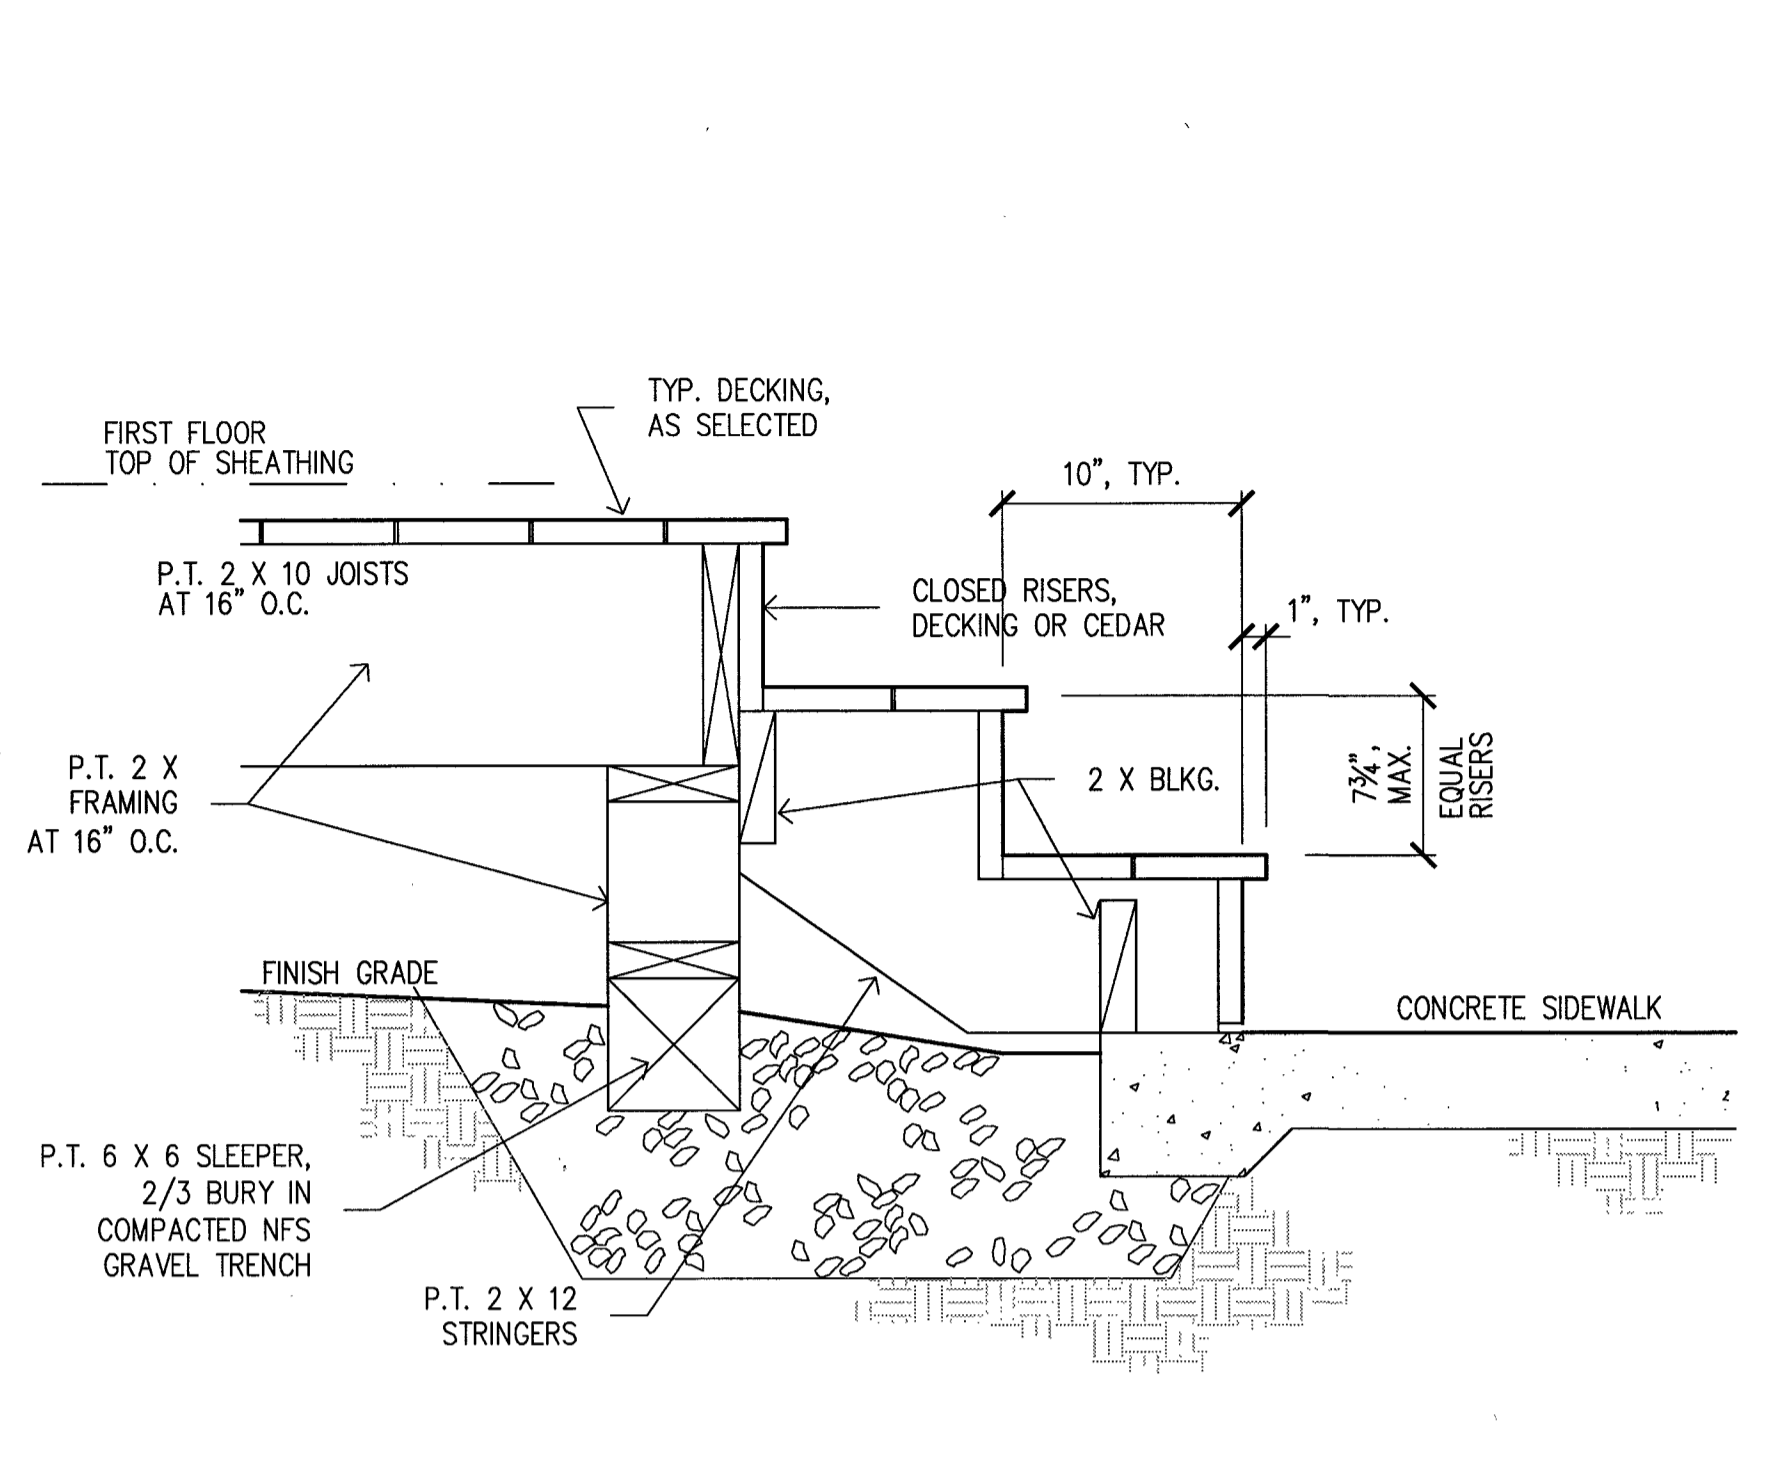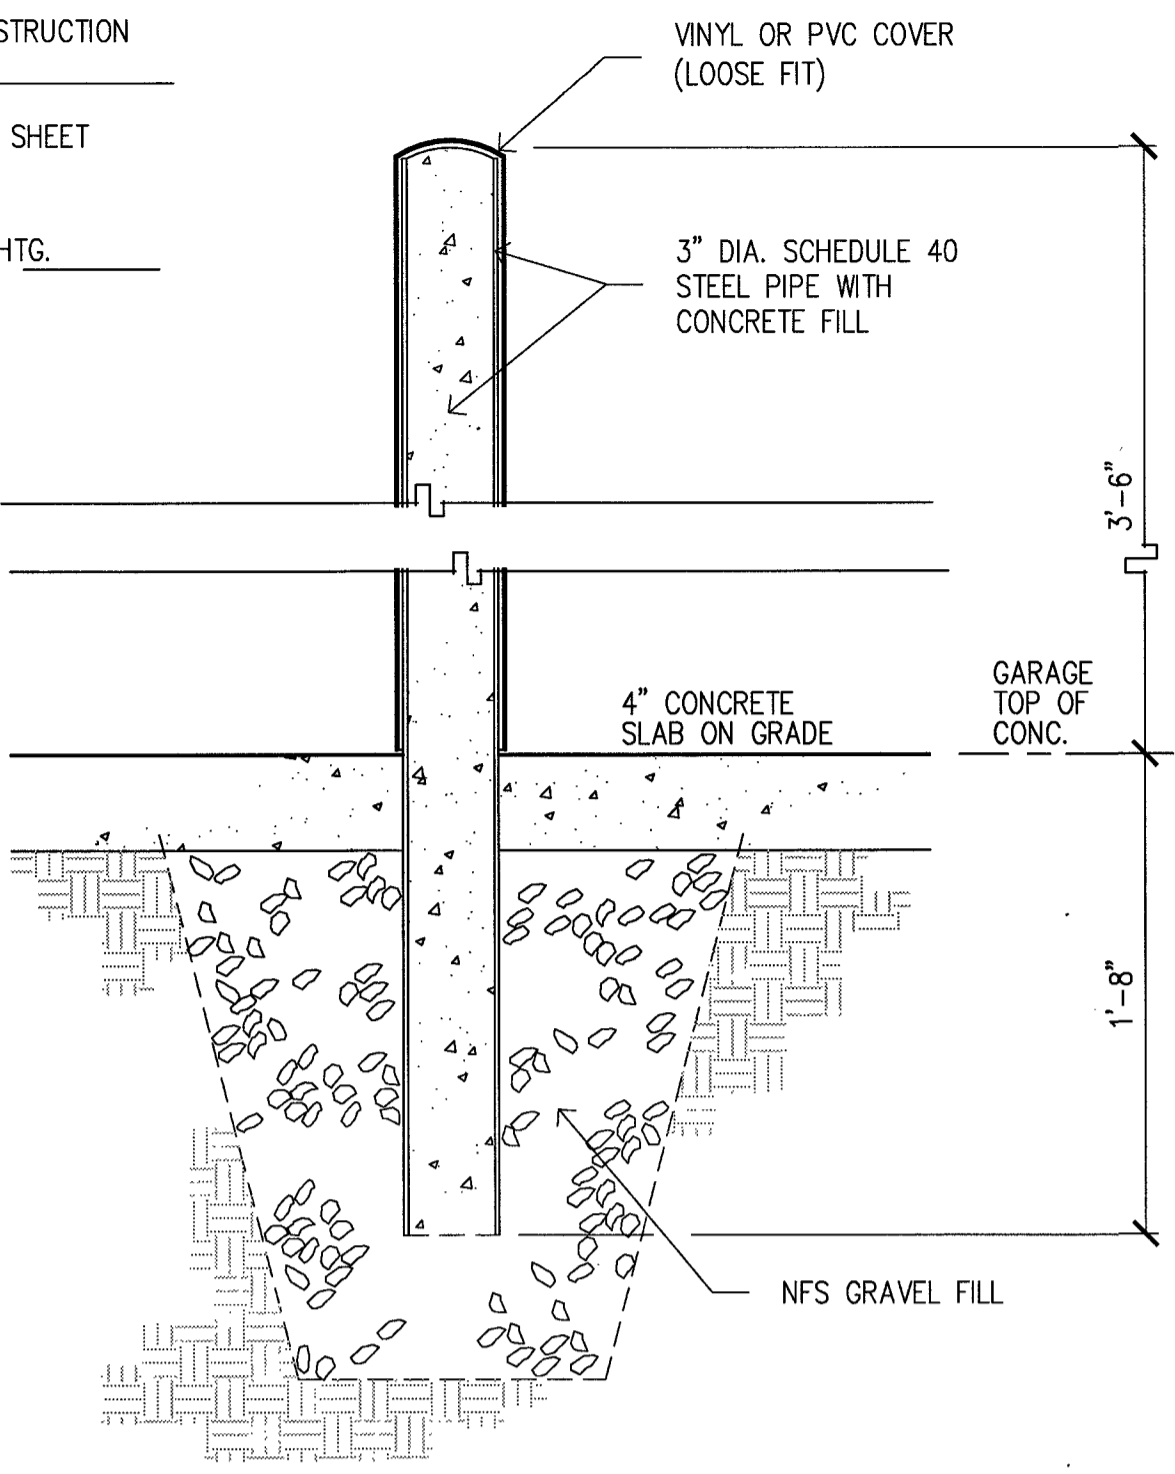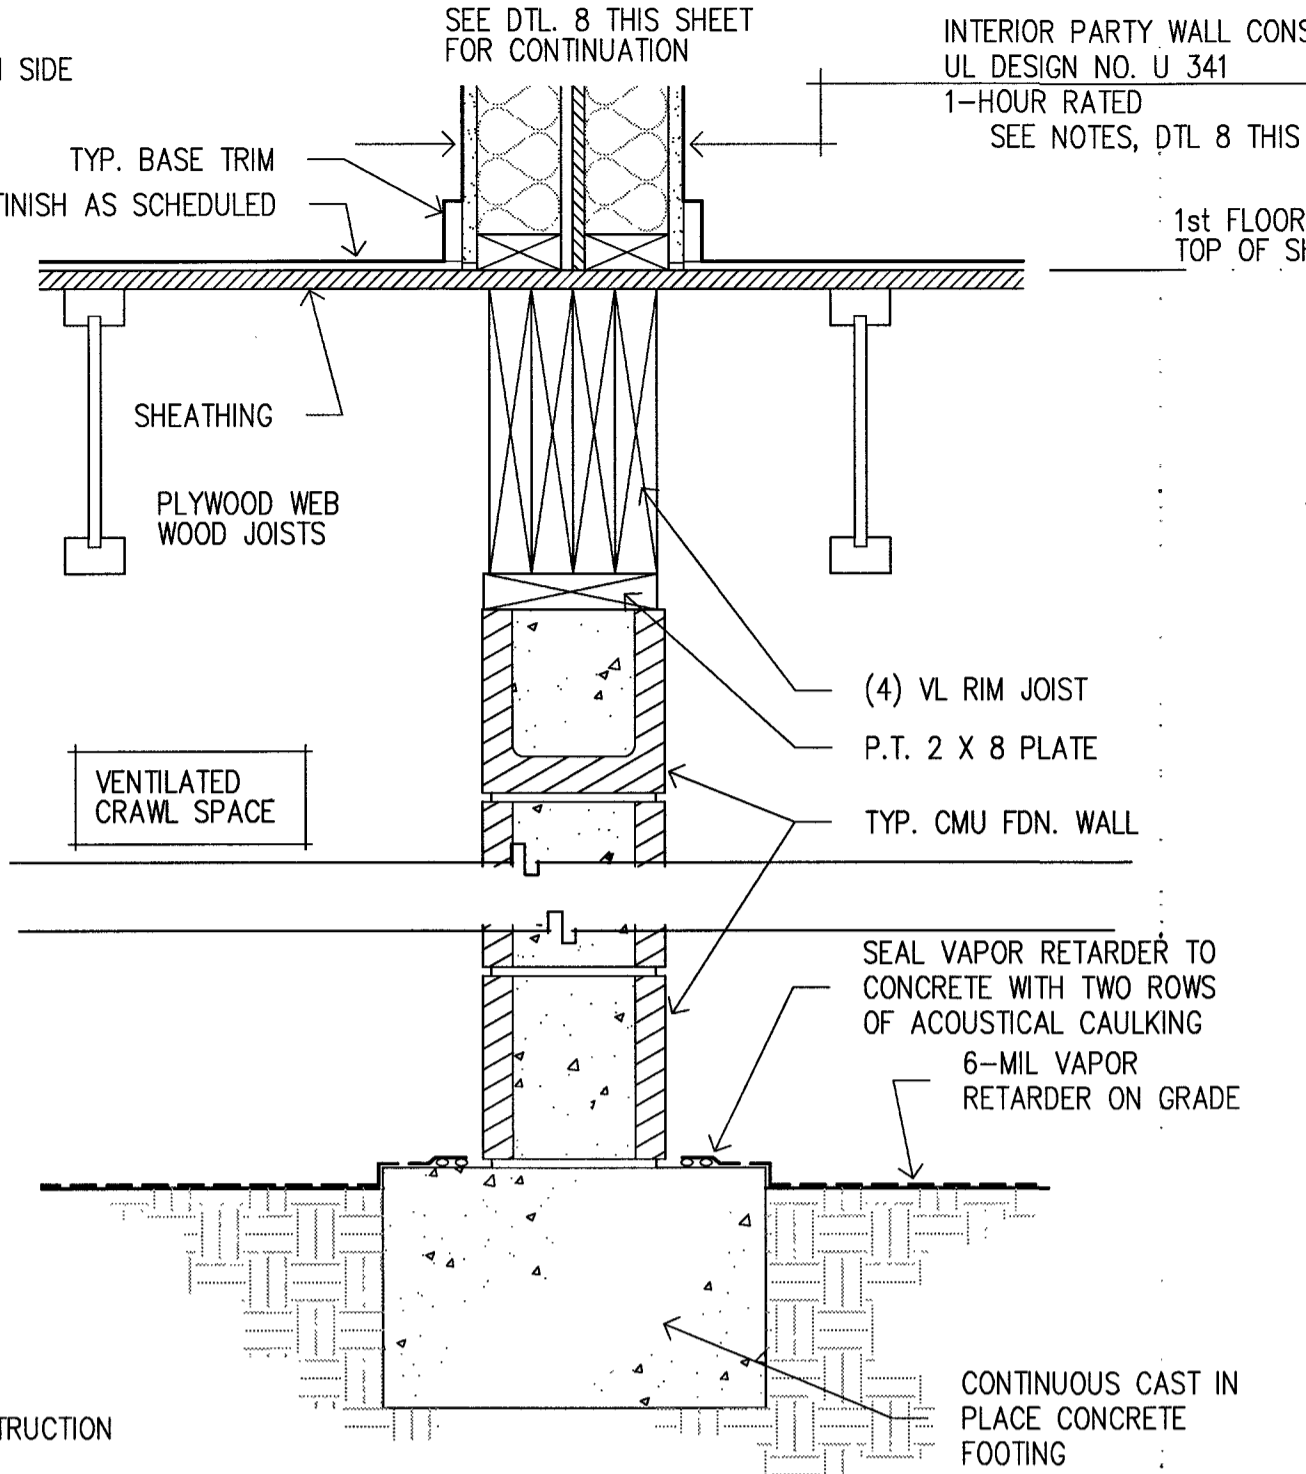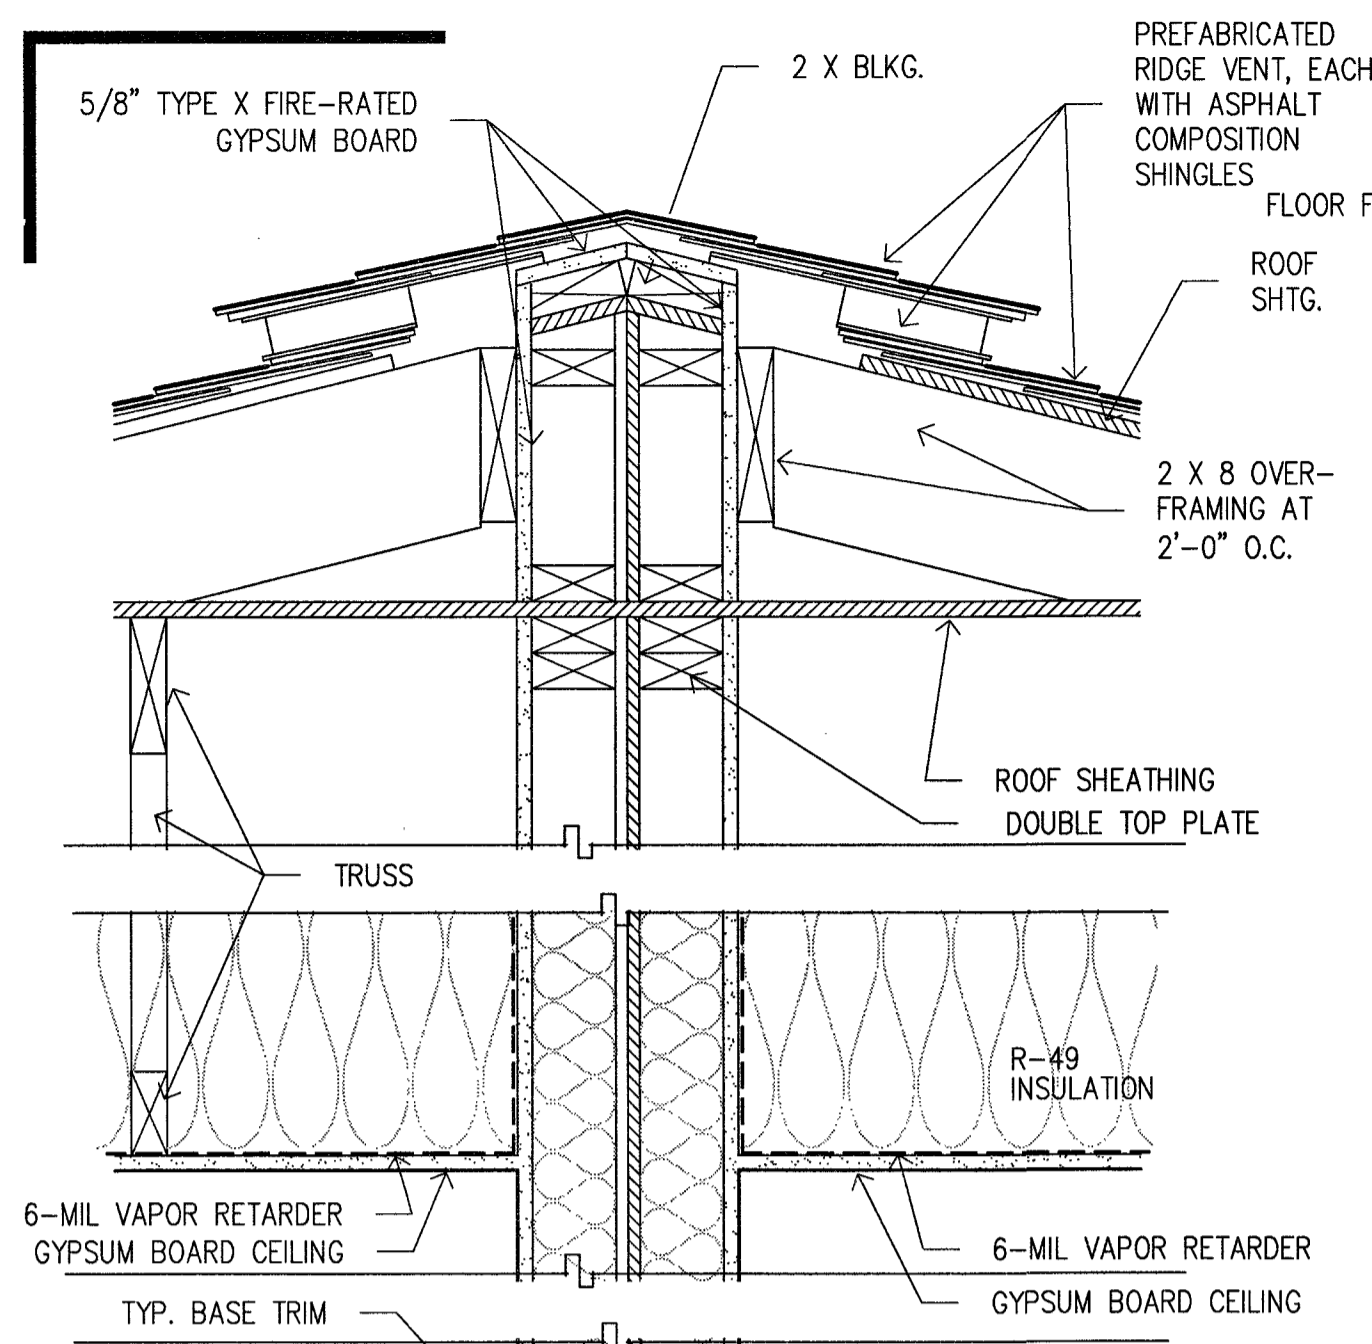


COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
lot 4, Spenard East subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

8/29/22  
DR. BY: CLARK  
DATE: 18 JUL 22


**A14**

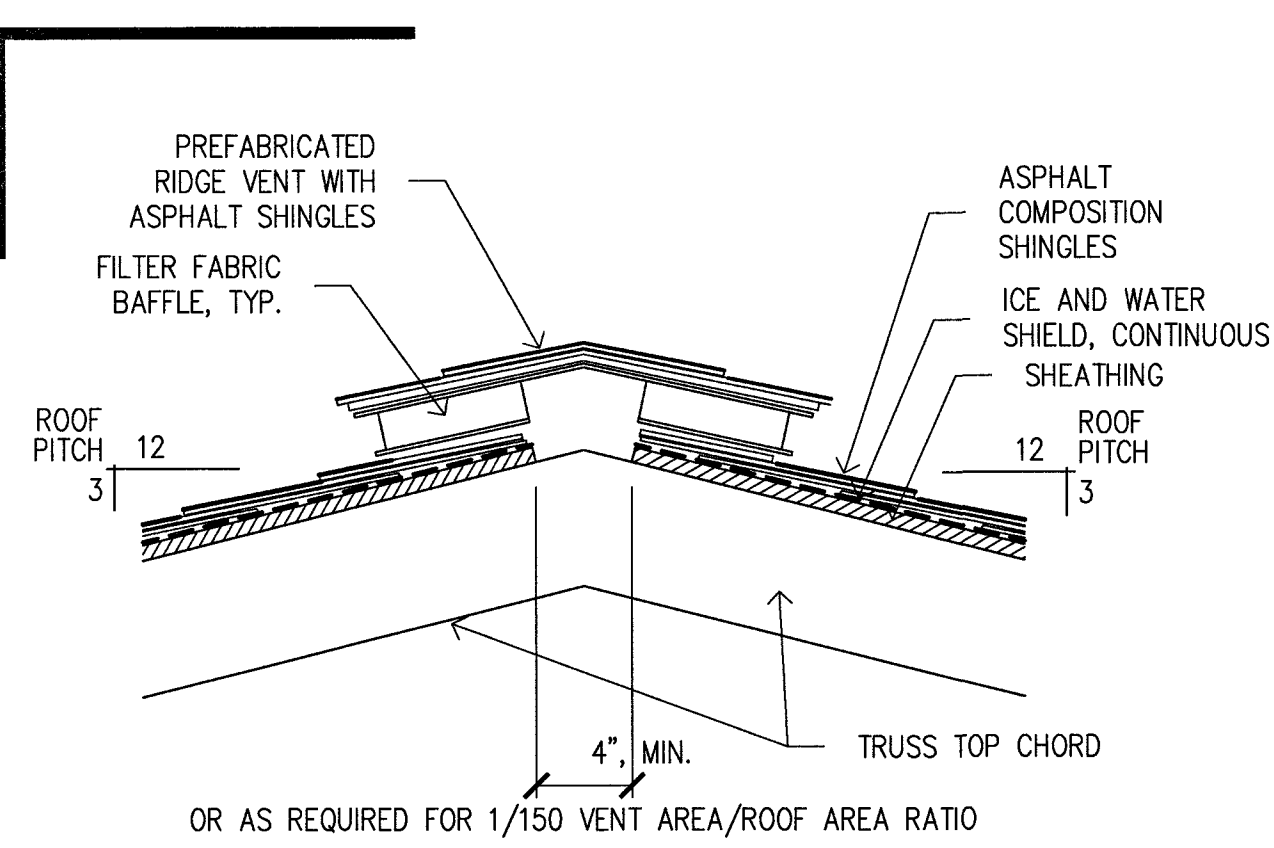


**Ridge vent 9**

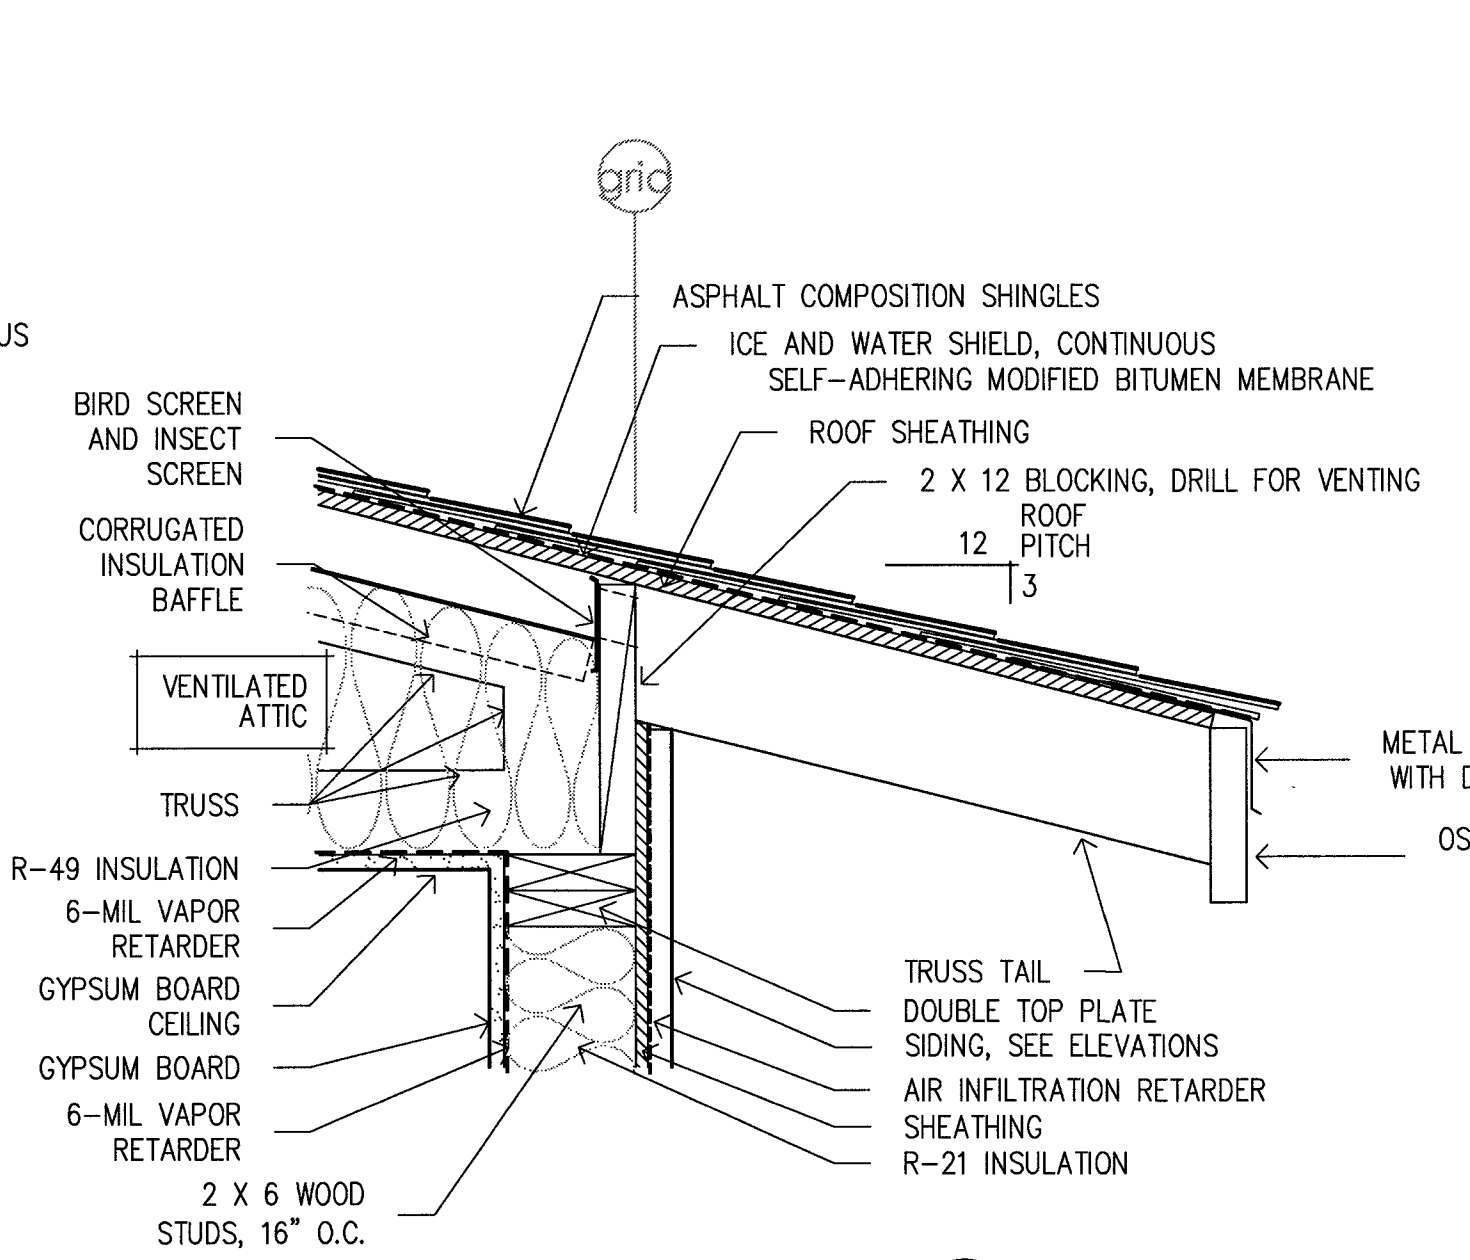


**Typical Eave 6**  
SEE DTL 6/S6 FOR  
ADDITIONAL INFORMATION

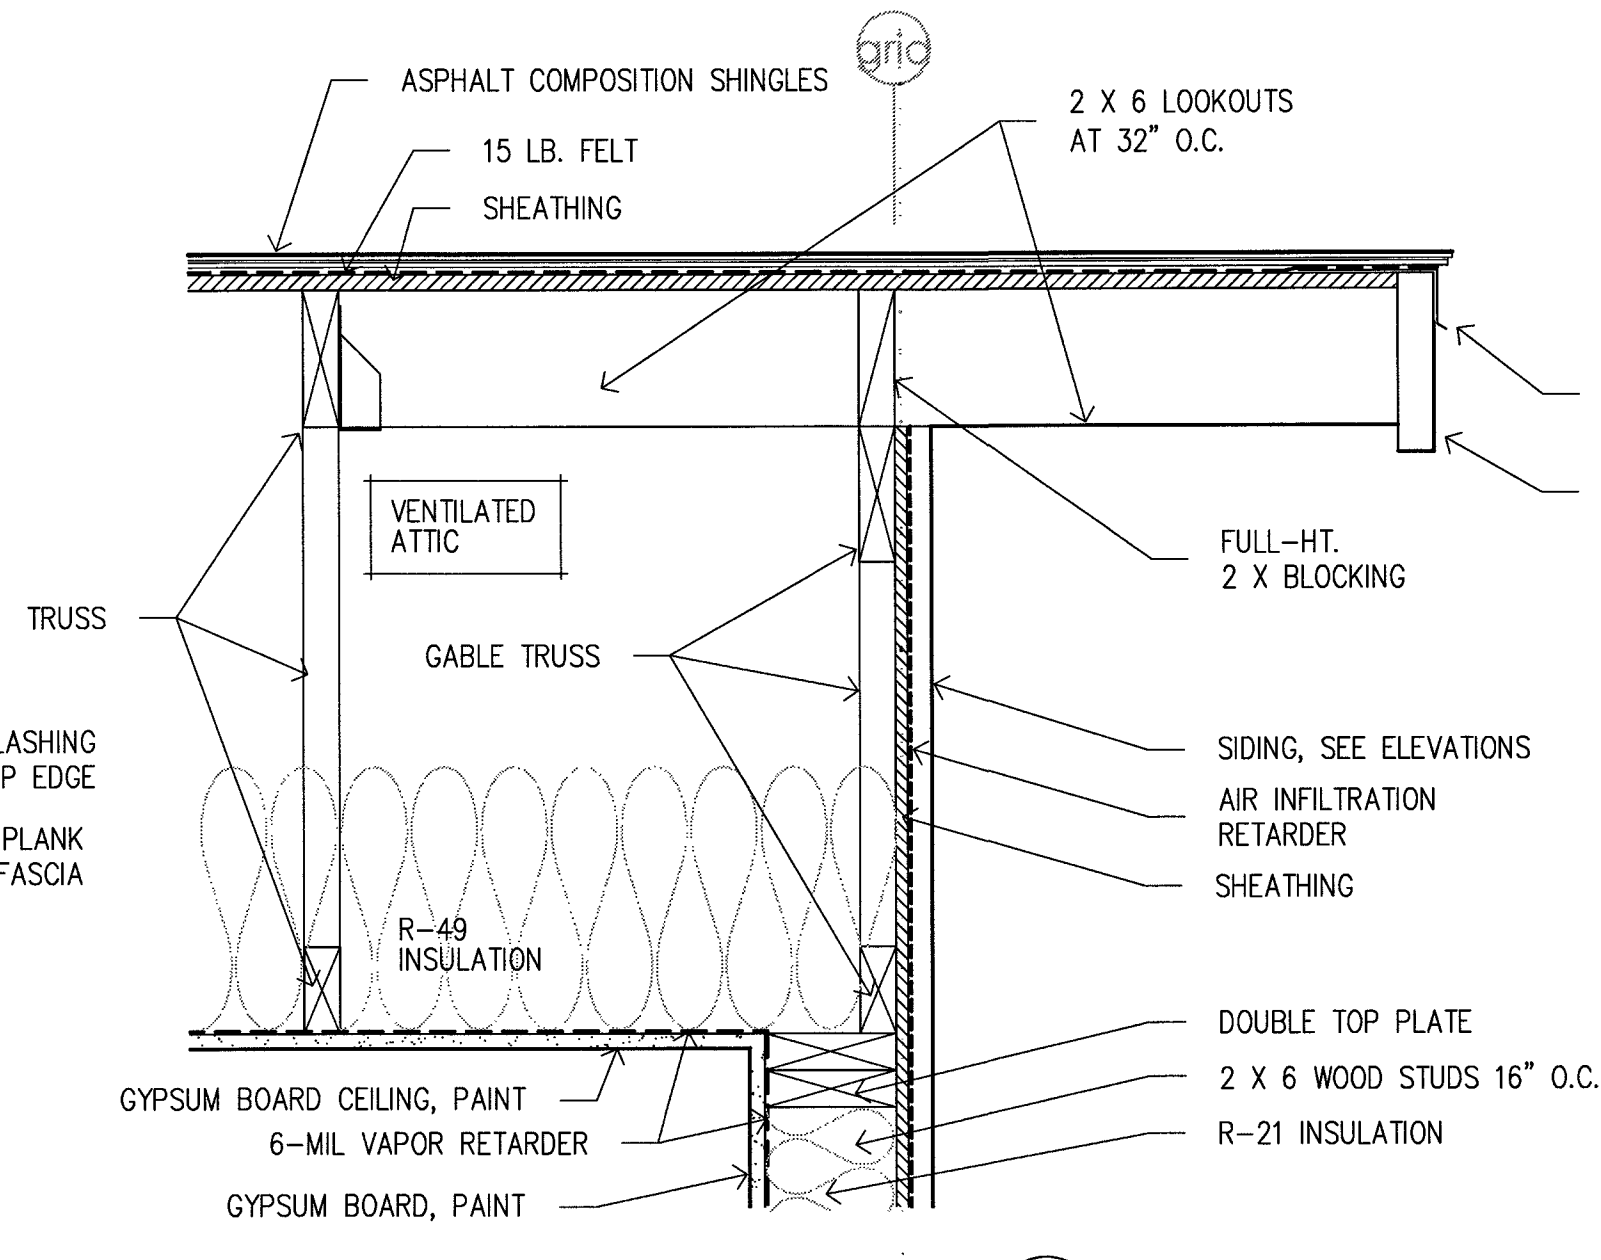


**Typical Rake 4**  
SEE DTL 3/S6 FOR  
ADDITIONAL INFORMATION

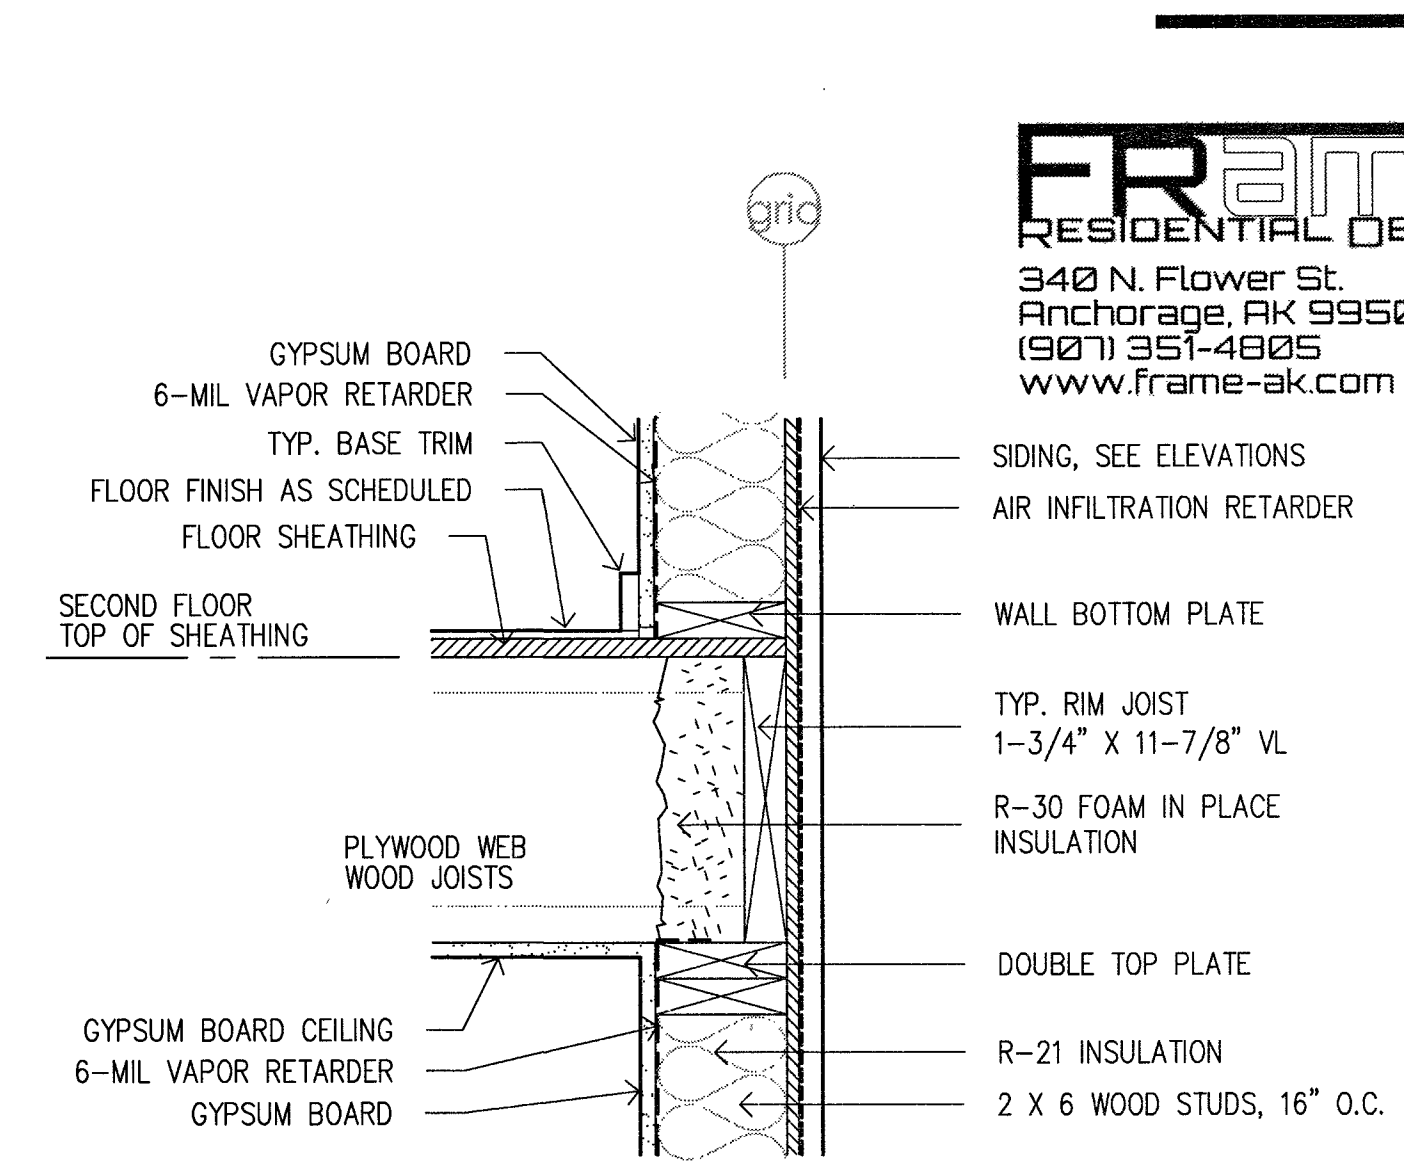



**Rim Joist 2**

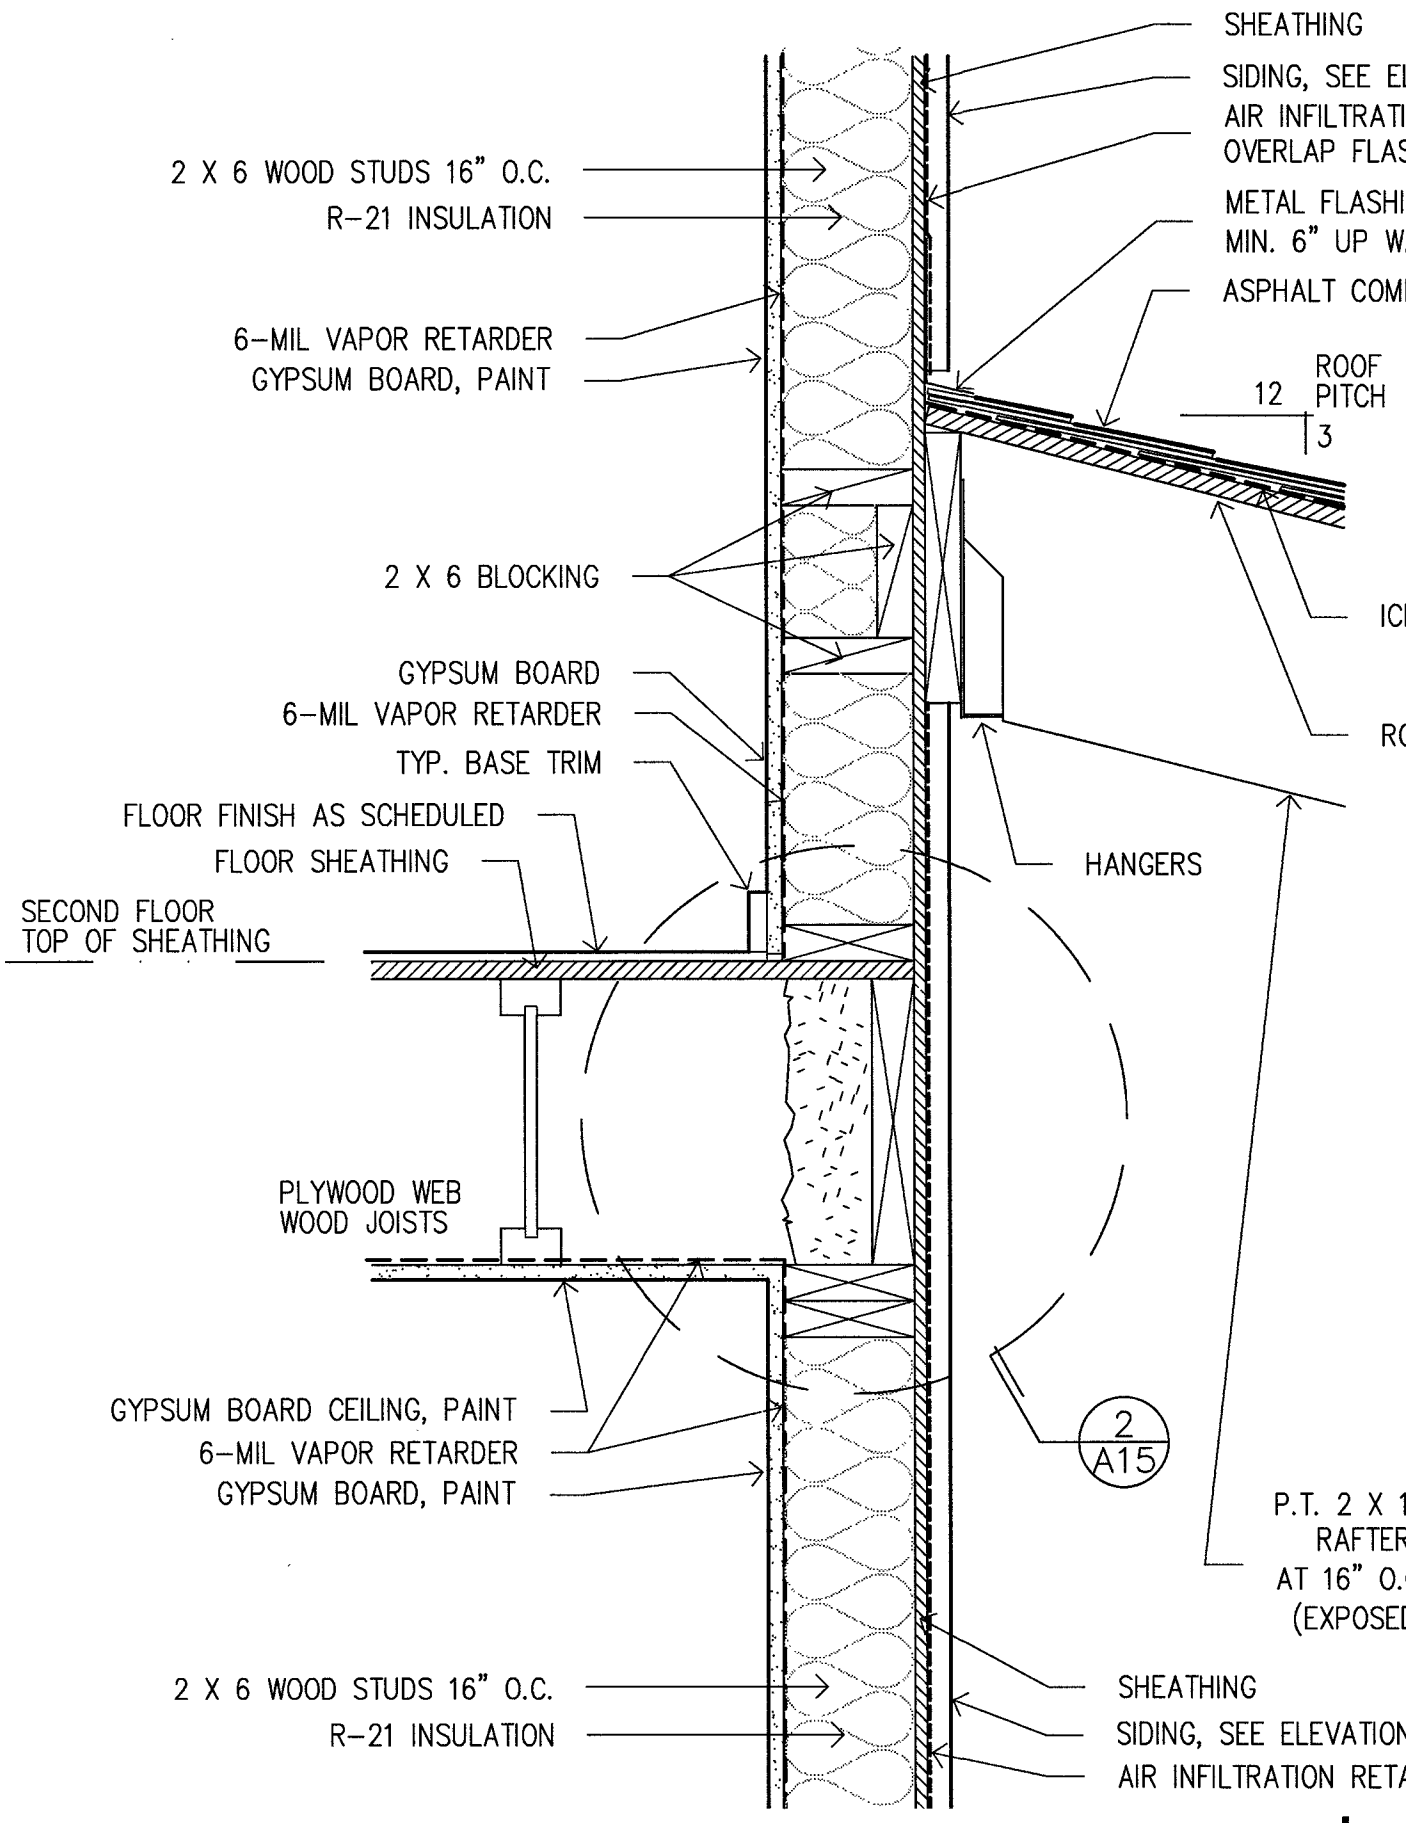

**Porch Roof Eave/Headwall 8**  
UNIT B, SHOWN  
UNIT A, SIMILAR/OPPOSITE HAND  
SEE DTL 1/S6 FOR  
ADDITIONAL INFORMATION

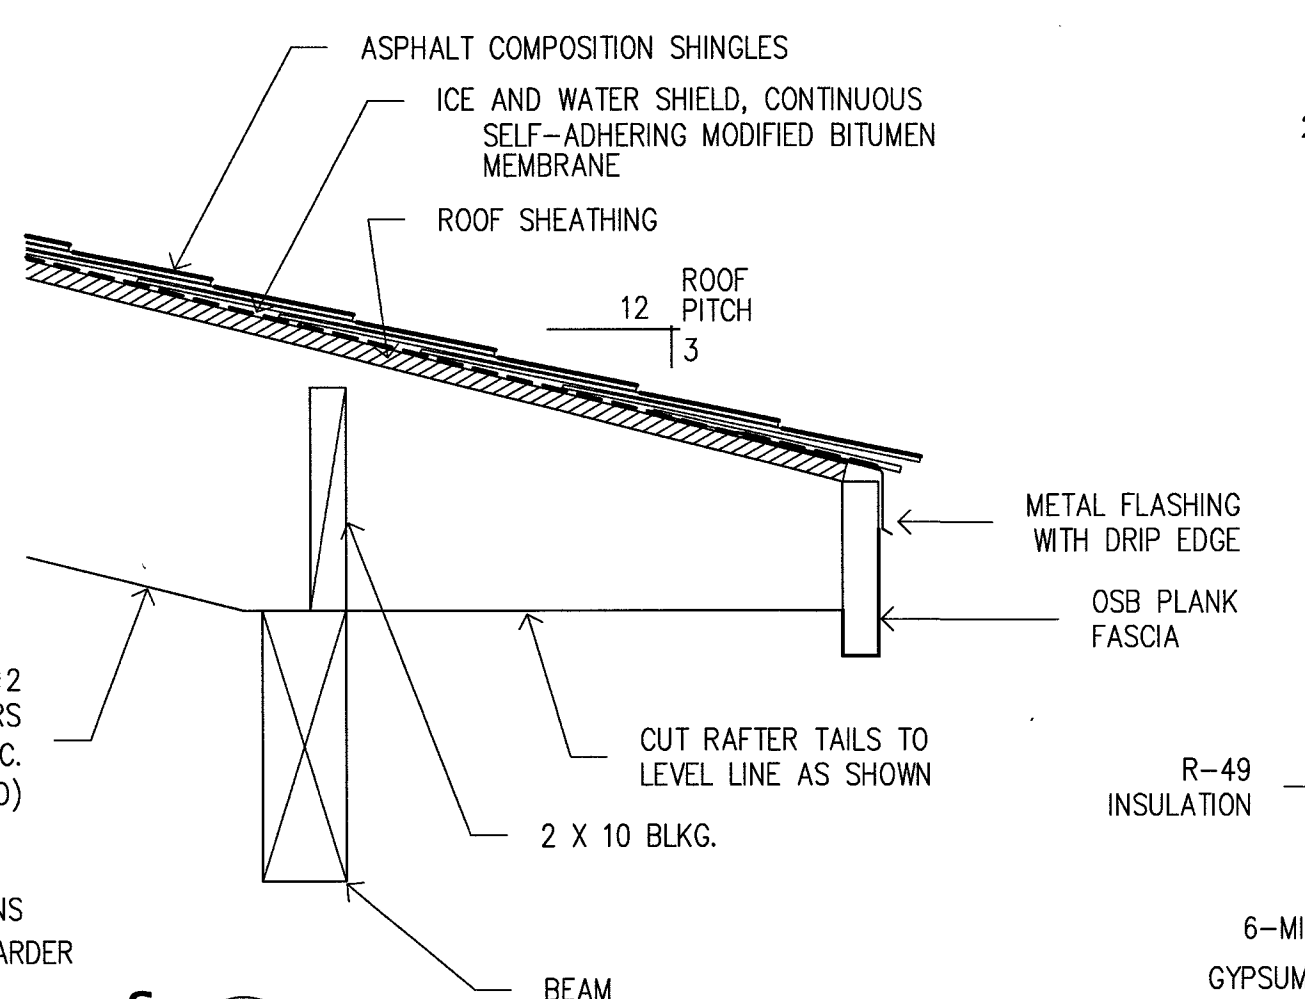














**Headwall 3**  
SEE DTL 4/S6 AND 6/A15  
FOR ADDITIONAL INFORMATION

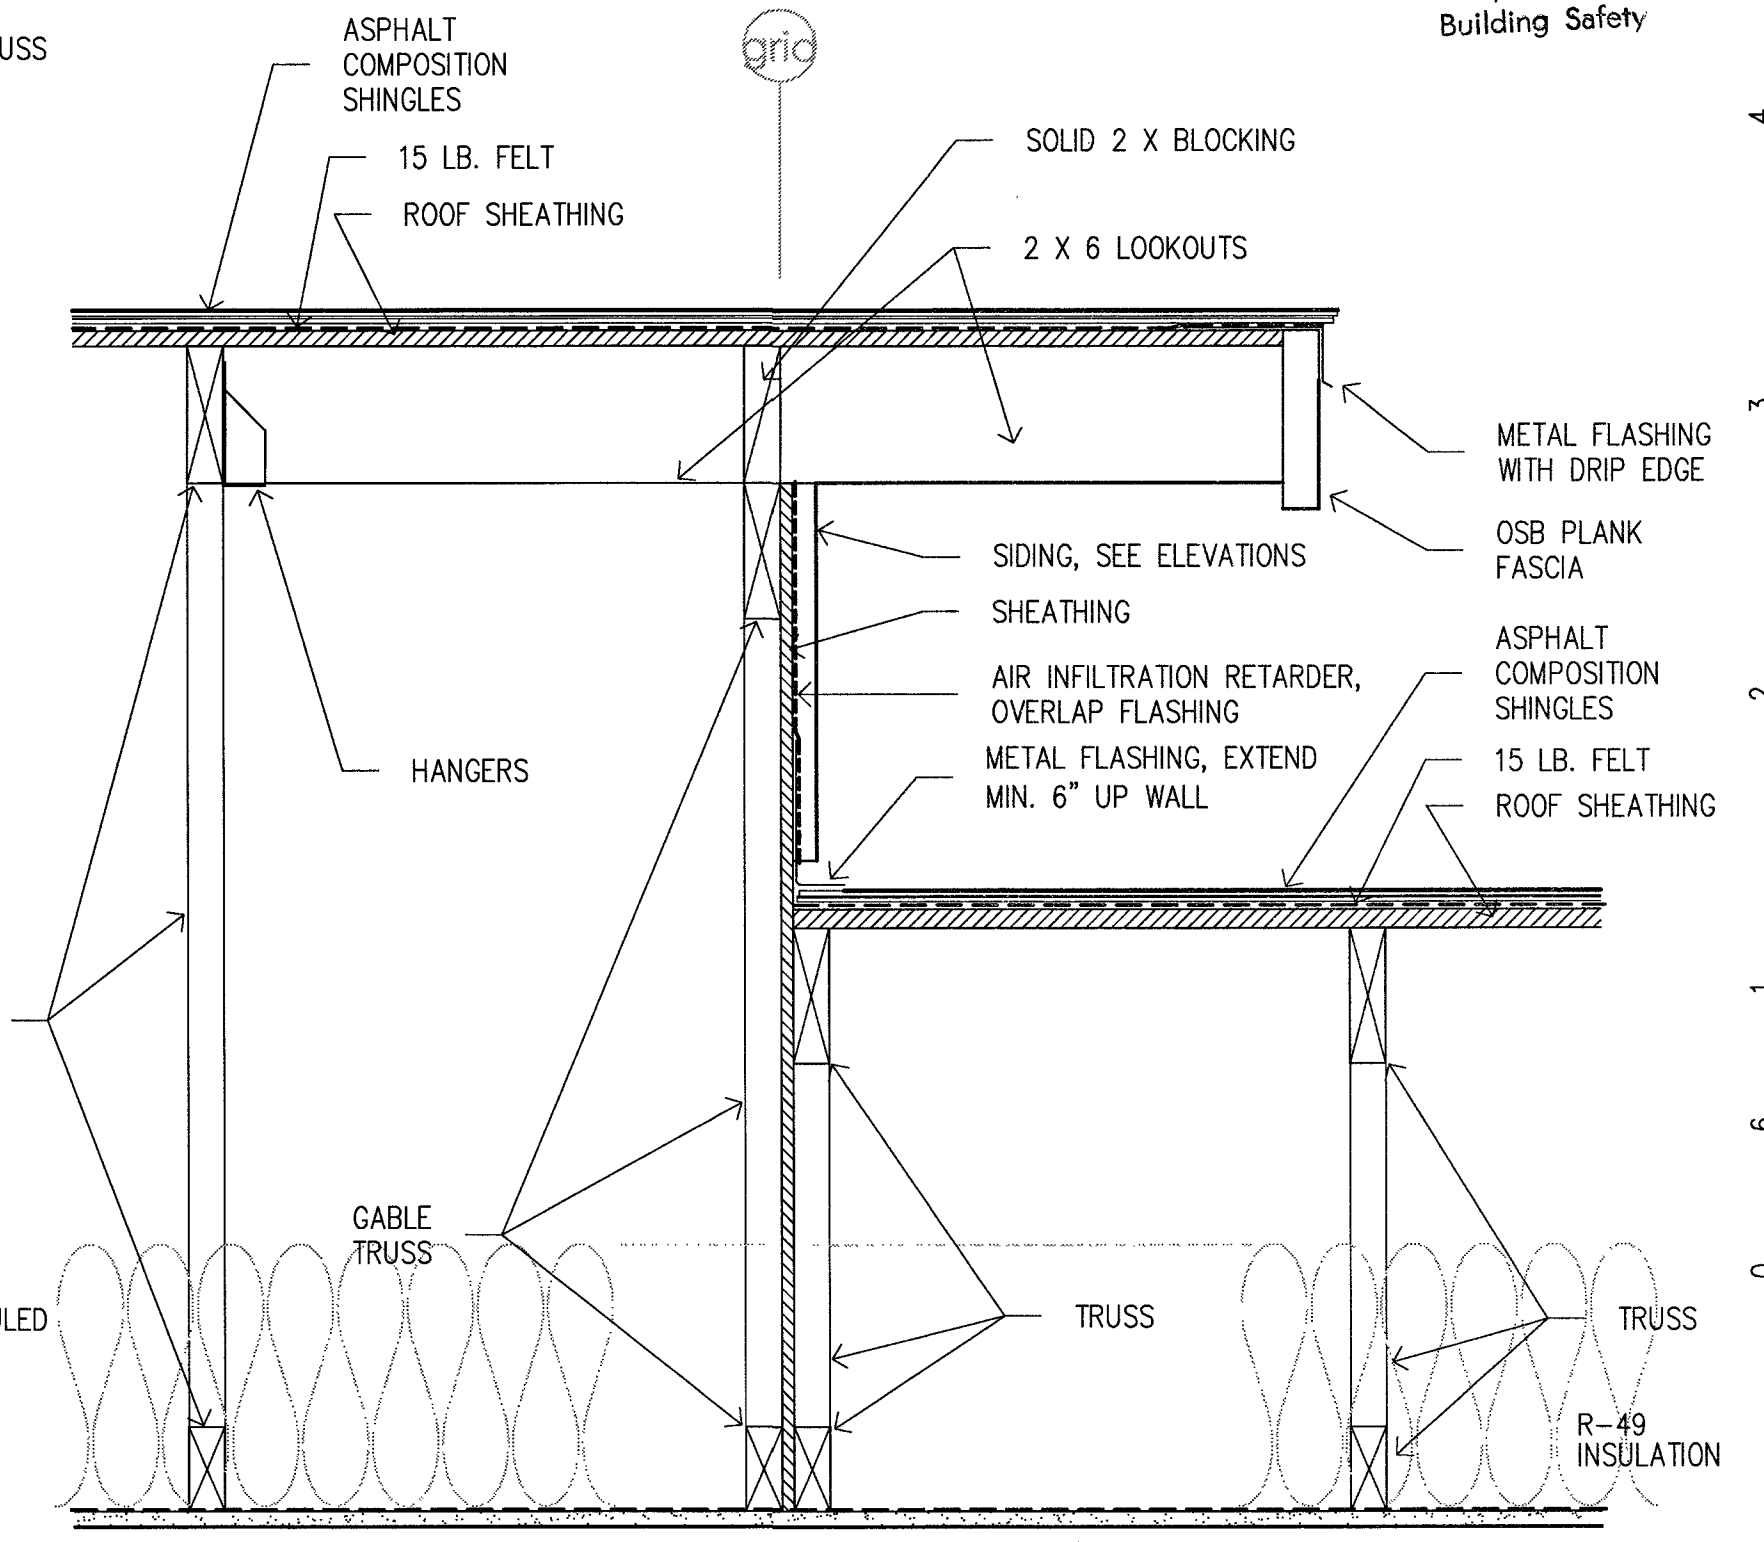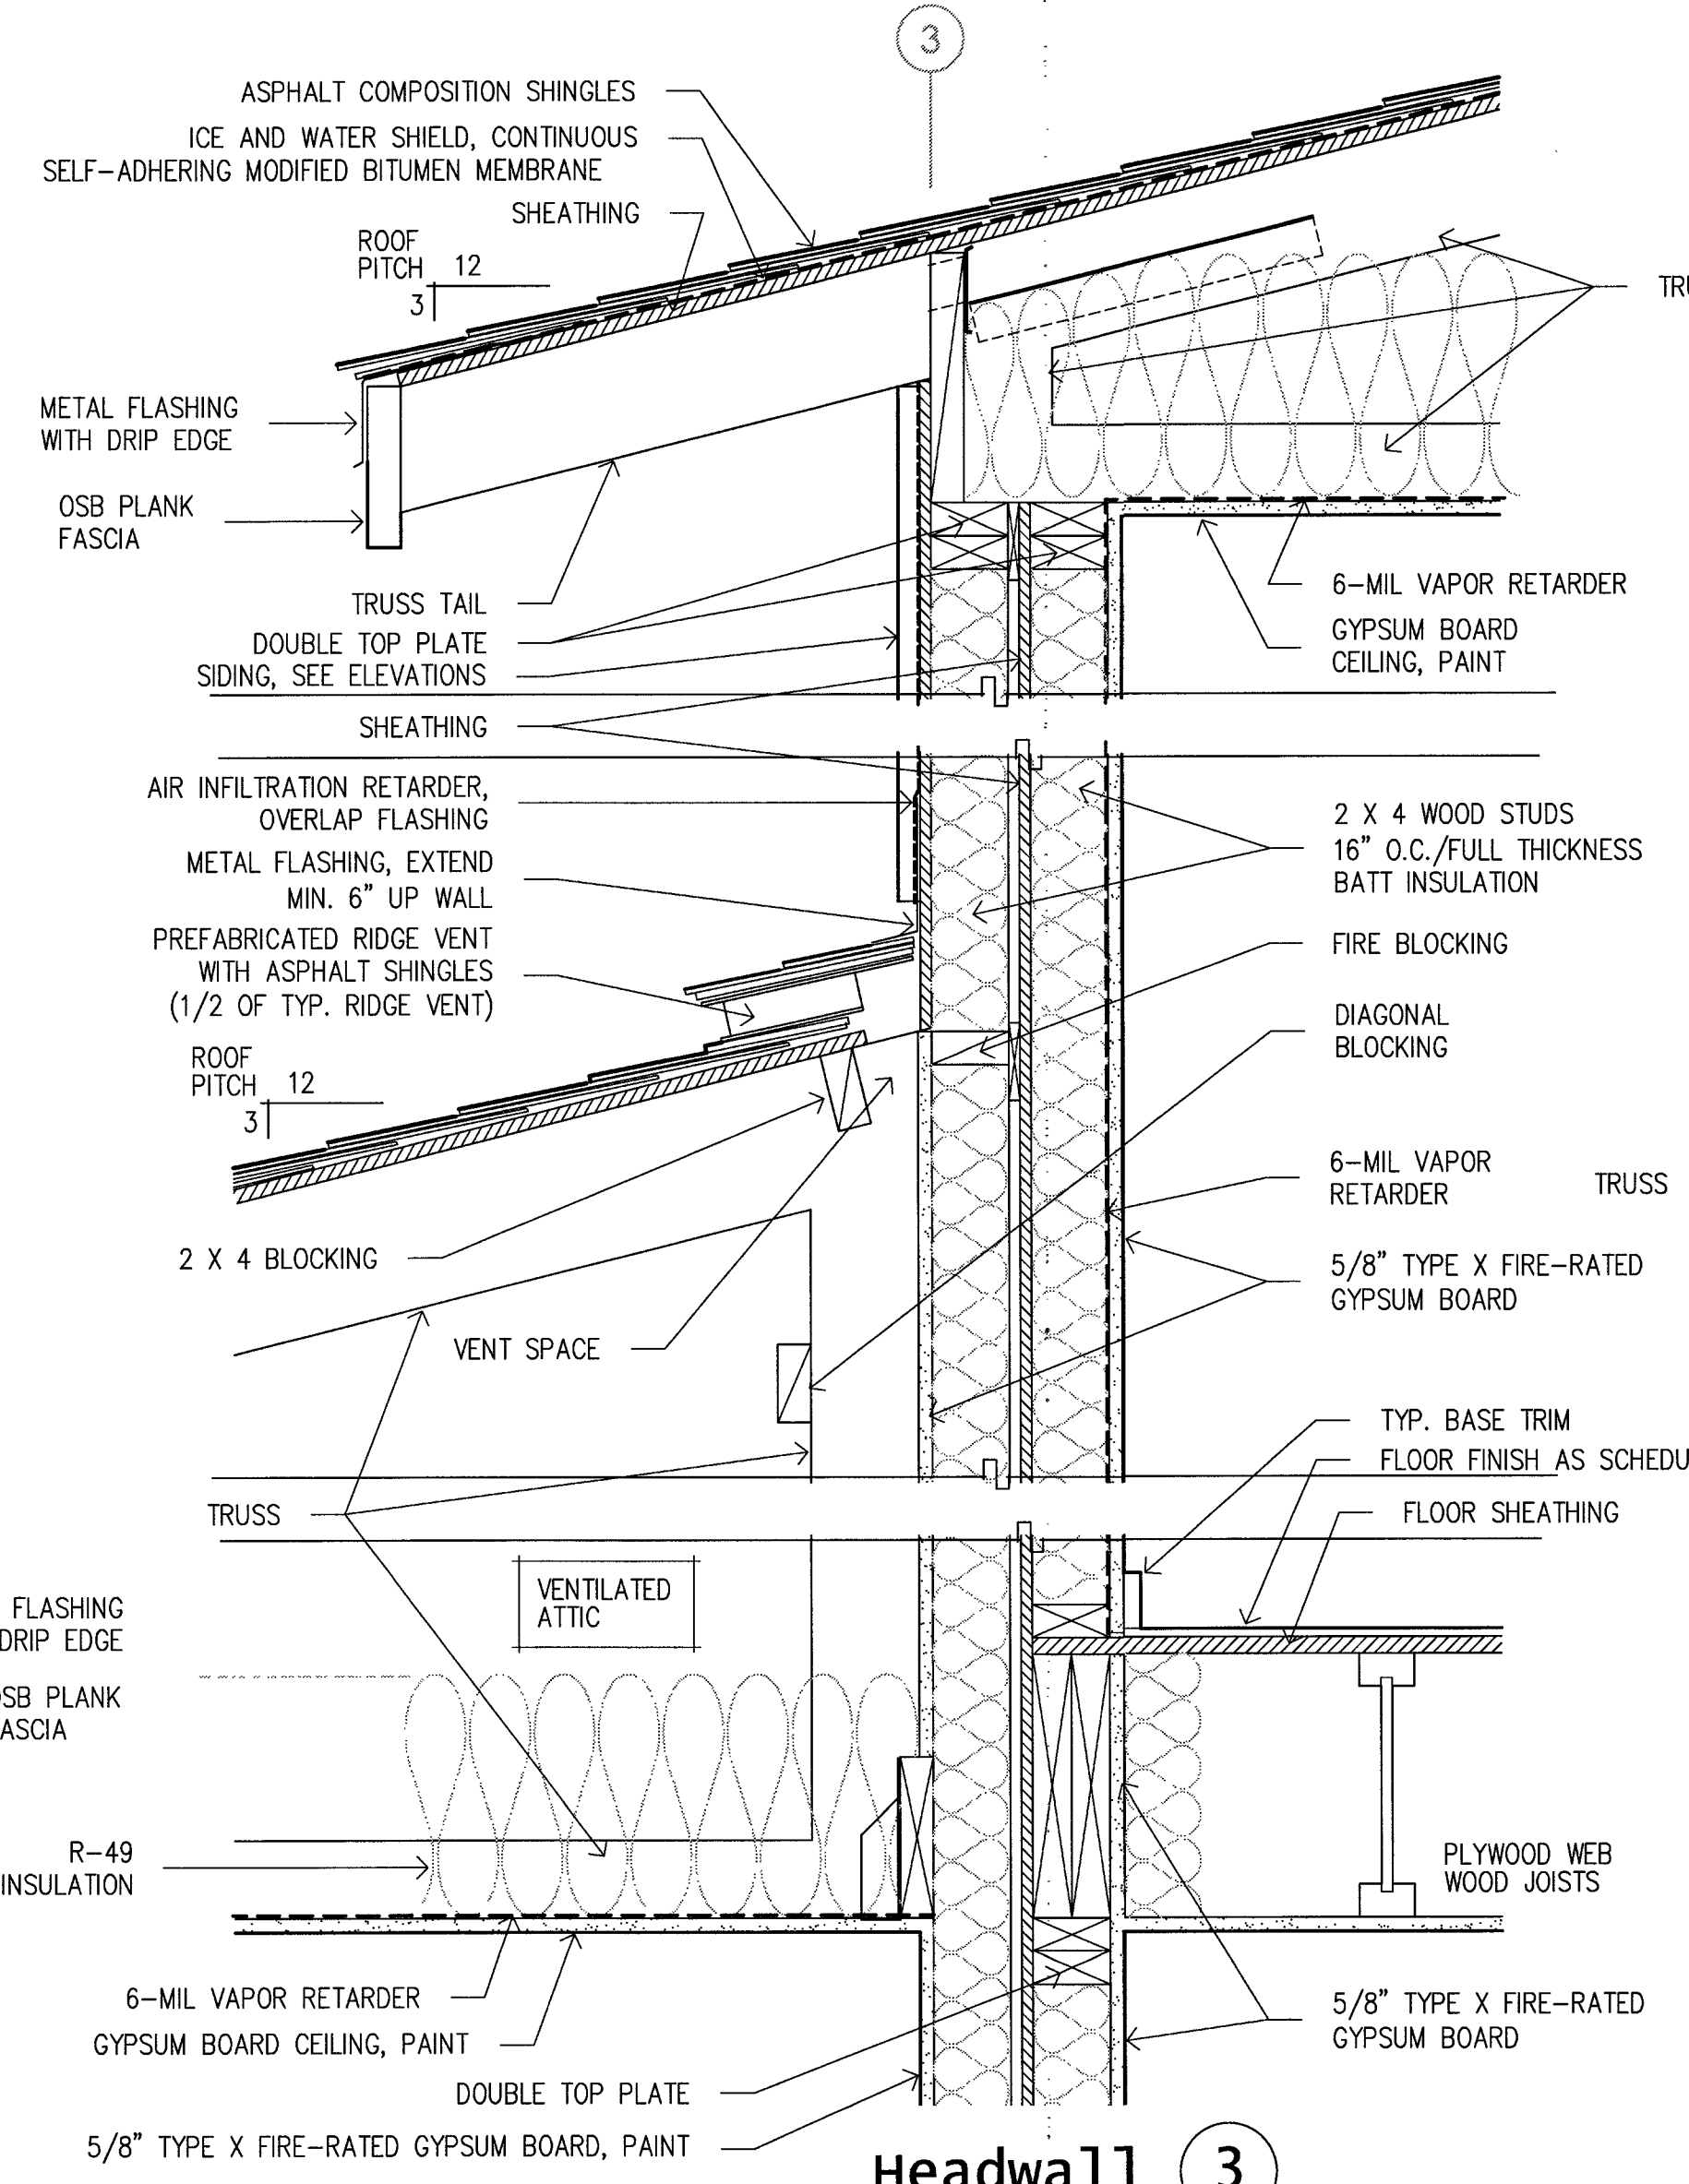

**Sidewall 1**  
SEE DTL 5/S6 FOR  
ADDITIONAL INFORMATION

**COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
Lot 4, Spenard East subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA**

Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety

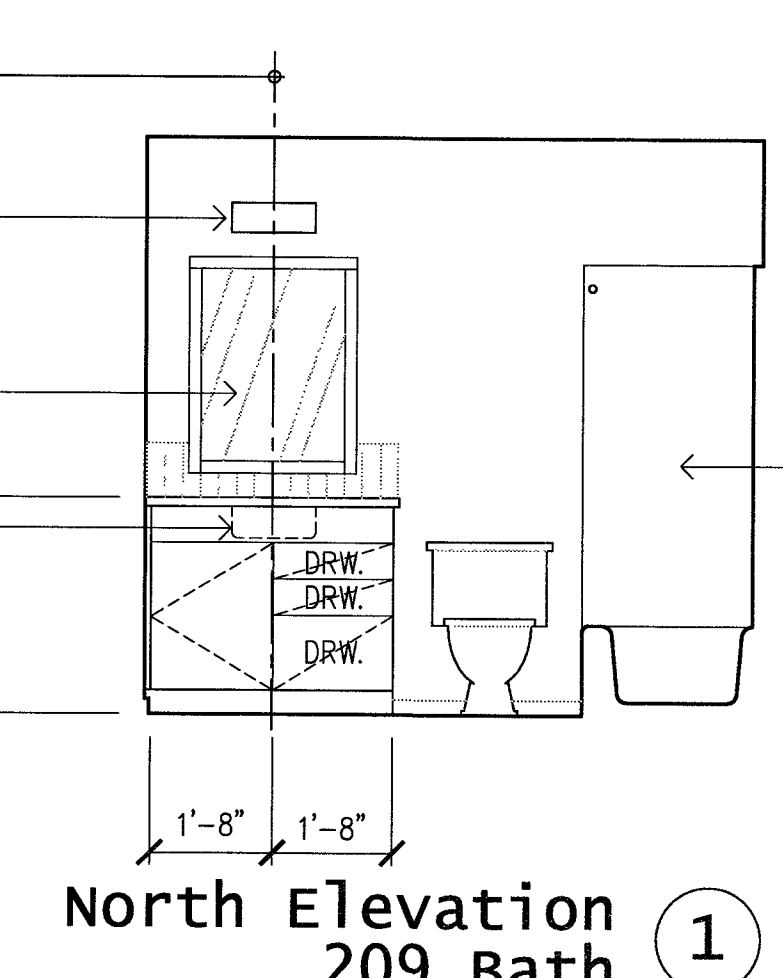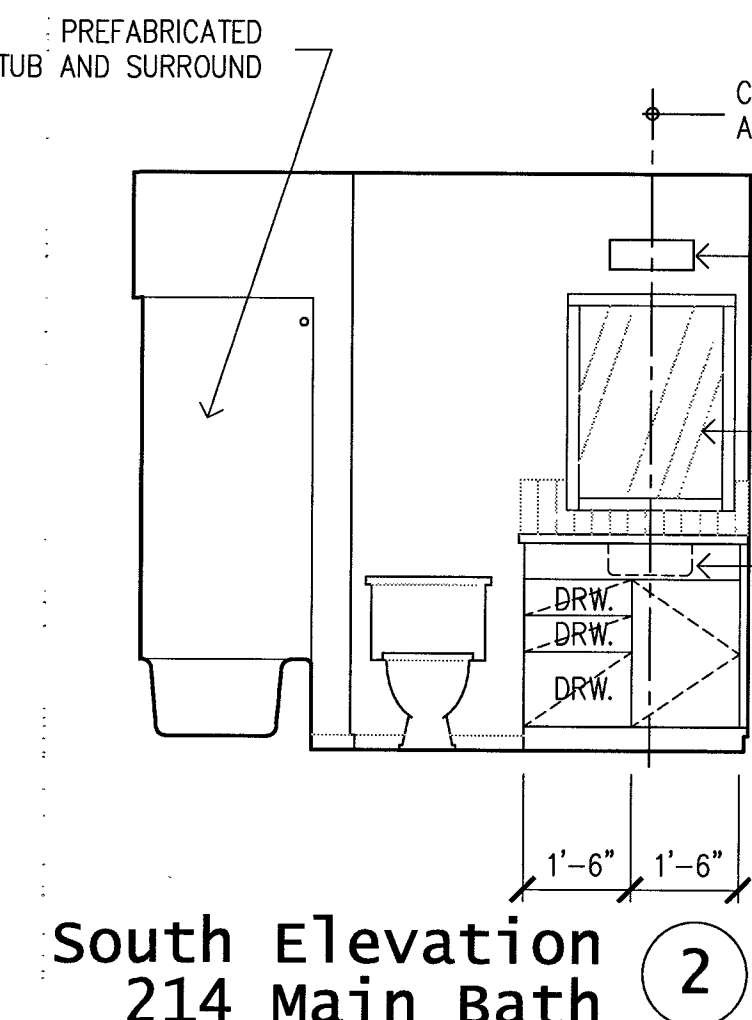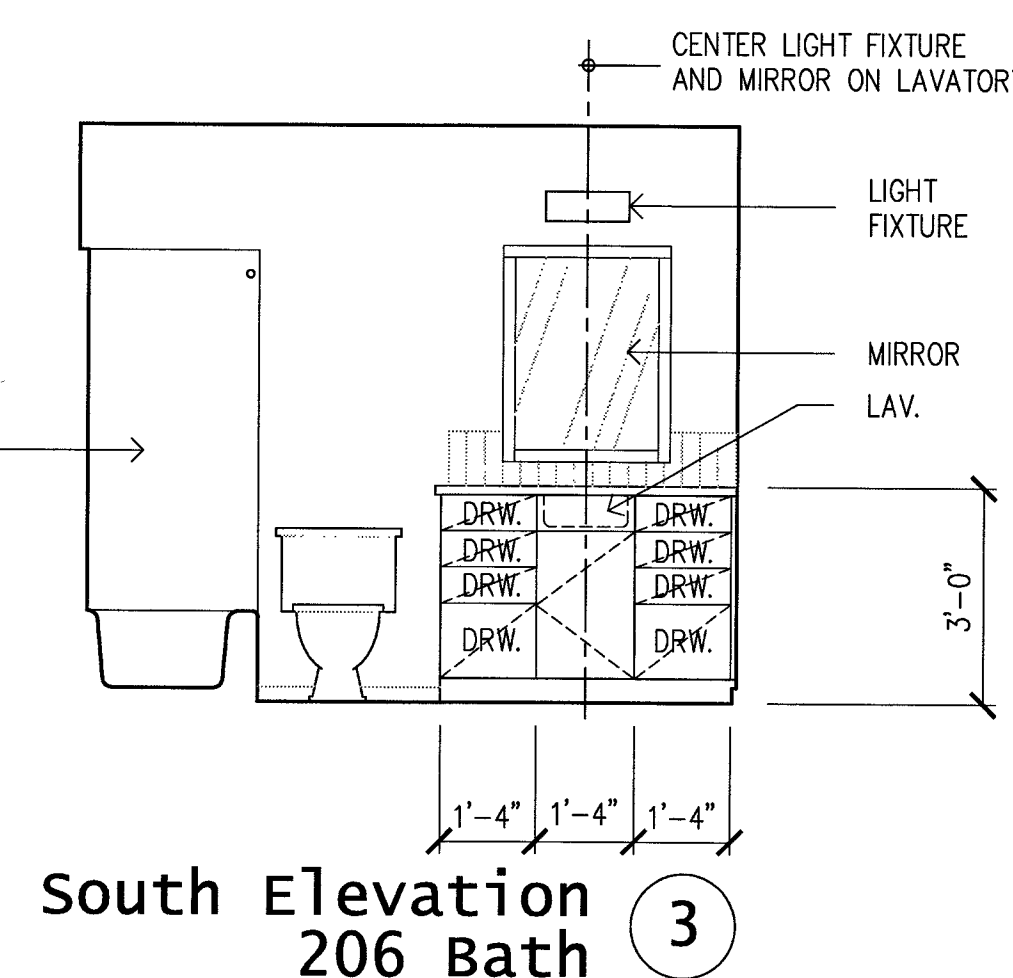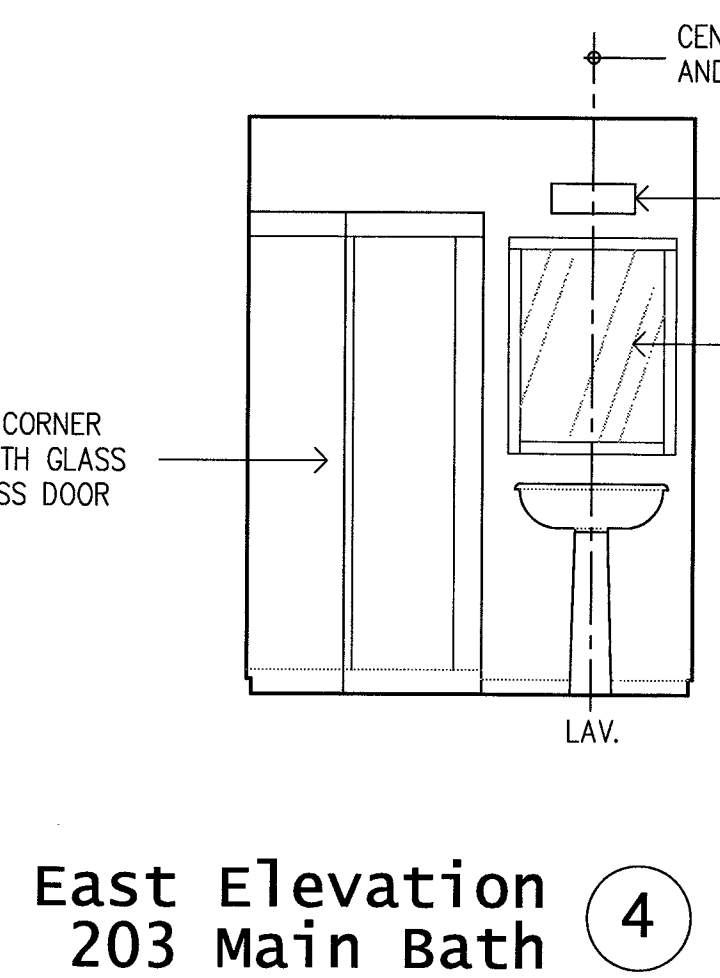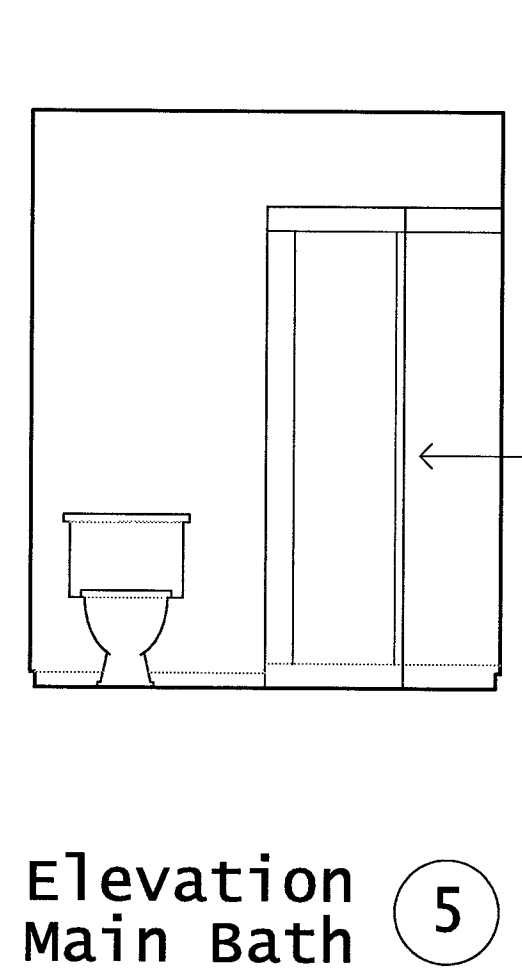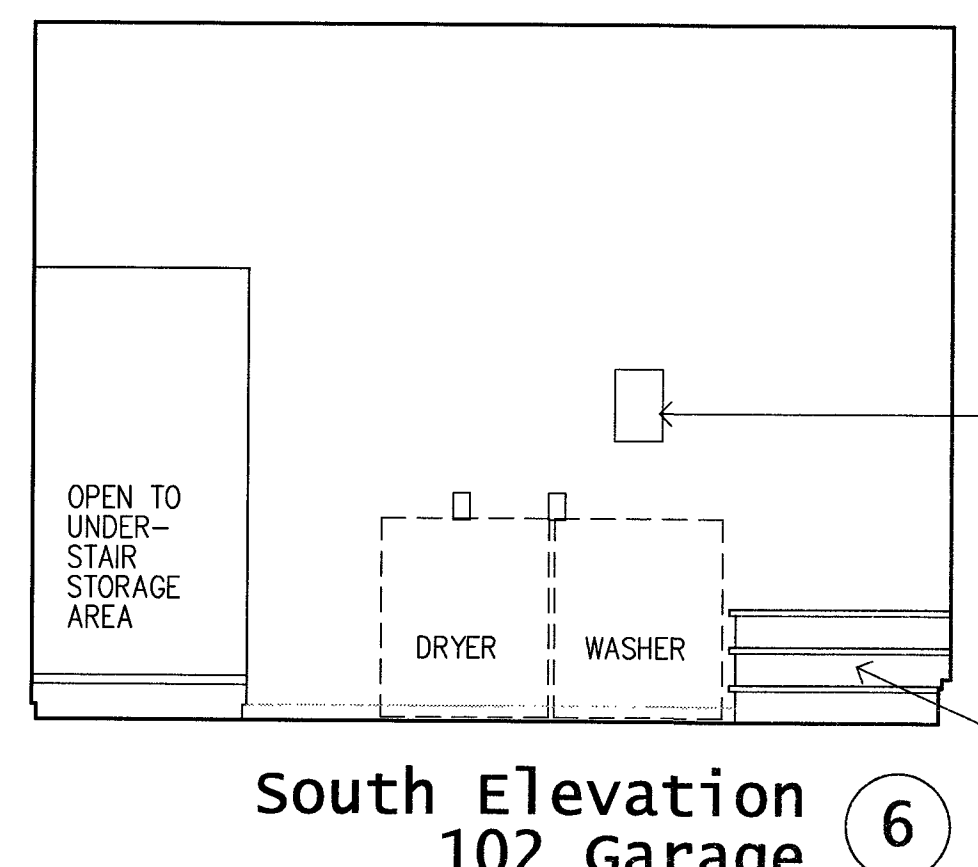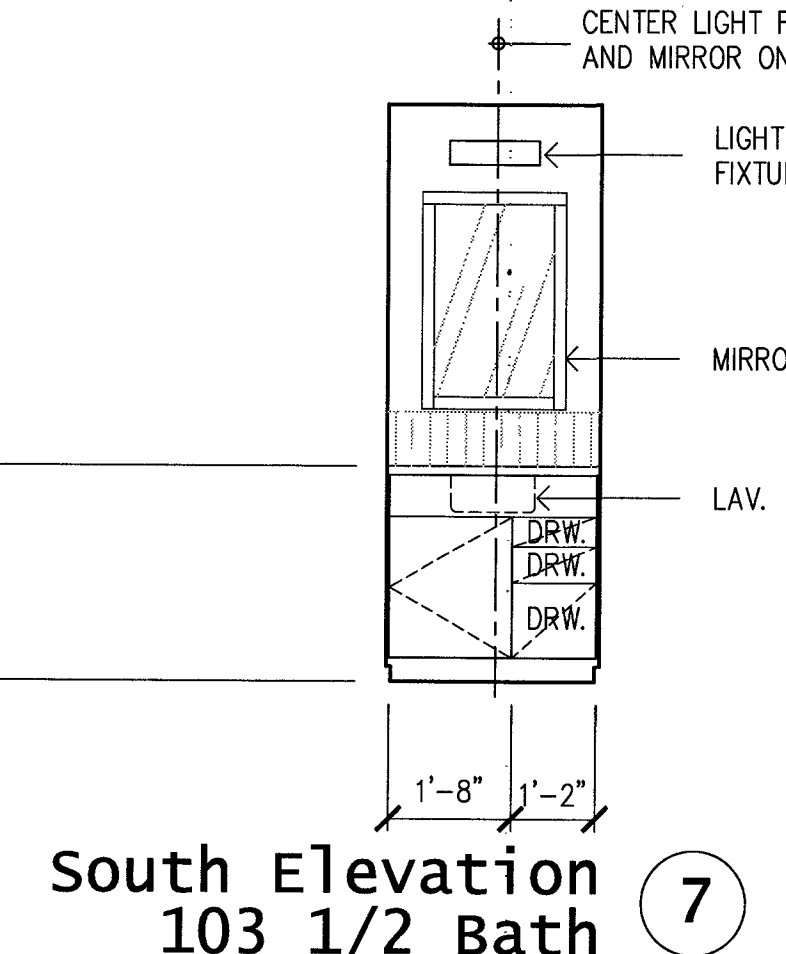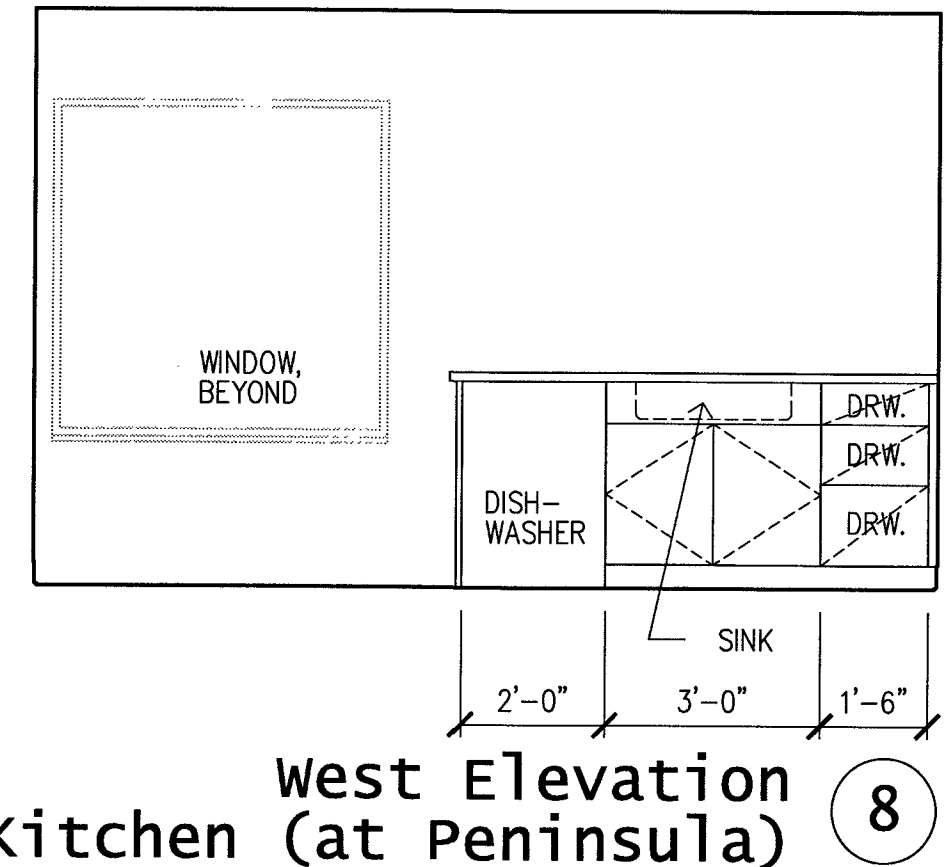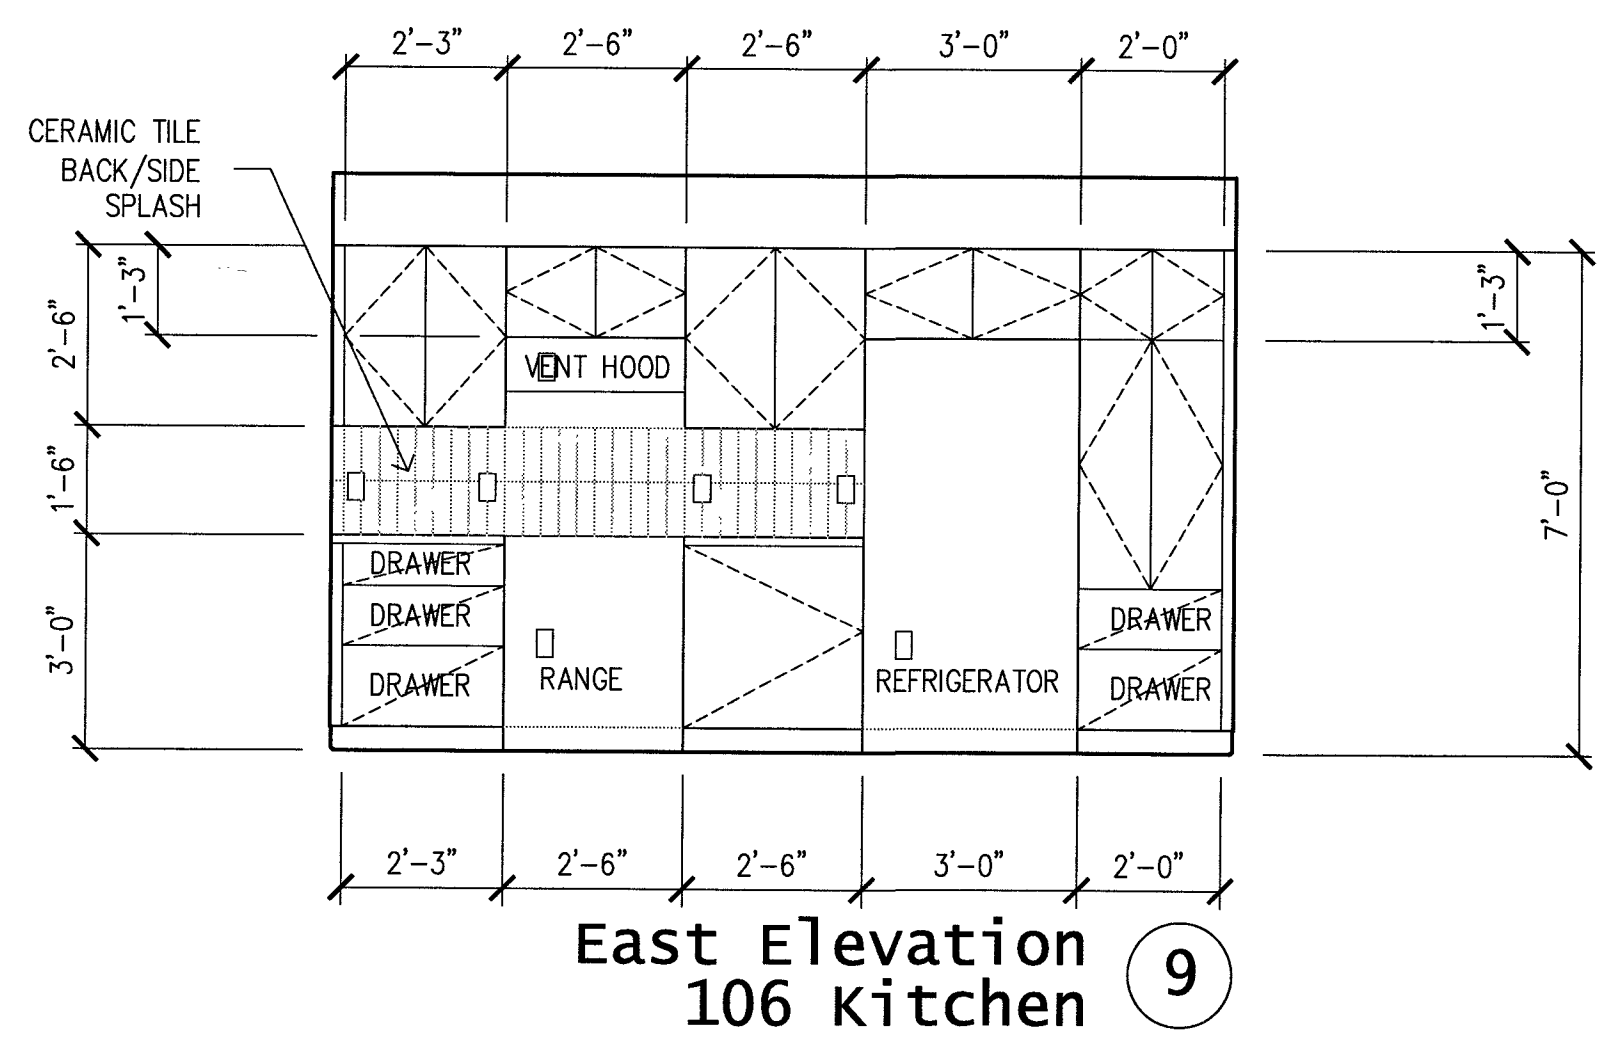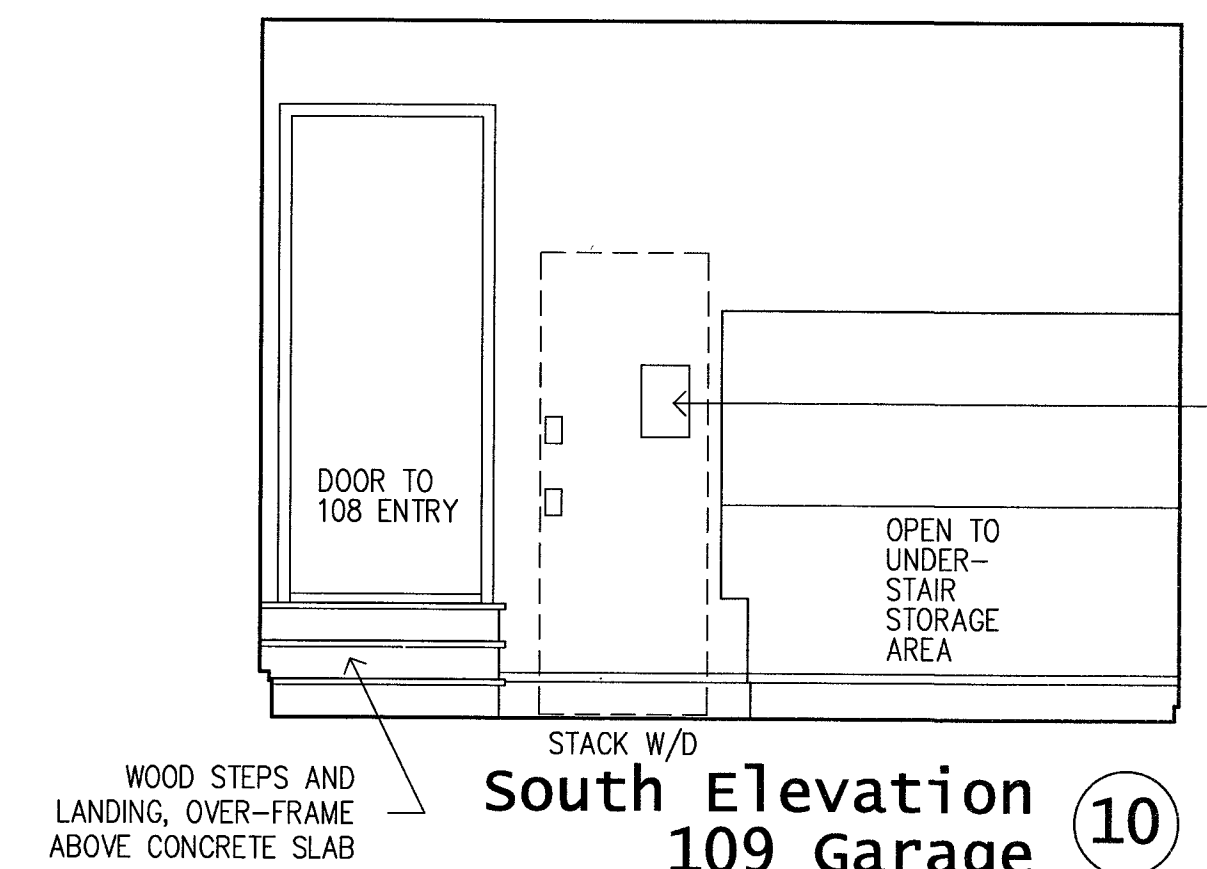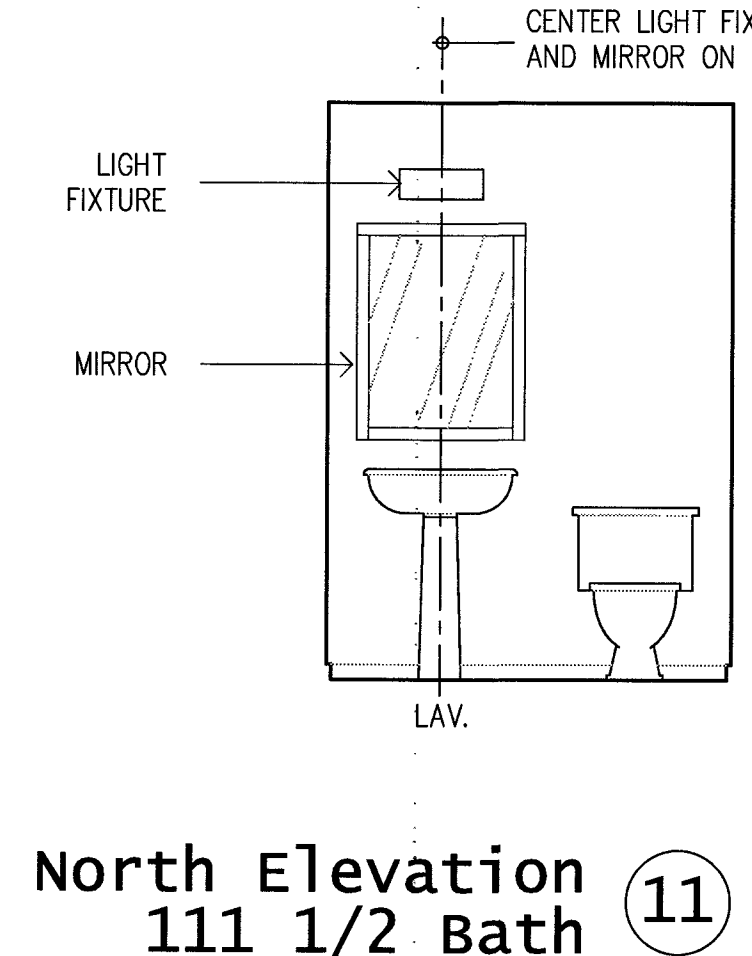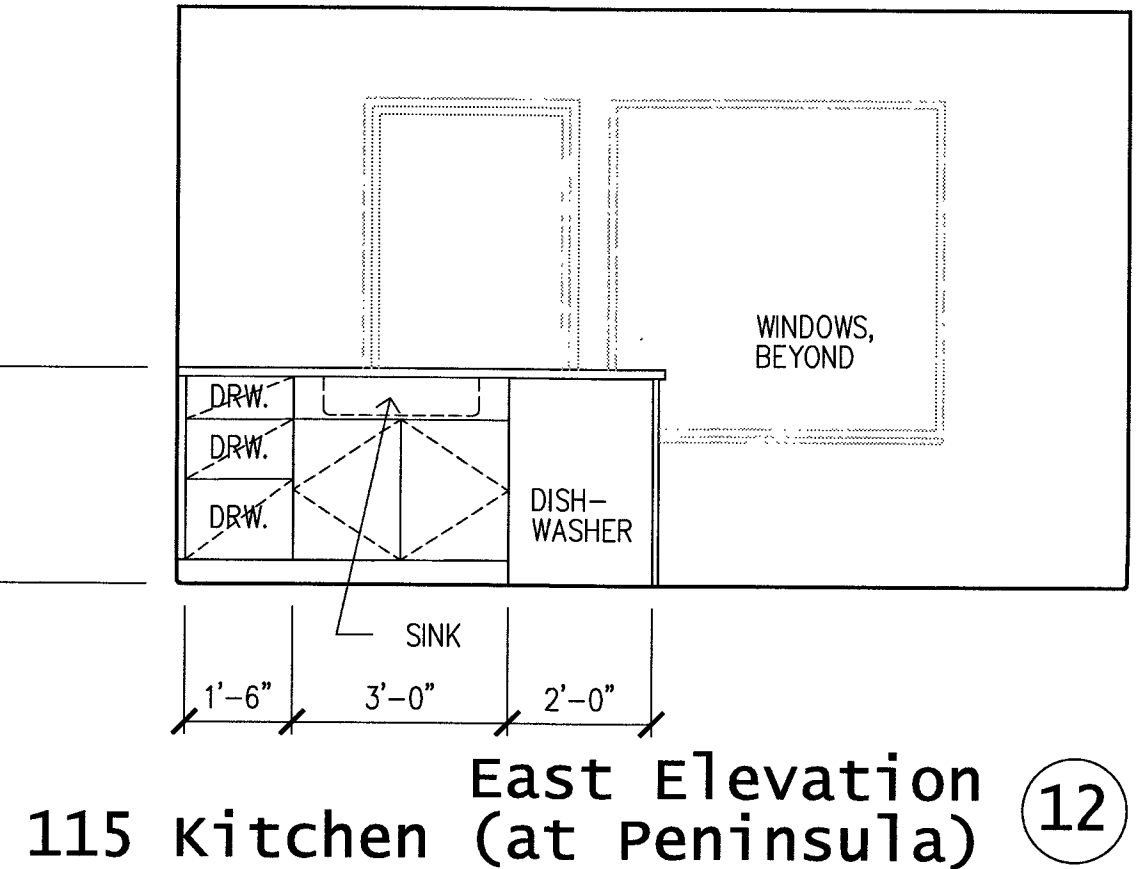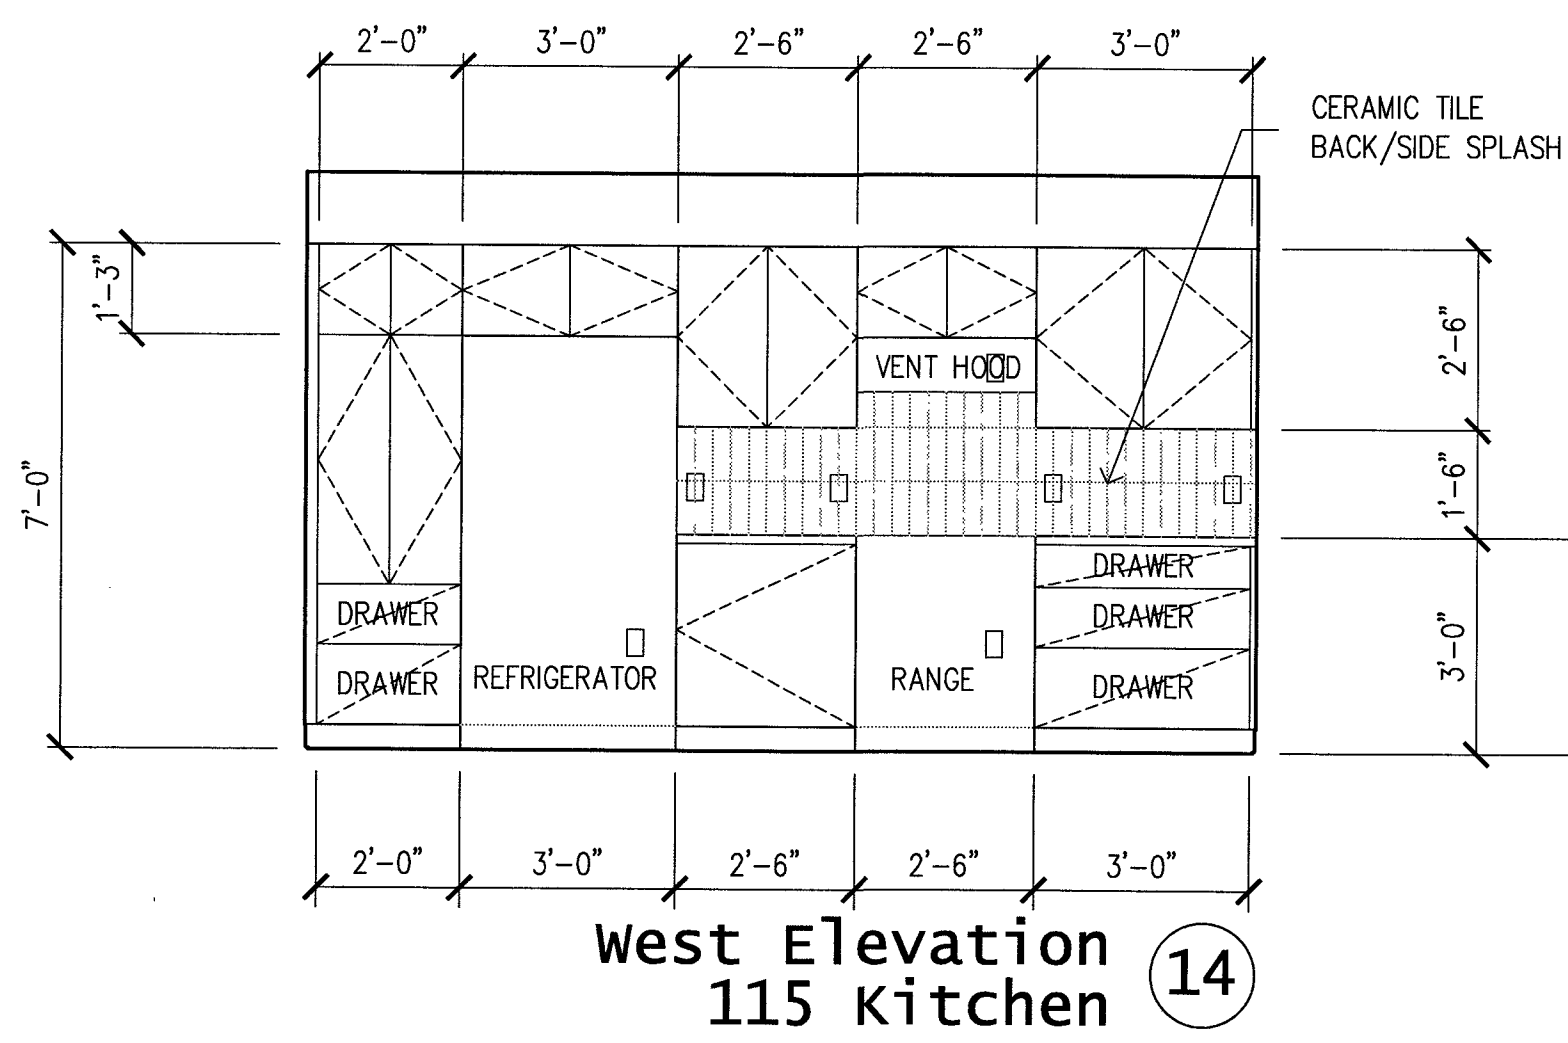

Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety

# Design Criteria

IBC 2018

**WIND**  
 Basic Speed (3 sec gust) 130 mph  
 Exposure B  
 Pressures ASCE 7-16  
 Risk Category III  
 Int pressure Coeff .18 (±)

**Wind Load Analysis** MWFRS (ANY HT)

**SEISMIC**  
 Base shear = .015 \* W<sub>s</sub> ASD SDS = 1.005  
 Use Group I SD1 = 0.700  
 Design Category D SS = 1.500  
 Site Class D S1 = 0.677  
 R = 6.5 IS = 1.0

**Seismic Load Analysis** Simplified Design Procedure

**SNOW**  
 Roof Snow, P<sub>f</sub> 40 psf  
 Ground Snow, P<sub>g</sub> 57 psf  
 Exposure Factor, C<sub>e</sub> 1.0  
 Thermal Factor, C<sub>t</sub> 1.0  
 Importance Factor, I<sub>s</sub> 1.0

**LOADS**  
 Snow 40 psf  
 Snow Seismic 8 psf  
 Roof Dead 15 psf  
 Roof Live 20 psf  
 Floor Dead 15 psf  
 Floor Live 40 psf  
 Exterior Walls 8 psf  
 Interior Walls 6 psf  
 CMU Foundation 85 psf  
 Concrete Foundation 100 psf

**SOILS**  
 Soil bearing strength assumed to be 1,500 psf, with 1/3 increase for seismic or wind loads, unless noted otherwise.  
 Retaining wall design by equivalent fluid pressure. Soil weight assumed to be 40 pcf.

**LATERAL LOAD RESISTING SYSTEM**  
 Light frame walls with wood shear panels.



## SOILS

- Allowable bearing strength assumed to be 1,500 psf, with 33% increase for seismic or wind loads unless noted otherwise.

## CONCRETE

- Portland cement concrete to have minimum 28 day compressive strength, F<sub>c</sub> = 3,000 psi. 5 sack (minimum) design mix. Maximum aggregate size, 3/4".
- Concrete reinforcement to be ASTM A615, grade 60, deformed bars.



## CMU

- Masonry units to be normal weight, fully grouted and reinforced per #3 below.
- All masonry shall be solid grout, Type M or S Mortar and mechanically consolidated.
- Reinforcing to be as shown on drawings. Minimum reinforcement shall be #5 at 32" OC; #5 at 48" OC, and #5 in top course. Vertical reinforcement to have standard hook. Reinforcement to be ASTM A615, grade 60, deformed bars. "Wet" setting reinforcement is prohibited.
- F<sub>m</sub> = 2500 psi

## WOOD

- Framing lumber assumed Hem-Fir, #2 or better. Bottom plates at concrete assumed treated #2 Hem-Fir.
- Truss lumber assumed Doug Fir.
- Blocking not required roof/floor diaphragms unless noted otherwise; boundary nail roofs at 3" o.c., panel edges at 4" o.c. and field at 8" o.c. Boundary nail floors at 4" o.c., panel edges at 4" o.c. and field at 12" o.c.
- Shear wall/roof diaphragm/floor diaphragm stapling/nailing specified refers to panel edge and boundaries; field fasten at 12" o.c., floors and walls. Field fasten roofs at 8" o.c., unless noted otherwise.
- Multiple stud splices - use two rows 16d com at 6" o.c., min.
- Multiple LVL - splice with two rows 16d com at 6" o.c., 2" from top and 2" from bottom.
- 3" members required at abutting panel joints and staples/nails shall be staggered where nail spacing is 2" o.c. and where 10d nails penetrating more than 1-1/2" are placed at 3" or less o.c. 3" bottom plates are required where unit shear loads exceed 600 plf.
- Glulam members - single span, rated 24F-V4, DF/DF; multiple span, rated 24F-V8, DF/DF.
- APA rated sheathing required for shear walls, floors and roof diaphragms. Wall sheathing may be installed horizontally or vertically. If installed horizontally, block all panel edges.
- Where T1-11 siding is used for shear sheathing, minimum thickness shall be 19/32". All nailing must be through full thickness. Block all joints if full-height siding is not used.
- Fastener and diaphragm values per IBC 2000, corrected for Hem-Fir.
- Plywood may be substituted for OSB, same thickness, same APA rating.
- Use APA rated sheathing as follows, unless noted otherwise:  
 Shear walls and roofs, non-drift areas 24/16.  
 Roofs, valleys and upper drift areas 32/16.  
 Roofs, below upper roofs and where wall causing drift is 6 ft or higher 40/20.
- 8d nails can substitute for 14-ga. staples, unless noted otherwise.
- Anchor bolts per schedule; all else IBC minimum 5/8" x 12" at 4'-0" o.c.
- Hold downs and anchor bolts shown are Simpson, or as approved by MOA.
- Hold down values per Simpson Hem-Fir tables.
- GWB per IBC minimum; not used for shear.
- Hangers, straps, saddles and other hardware are as manufactured by Simpson Strong-Tie. Values are corrected for Hem-Fir as required.

## STEEL

- Plate, channel, angle - ASTM A36; wide flange - ASTM A992, Gr. 50
- Anchor bolts and machine bolts - ASTM A307, ASTM A1554
- HSS [round, square, rectangular sections] - ASTM A500, Gr. B, F<sub>1</sub> = 46ksi
- Pipe - ASTM A53, Gr. B, F<sub>y</sub> = 35 ksi

# Shear Wall Design Values

(Hem-Fir, ESR 1539 dated 7/1/15)

Wall	Vall <sup>6</sup>	Sheathing	Studs	Members with abutting panels	Nails		
					Boundary nail	Field nail	Btm. plate attach.
N1	326	7/16" OSB, one side	2x at 16" o.c.	(1) 2x	.131 x 2-1/2" at 4" o.c.	.131 x 2-1/2" at 12" o.c.	.148 x 3" at 4" o.c.
N2	419	7/16" OSB, one side	2x at 16" o.c.	3x or (2) 2x stitch with (2) 16d at 4"	.131 x 2-1/2" at 3" o.c.	.131 x 2-1/2" at 12" o.c.	.148 x 3" at 3" o.c.
N3	544	7/16" OSB, one side	2x at 16" o.c.	3x or (2) 2x stitch with (2) 16d at 4"	.131 x 2-1/2" at 2" o.c.	.131 x 2-1/2" at 12" o.c.	.148 x 3" at 2" o.c.
N4	652	7/16" OSB, two sides	2x at 16" o.c.	3x or (2) 2x stitch with (2) 16d at 4"	.131 x 2-1/2" at 4" o.c.	.131 x 2-1/2" at 12" o.c.	.148 x 3" at 2" o.c.
N5	838	7/16" OSB, two sides	2x at 16" o.c.	3x or (2) 2x stitch with (2) 16d at 4"	.131 x 2-1/2" at 3" o.c.	.131 x 2-1/2" at 12" o.c.	.161 x 3" at 2" o.c.
N6	1088	7/16" OSB, two sides	2x at 16" o.c.	3x or (2) 2x stitch with (2) 16d at 4"	.131 x 2-1/2" at 2" o.c.	.131 x 2-1/2" at 12" o.c.	Dbl. rim, two rows .148 x 3" at 2-1/2"
N7	1209	19/32" OSB, two sides	2x at 16" o.c.	3x or (2) 2x stitch with (2) 16d at 3"	.148 at 2" o.c.	.148 at 12" o.c.	Dbl. rim, two rows .161 x 3" at 2"
N8	1618	19/32" OSB, two sides	2x at 16" o.c.	3x or (2) 2x stitch with (2) 16d at 3"	.148 at 2" o.c.	.148 at 12" o.c.	Dbl. rim, two rows SDS1/4 x 3 at 4"

- 3 x (2-2x) members are required at abutting panel edges where spacing is 2" o.c. and where 10d nails penetrating more than 1-1/2" into receiving member are spaced at 3" o.c. or less. Framing members in walls with shears > 350 plf with abutting panels receiving edge nailing shall be 3x (2-2x). 2x sill plates may be used for wall shears > 350 plf and < 600 plf if anchor bolt spacing is one-half that required by the design.
- Offset stagger nails from side to side for double sheathing. Provide two rows nails, staggered where 2" o.c. nailing occurs. Block all sheathing edges. Install sheathing horizontally or substitute 15/32" sheathing for 7/16" sheathing.
- Bottom plate attachment assumes solid members below.
- Where bottom plates rest directly on concrete or masonry, anchor bolt schedule supercedes bottom plate fastening schedule. 3" x 3" x 1/4" washers are required at all sill anchor bolts. 3x (2-2x) sill plates are required where shears > 700 plf. Stitch plates with (2) 16d at 3" o.c., staggered.
- Hem-Fir framing lumber, per ESR 1539 dated 7/1/15, wind or seismic. All values < / = SDPWS-08, Table 4.3A, adjusted per 4.3.3, ASD, seismic, where Vall = [V<sub>nom</sub>/2]<sup>1.5</sup> [1.5-G].
- Multiple stud splices - use two rows 16d com at 6" o.c., min.

## Anchor Bolts

Call-out	Anchor bolt	at	Spacing
1	5/8" x 12"	at	48" o.c.
2	5/8" x 12"	at	36" o.c.
3	5/8" x 12"	at	32" o.c.
4	5/8" x 12"	at	24" o.c.
5	5/8" x 12"	at	16" o.c.
6	5/8" x 12"	at	12" o.c.
7	5/8" x 12"	at	12" o.c.

## Hold Downs

Call-out	Strap or hold down	Chord	Anchor bolt	Embed. concrete	Embed. concrete	Allowable load (lbs.)
1	(1) MST37	(2) 2x				2,828
2	(1) MST48	(2) 2x				4,073
3	(1) MST60	(2) 2x				5,200
4	(1) MST72	(2) 2x				5,800
5	(2) MST48	(4) 2x				8,146
6	HDU2	(2) 2x	5/8"	7" into footing u.n.o.	7" into footing u.n.o.	2,215
7	HDU4	(2) 2x	5/8"	7" into footing u.n.o.	7" into footing u.n.o.	3,285
8	HDU5	(3) 2x	5/8"	7" into footing u.n.o.	7" into footing u.n.o.	4,065
9	HDU8	(2) 2x	7/8"	7" into footing u.n.o.	7" into footing u.n.o.	4,305
10	HDU8	(3) 2x	7/8"	7" into footing u.n.o.	7" into footing u.n.o.	5,665
11	HDU11	(4) 2x	1"	See dfts.	See dfts.	6,865
12	HDU11	(5) 2x	1"	See dfts.	See dfts.	8,045
13	HDU14	(4) 2x	1"	See dfts.	See dfts.	10,350
14	HD12	(3) 2x	1-1/8"	See dfts.	See dfts.	11,055
15	HD12	(4) 2x	1-1/8"	See dfts.	See dfts.	15,510
16	FSC	2x				1,570
17	MSTC48B3	2x				3,380
18	MSTC66B3	2x				3,820


## Roof Design

See Sht. S6 for roof zone locations

Zone	Design Loads	Sheathing Index	Sheathing Nailing
1	TCLL - 40 psf TCDL - 15 psf BCDL - 5 psf	APA 24/16	BN - 8d at 3" o.c. EN - 8d at 3" o.c. FN - 8d at 8" o.c.
2	TCLL - 65 psf TCDL - 15 psf BCDL - 5 psf	APA 32/16	BN - 8d at 3" o.c. EN - 8d at 3" o.c. FN - 8d at 8" o.c.
3	TCLL - 85 psf TCDL - 15 psf BCDL - 5 psf	APA 40/20	BN - 8d at 3" o.c. EN - 8d at 3" o.c. FN - 8d at 8" o.c.
4	TCLL - 105 psf TCDL - 15 psf BCDL - 5 psf	APA 40/20	BN - 8d at 3" o.c. EN - 8d at 3" o.c. FN - 8d at 8" o.c.

BN = boundary nailing  
 EN = edge nailing  
 FN = field nailing

**FRAME**  
 RESIDENTIAL DESIGN  
 340 N. Flower St.  
 Anchorage, AK 99508  
 (907) 351-4825  
 www.frame-ak.com

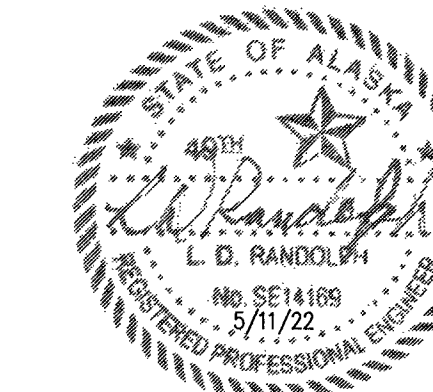

Reviewed for Code Compliance

SEP 18 2022

Ralph Jordan  
 Building Safety

**SUBMITTA**


SEP 07 2022

R22-2251

COOK INLET HOUSING AUTHORITY  
 WILSHIRE AVE. DUPLEX  
 Lot 4, Spenard East Subdivision  
 1106 Wilshire Ave.  
 ANCHORAGE, ALASKA

8/26/22  
 DR. BY: CLARK  
 DATE: 18 JUL 22


**S1**  
 18 OF 23

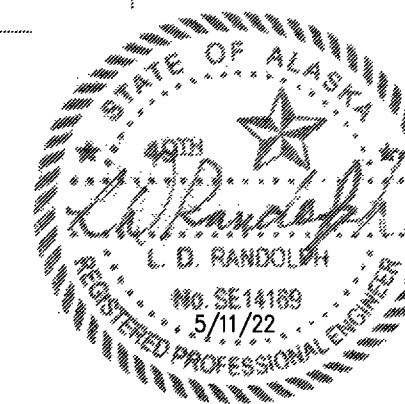

Reviewed for Code Compliance

SEP 16 2022


Ralph Jordan  
Building Safety

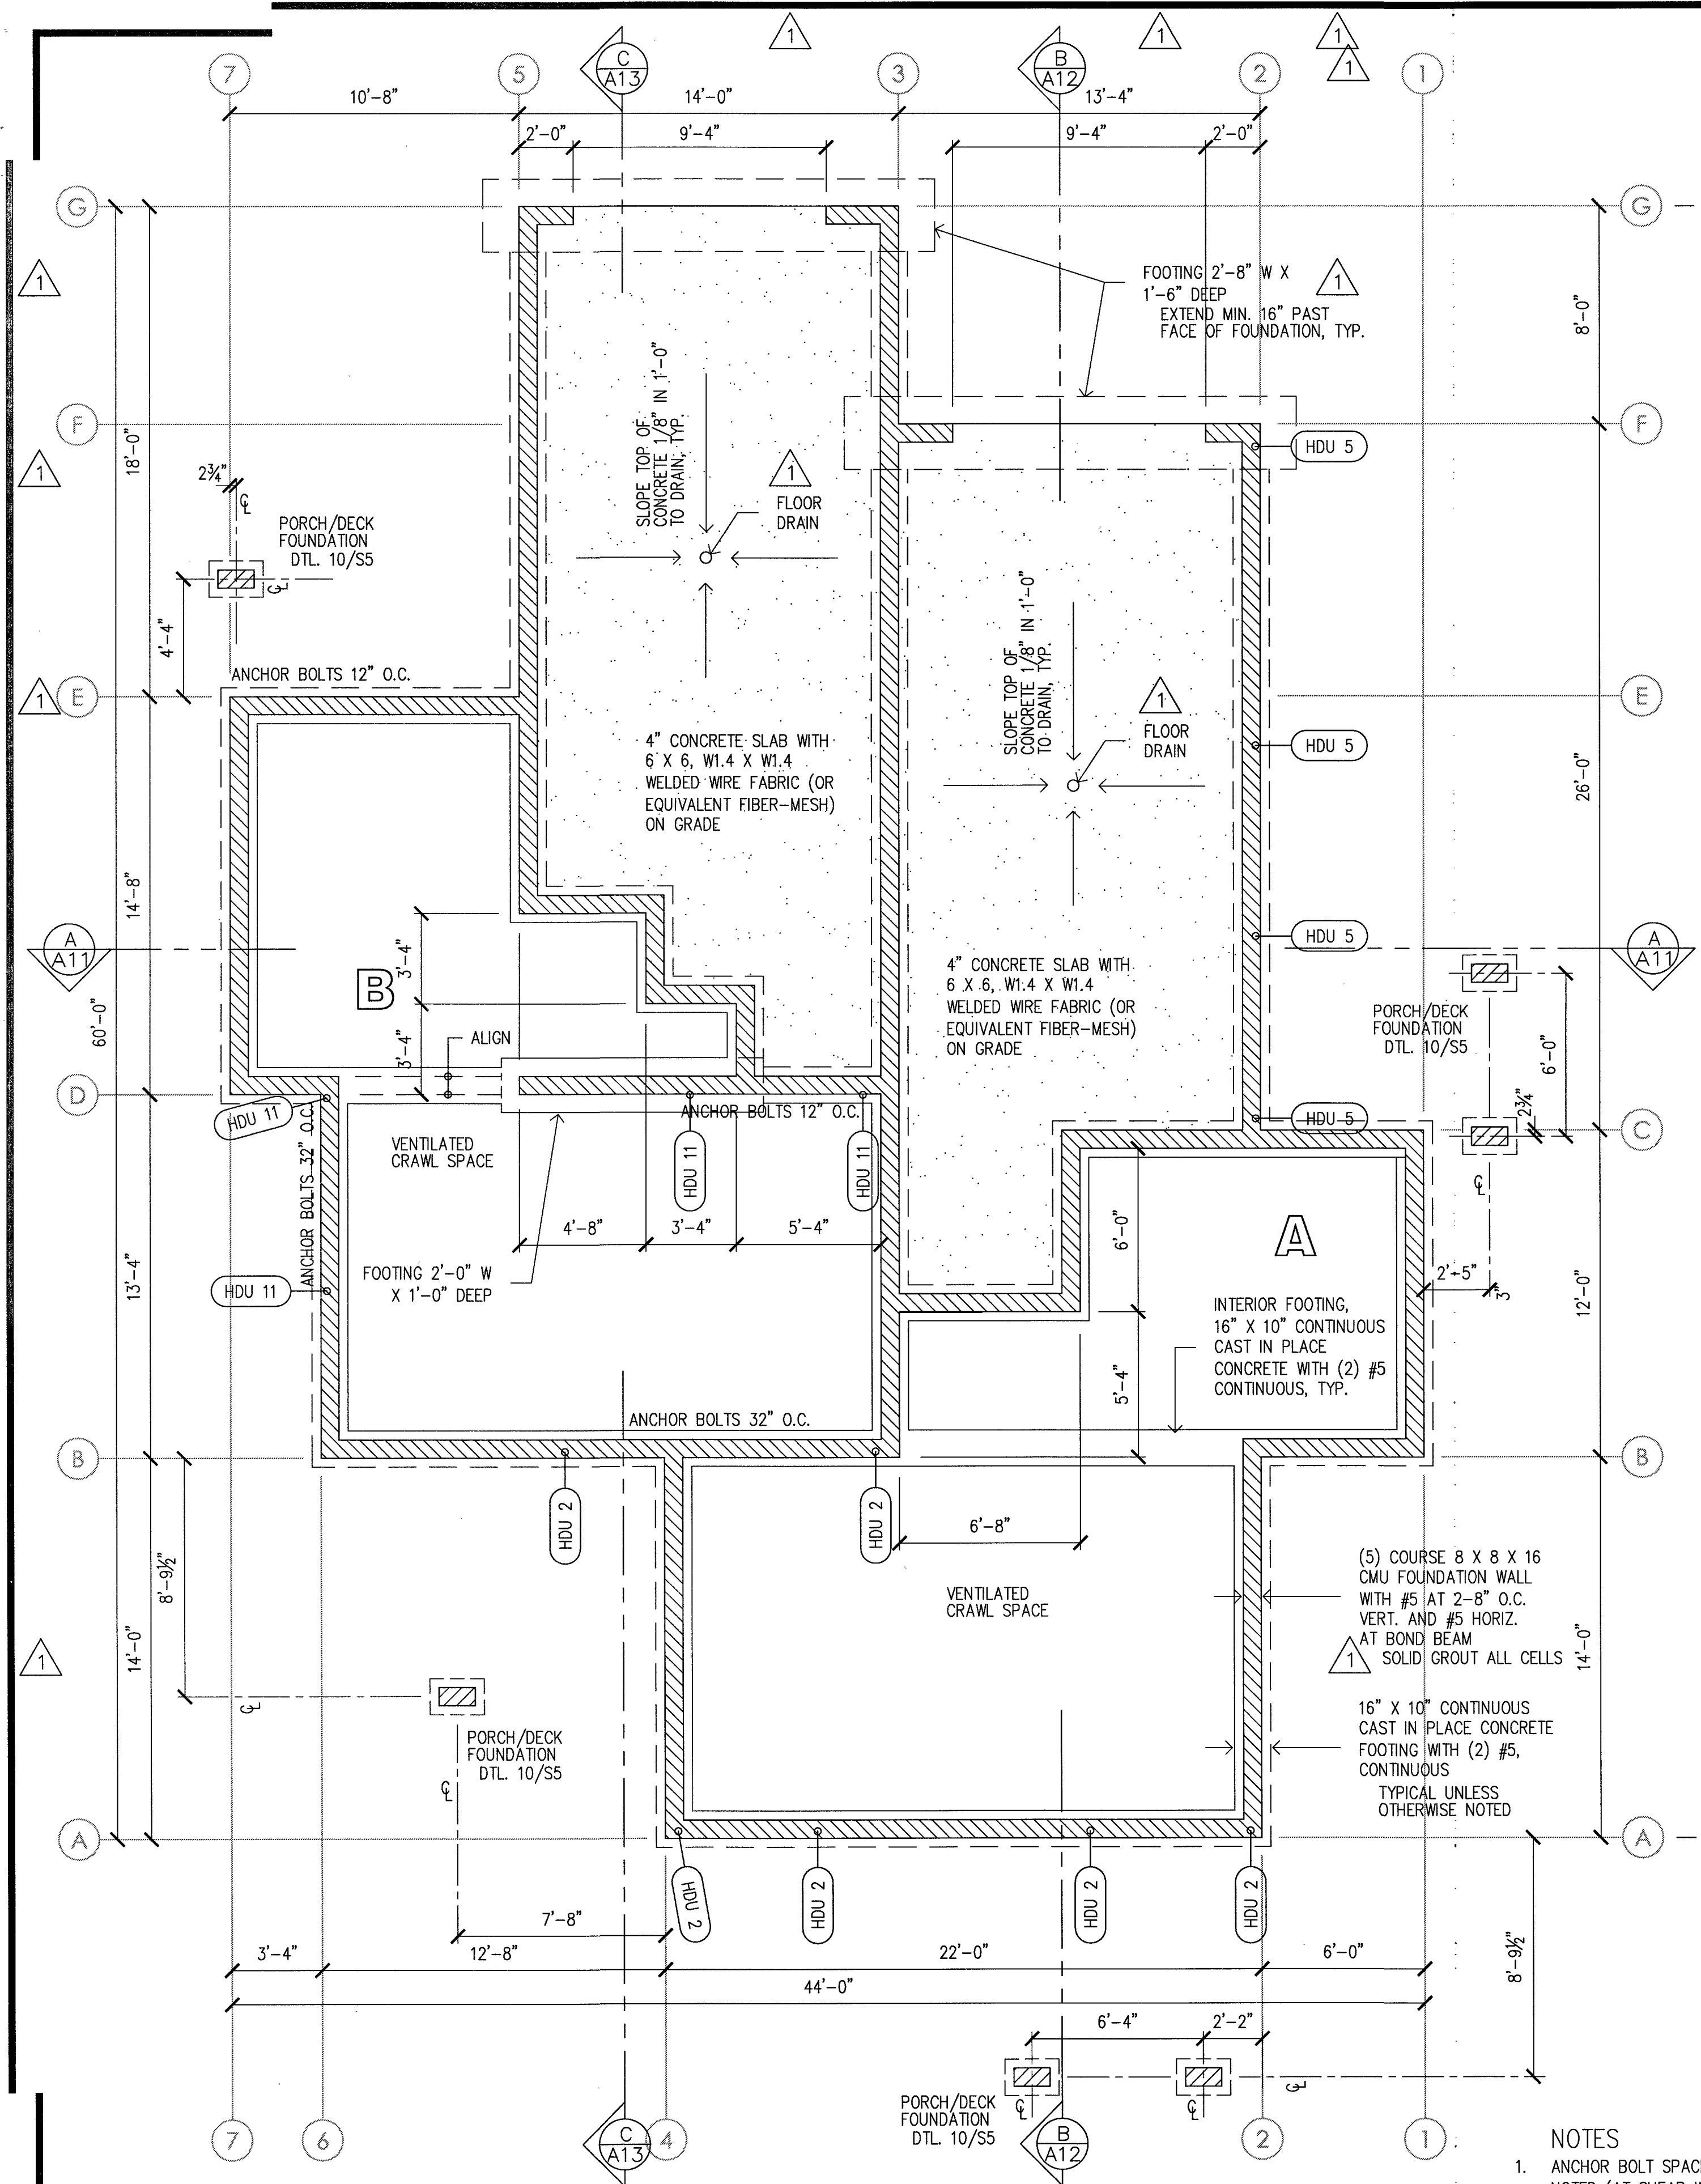


Foundation Plan

NOTES

- ANCHOR BOLT SPACING 4'-0" O.C. EXCEPT AS OTHERWISE NOTED (AT SHEAR WALLS).

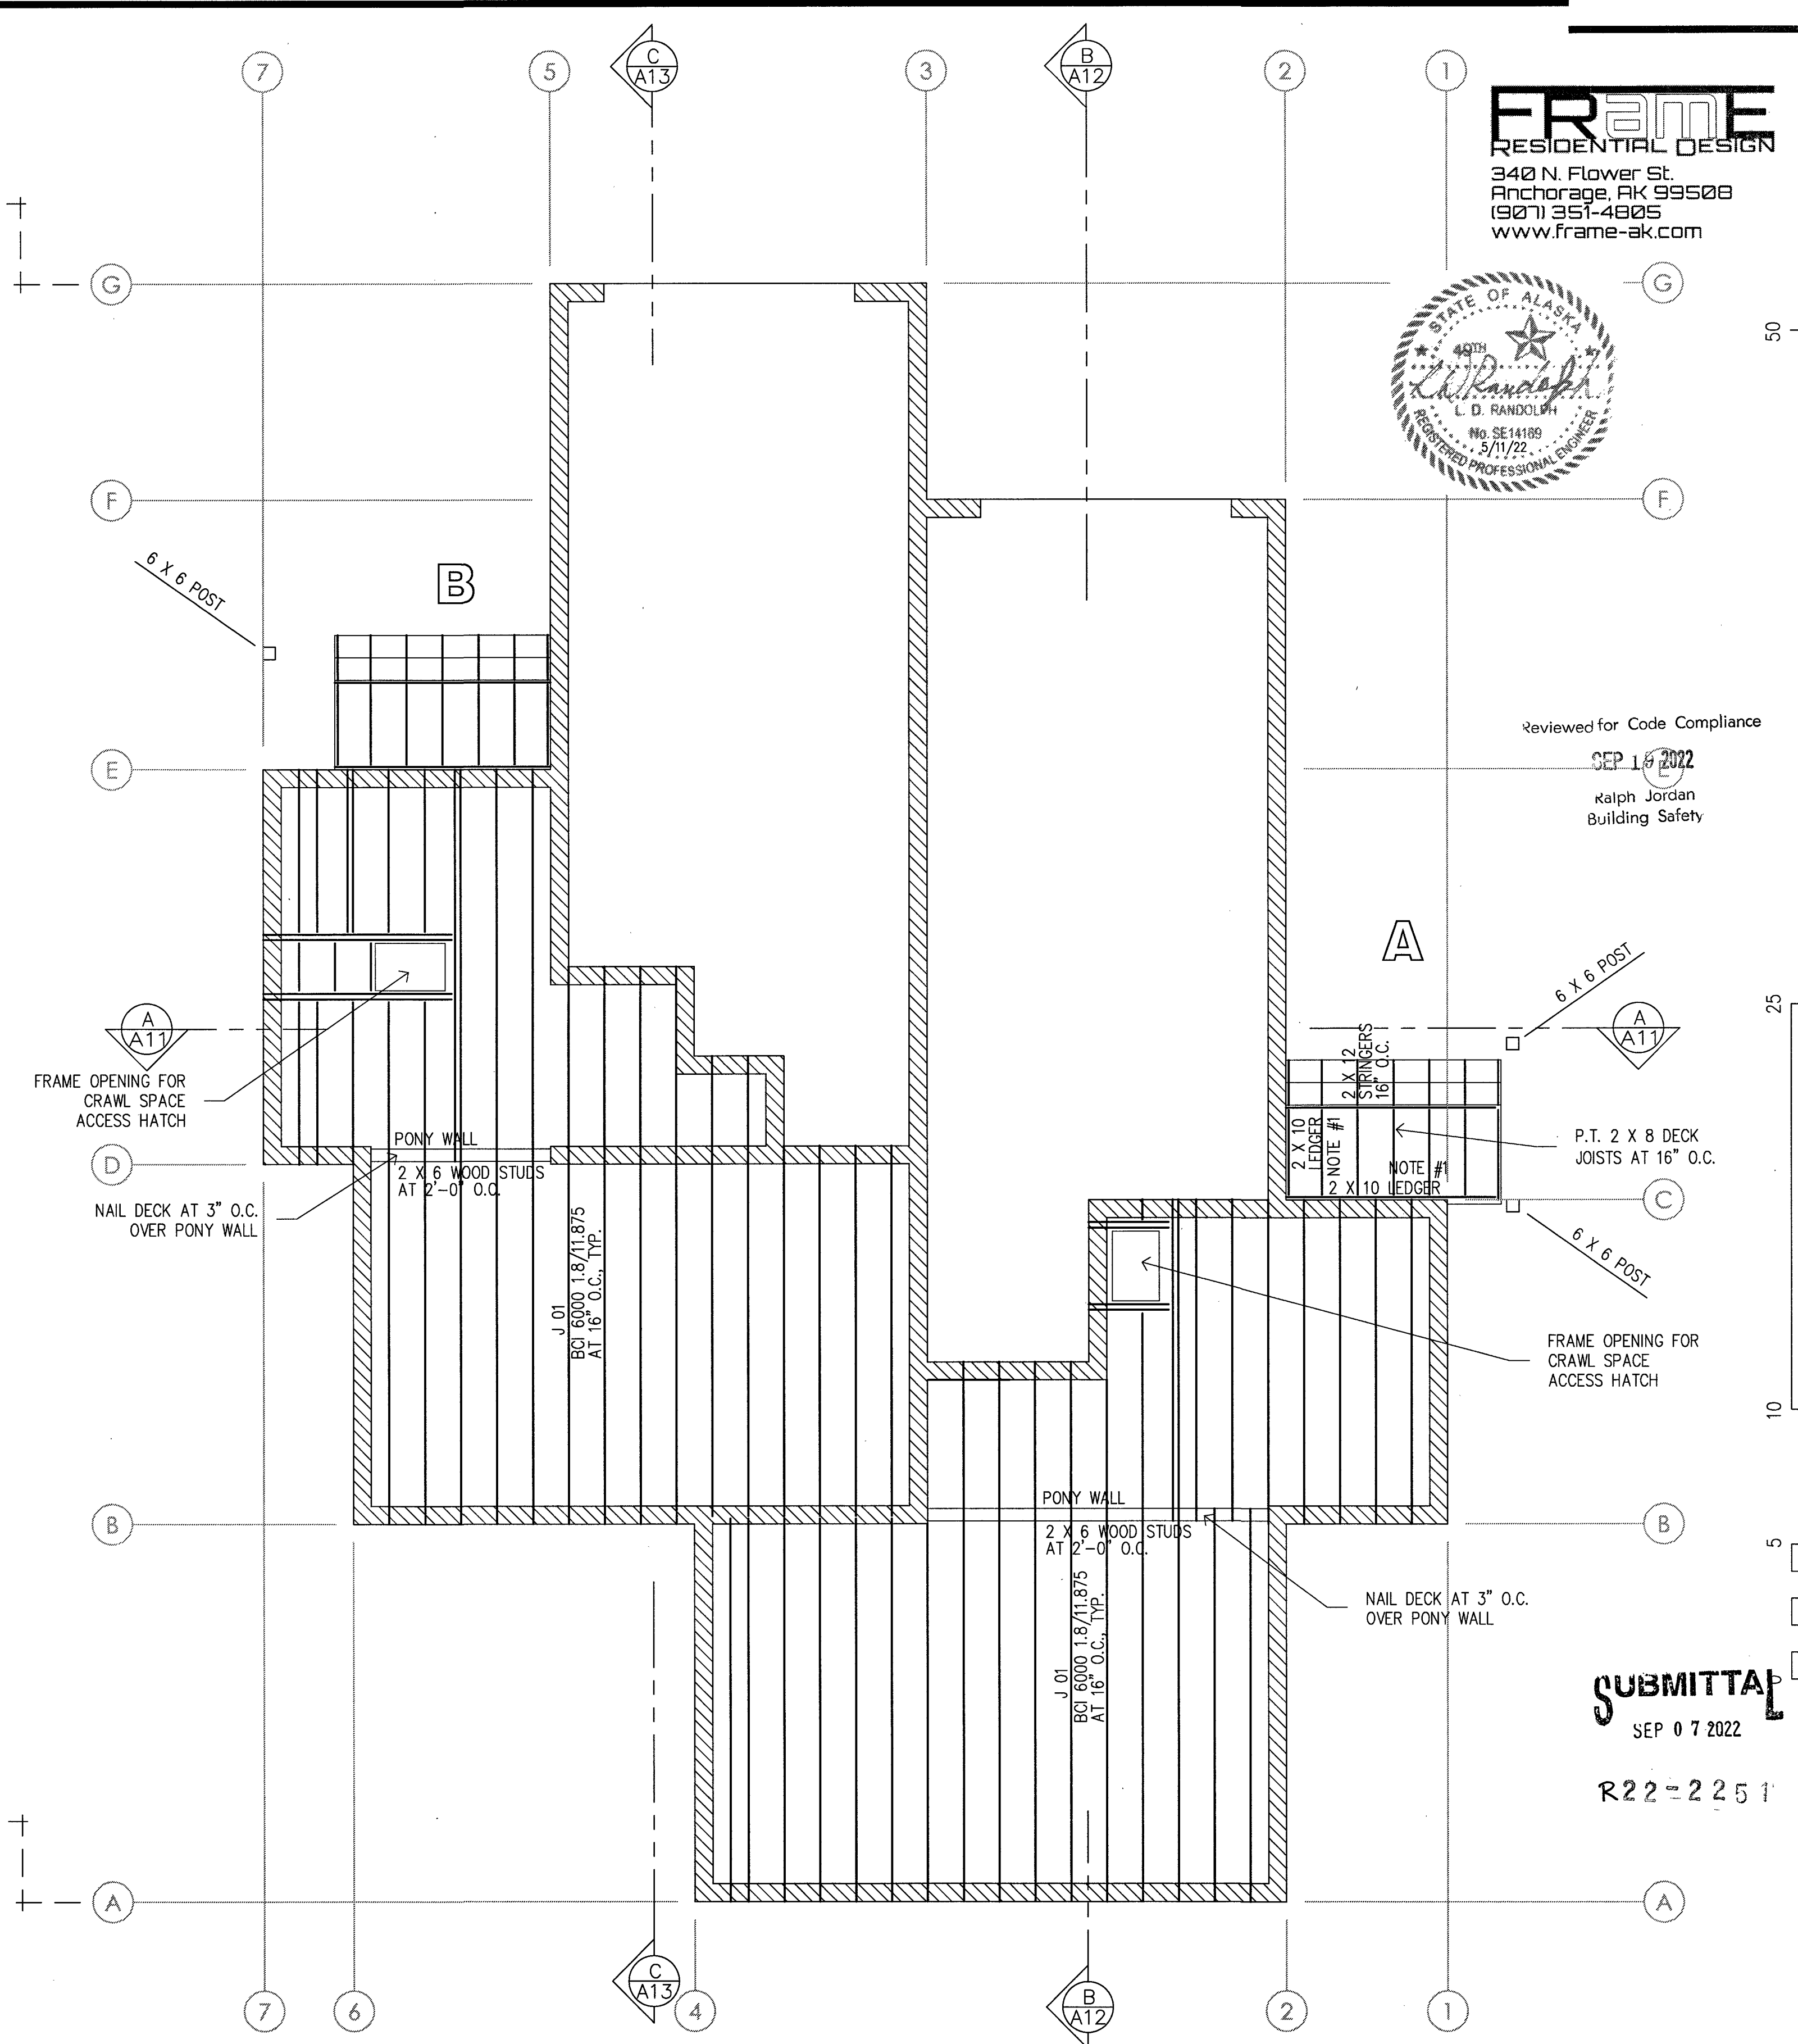

First Floor Framing Plan



**COOK INLET HOUSING AUTHORITY**  
**WILSHIRE AVE. DUPLEX**  
Lot 4, Spenard East subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

8/29/22  
DR. BY: CLARK  
DATE: 18 JUL 22



S2

19 OF 23


**SUBMITTAL**

SEP 07 2022

R22-2251

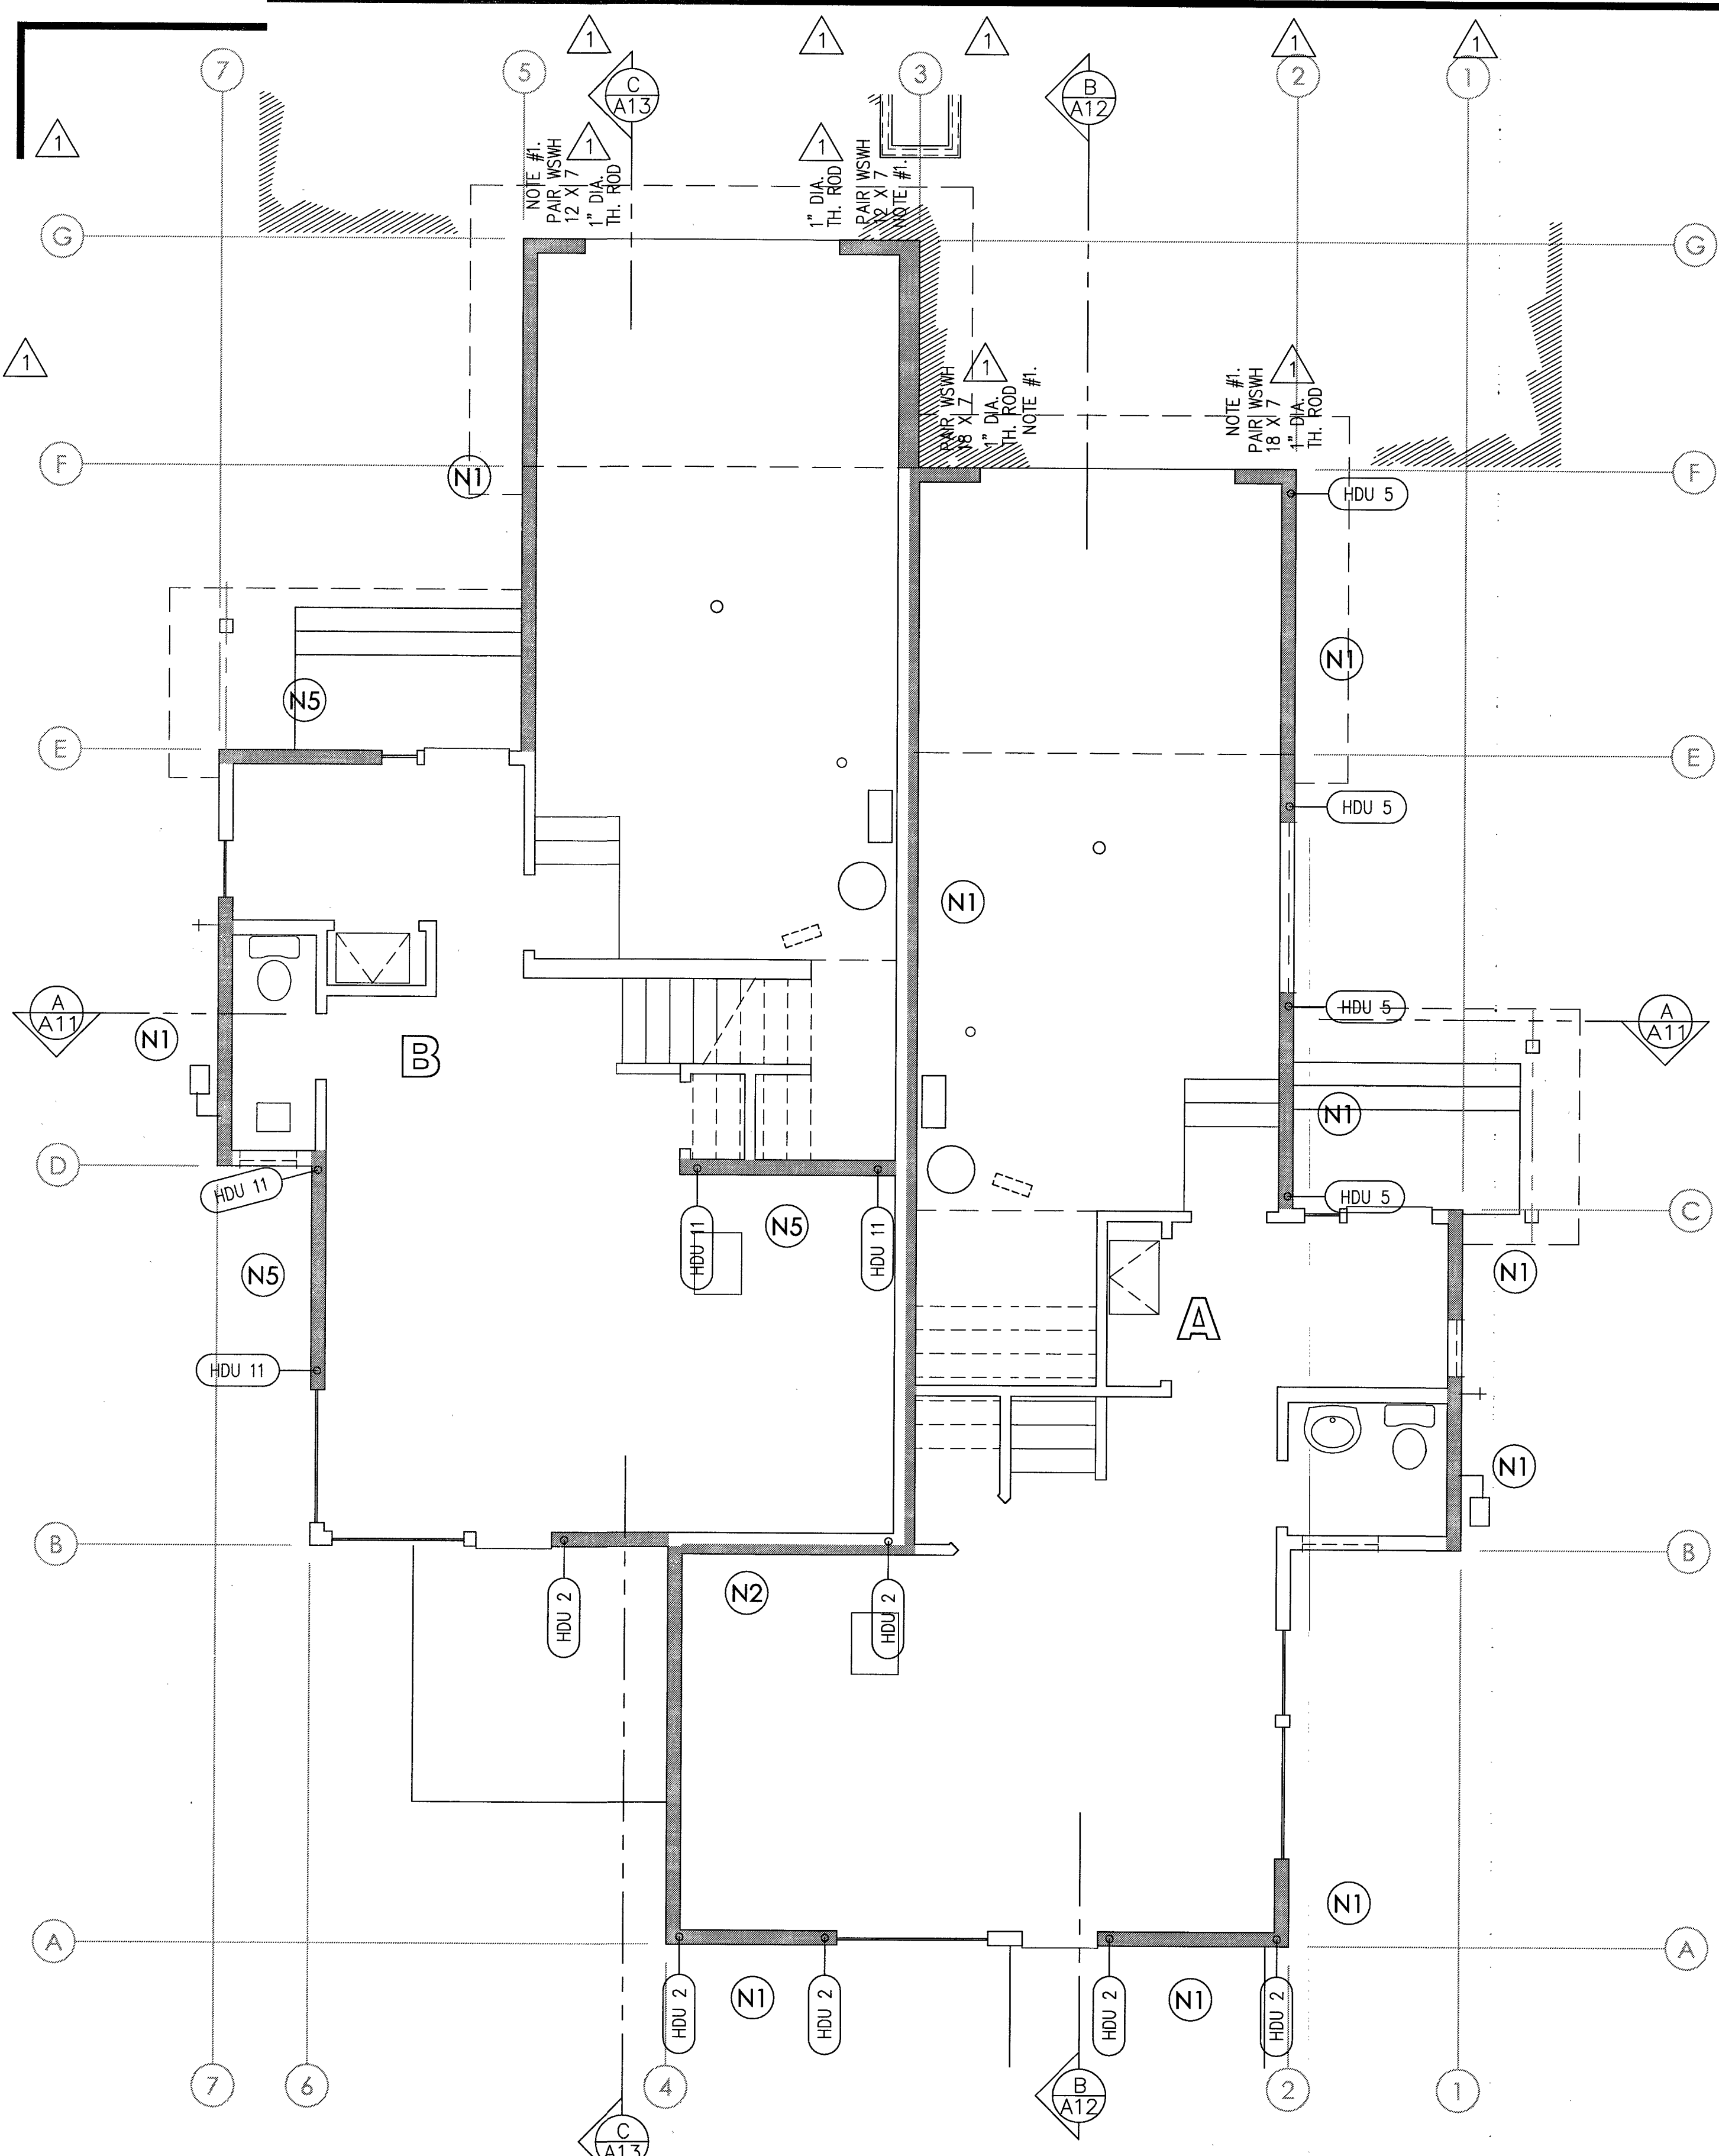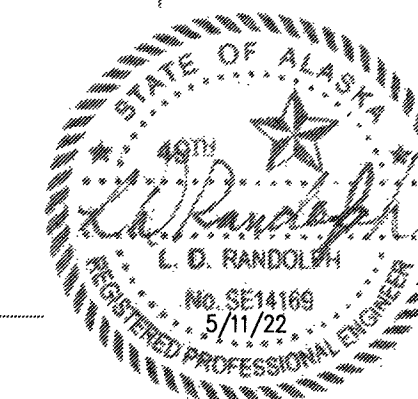

**First Floor  
Shear Wall Plan**

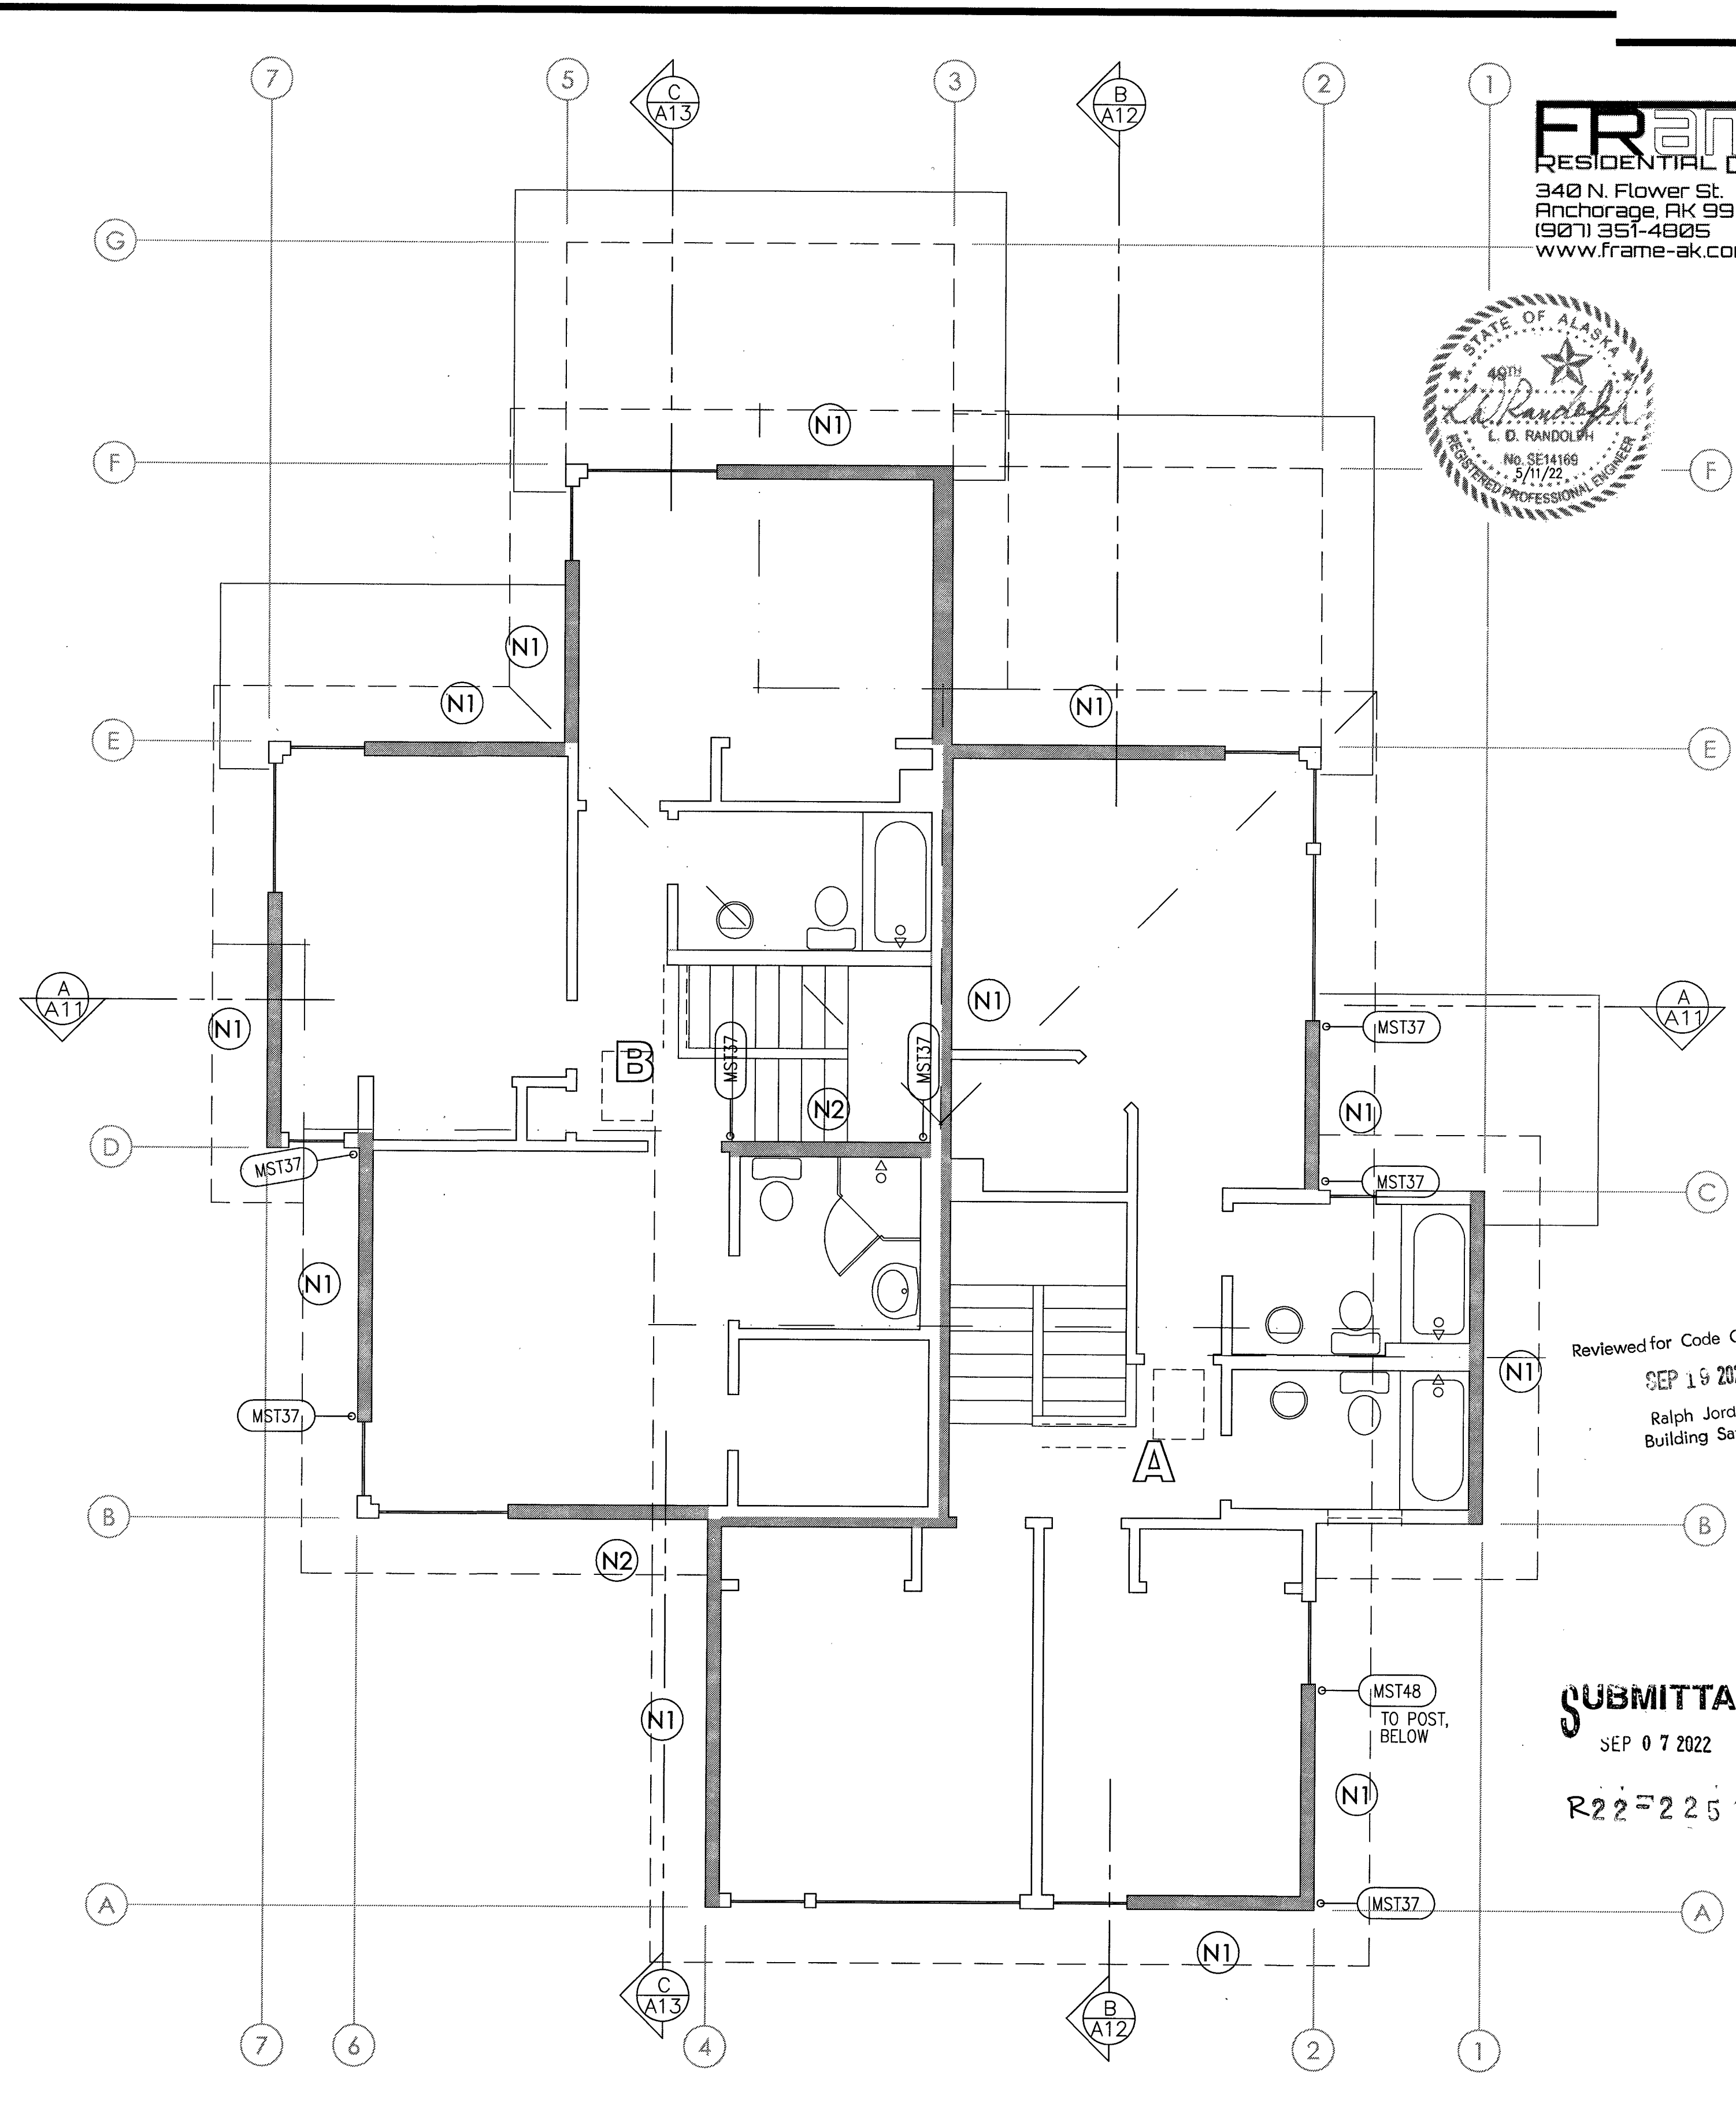


**Second Floor  
Shear Wall Plan**

**NOTE**  
1. WSWH INSTALLATION SHALL BE AS PER SIMPSON STRONG WALL SHEAR WALL CATALOG C-L-SW21, TO INCLUDE WSWH-PS STRAPS AND WSWH-TP TOP SHEAR CONNECTOR.

Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety

**SUBMITTAL**  
SEP 07 2022

R22-2251





**COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX**  
lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

8/26/22  
DR. BY: CLARK  
DATE: 18 JUL 22


**S3**

20 of 23

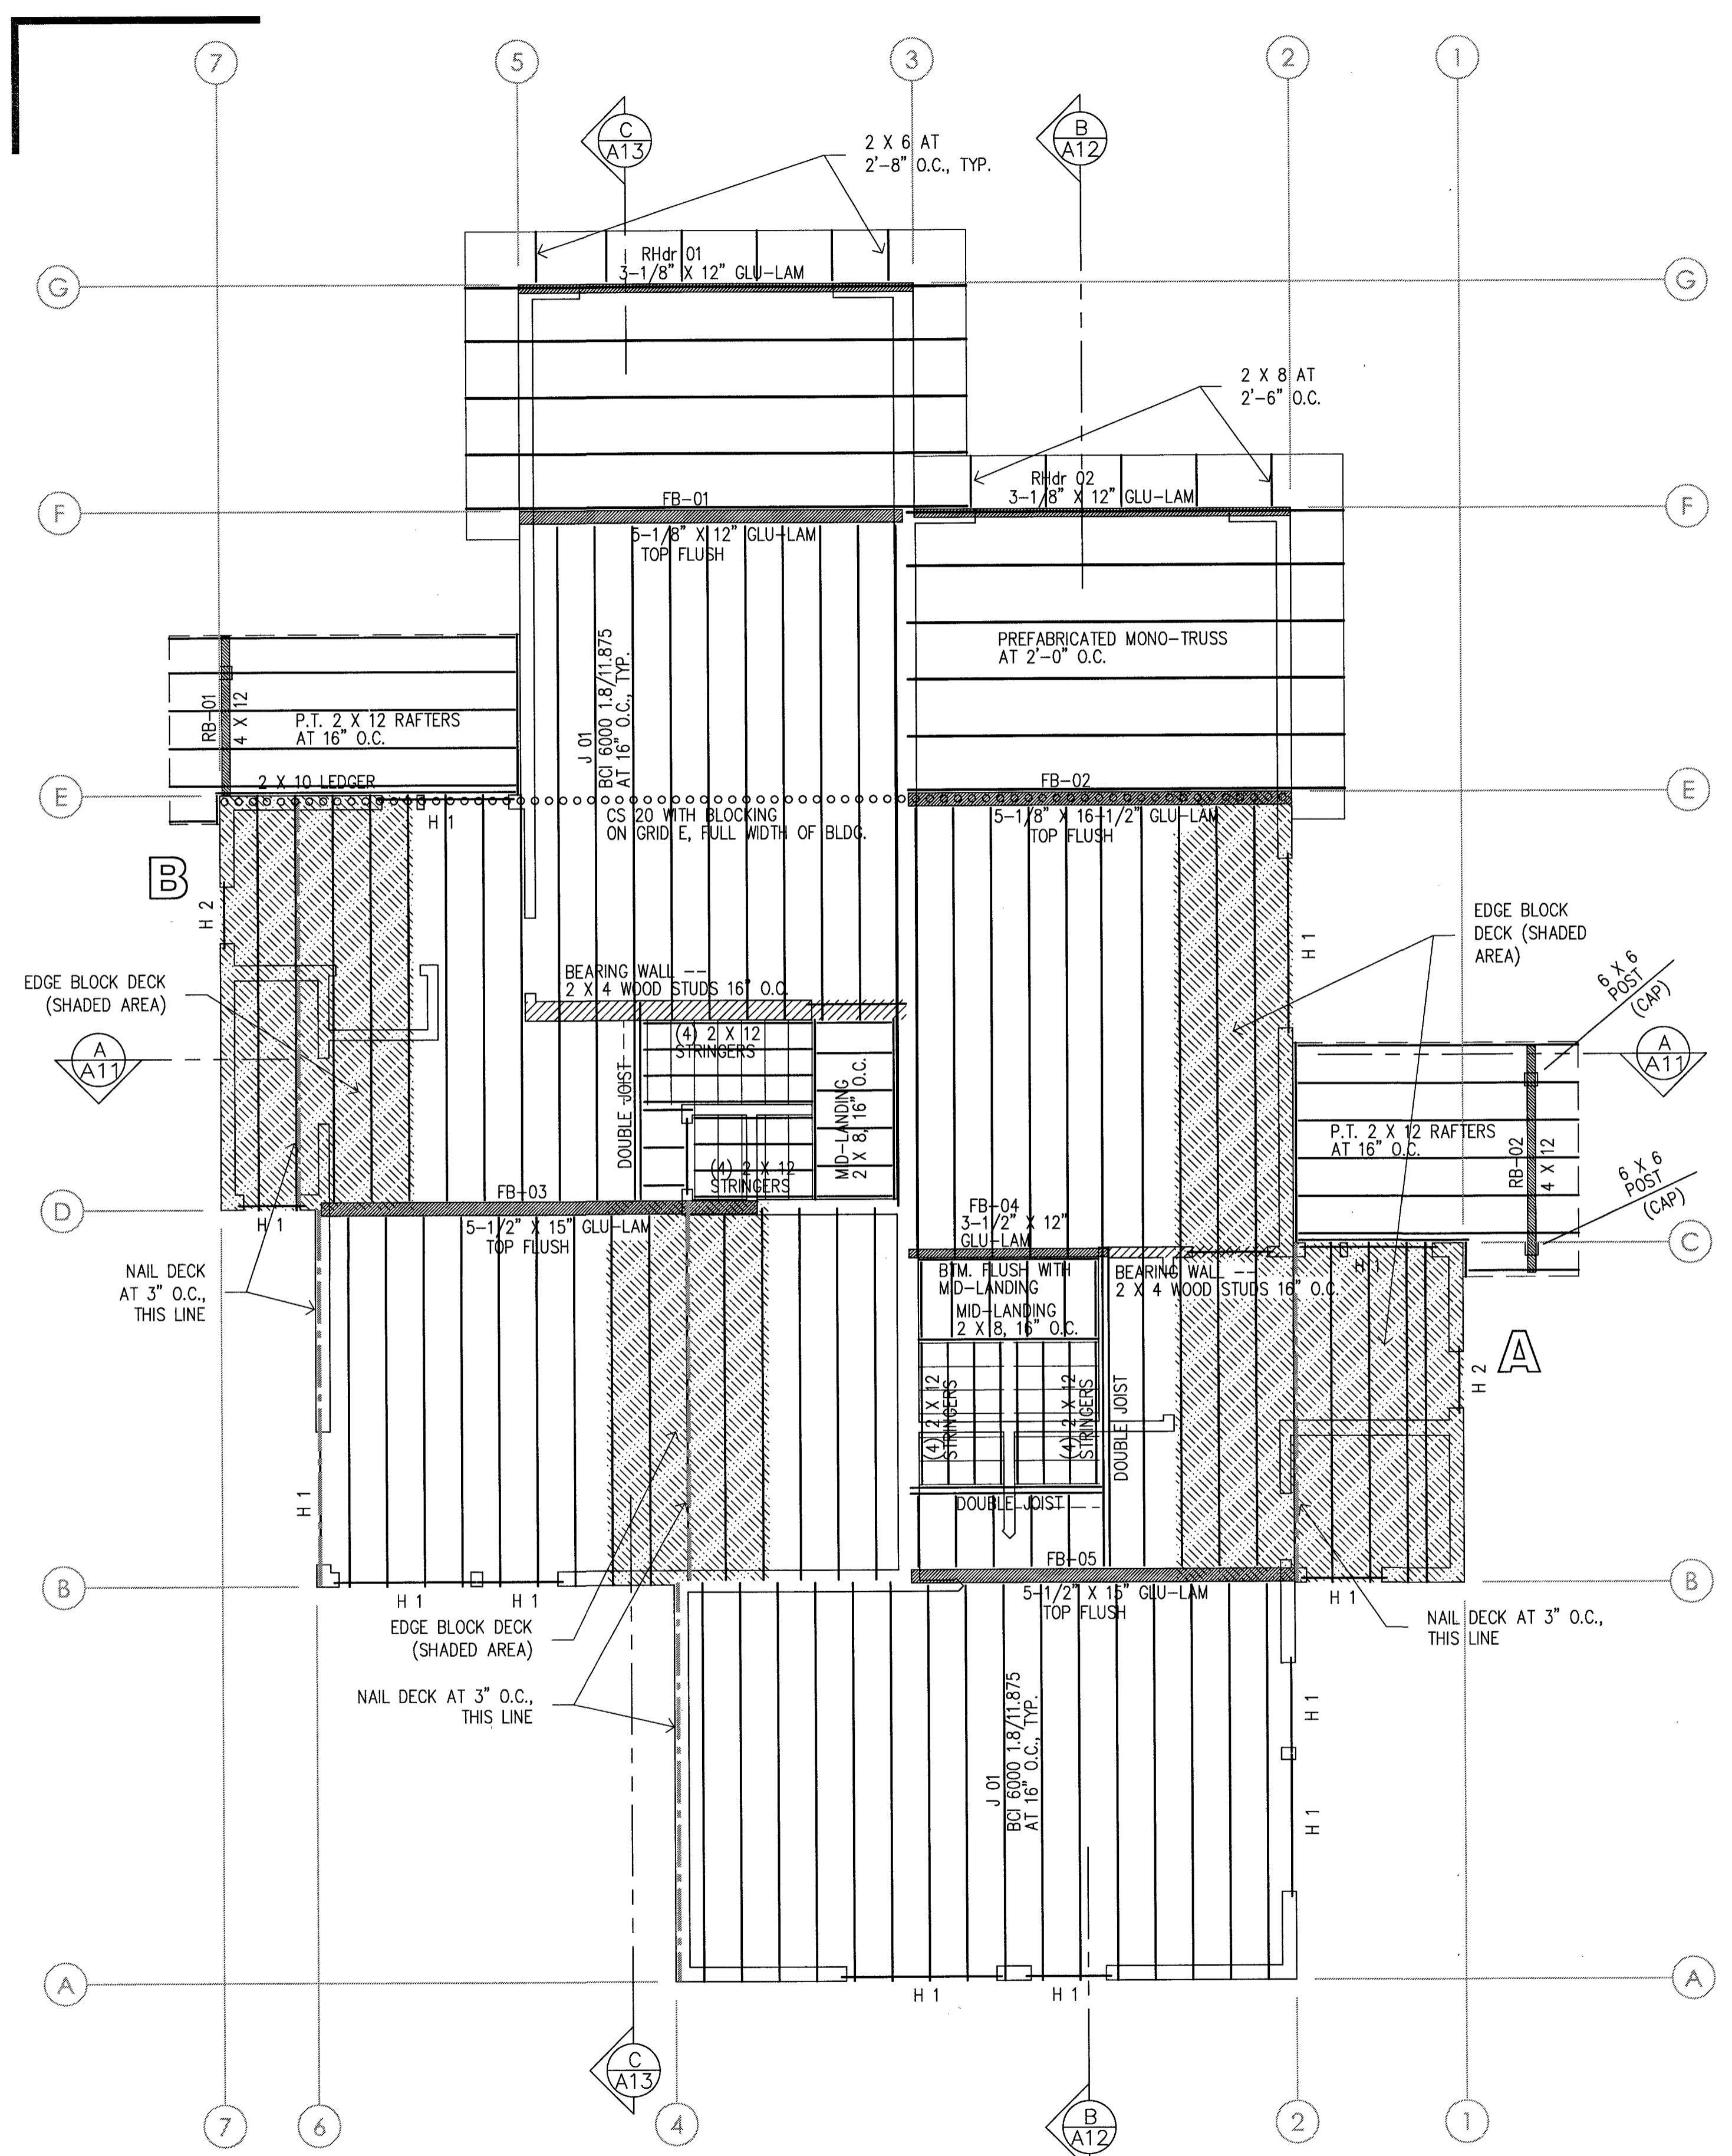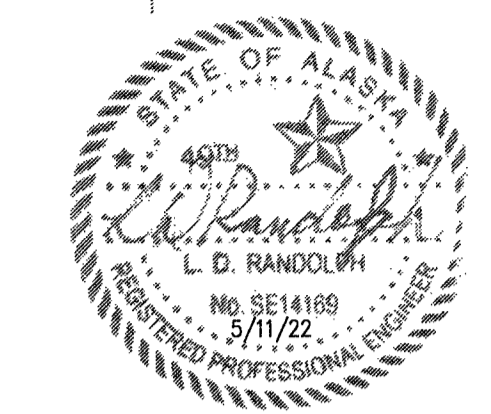


**Second Floor/Low Roof Framing Plan**

**LEGEND**  
HEADERS  
H1 4 X 12 H.F. NO. 2  
H2 4 X 8 H.F. NO. 2

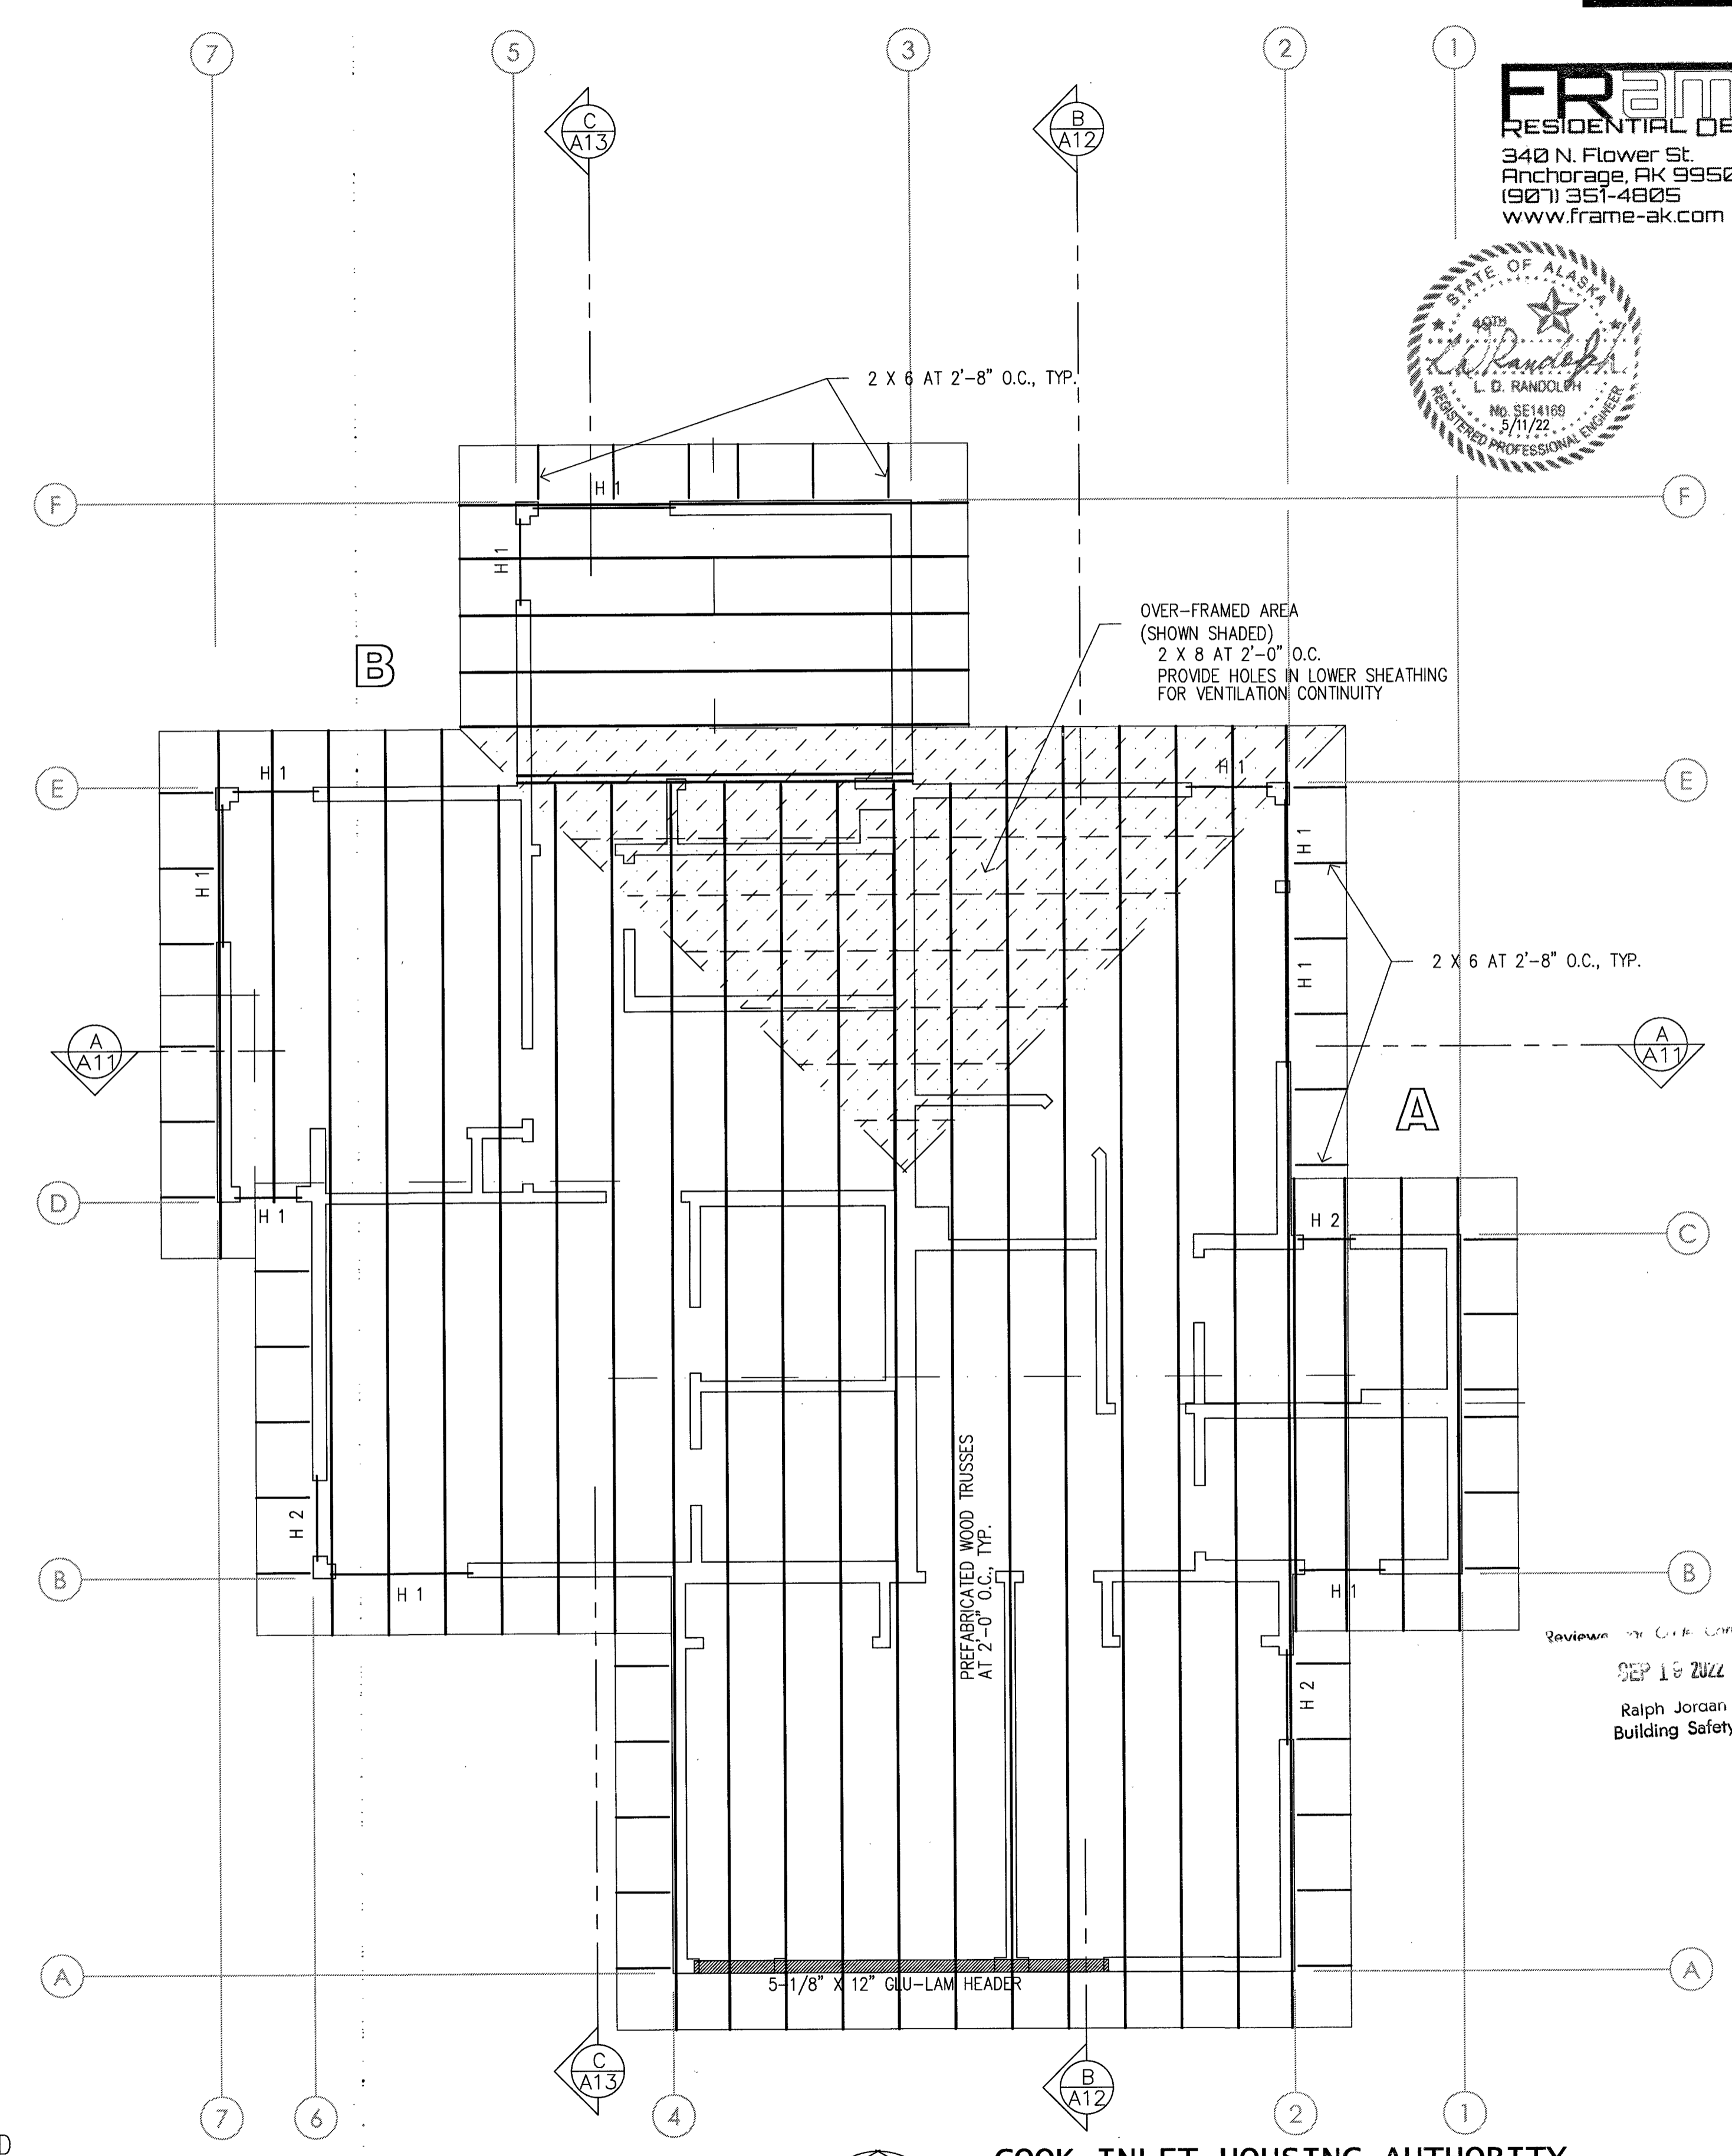


**High Roof Framing Plan**




**COOK INLET HOUSING AUTHORITY**  
**WILSHIRE AVE. DUPLEX**  
Lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA

DR. BY: CLARK  
DATE: 18 JUL 22

Reviewed by: CLARK, 11/15/22  
SEP 18 2022  
Ralph Jordan  
Building Safety

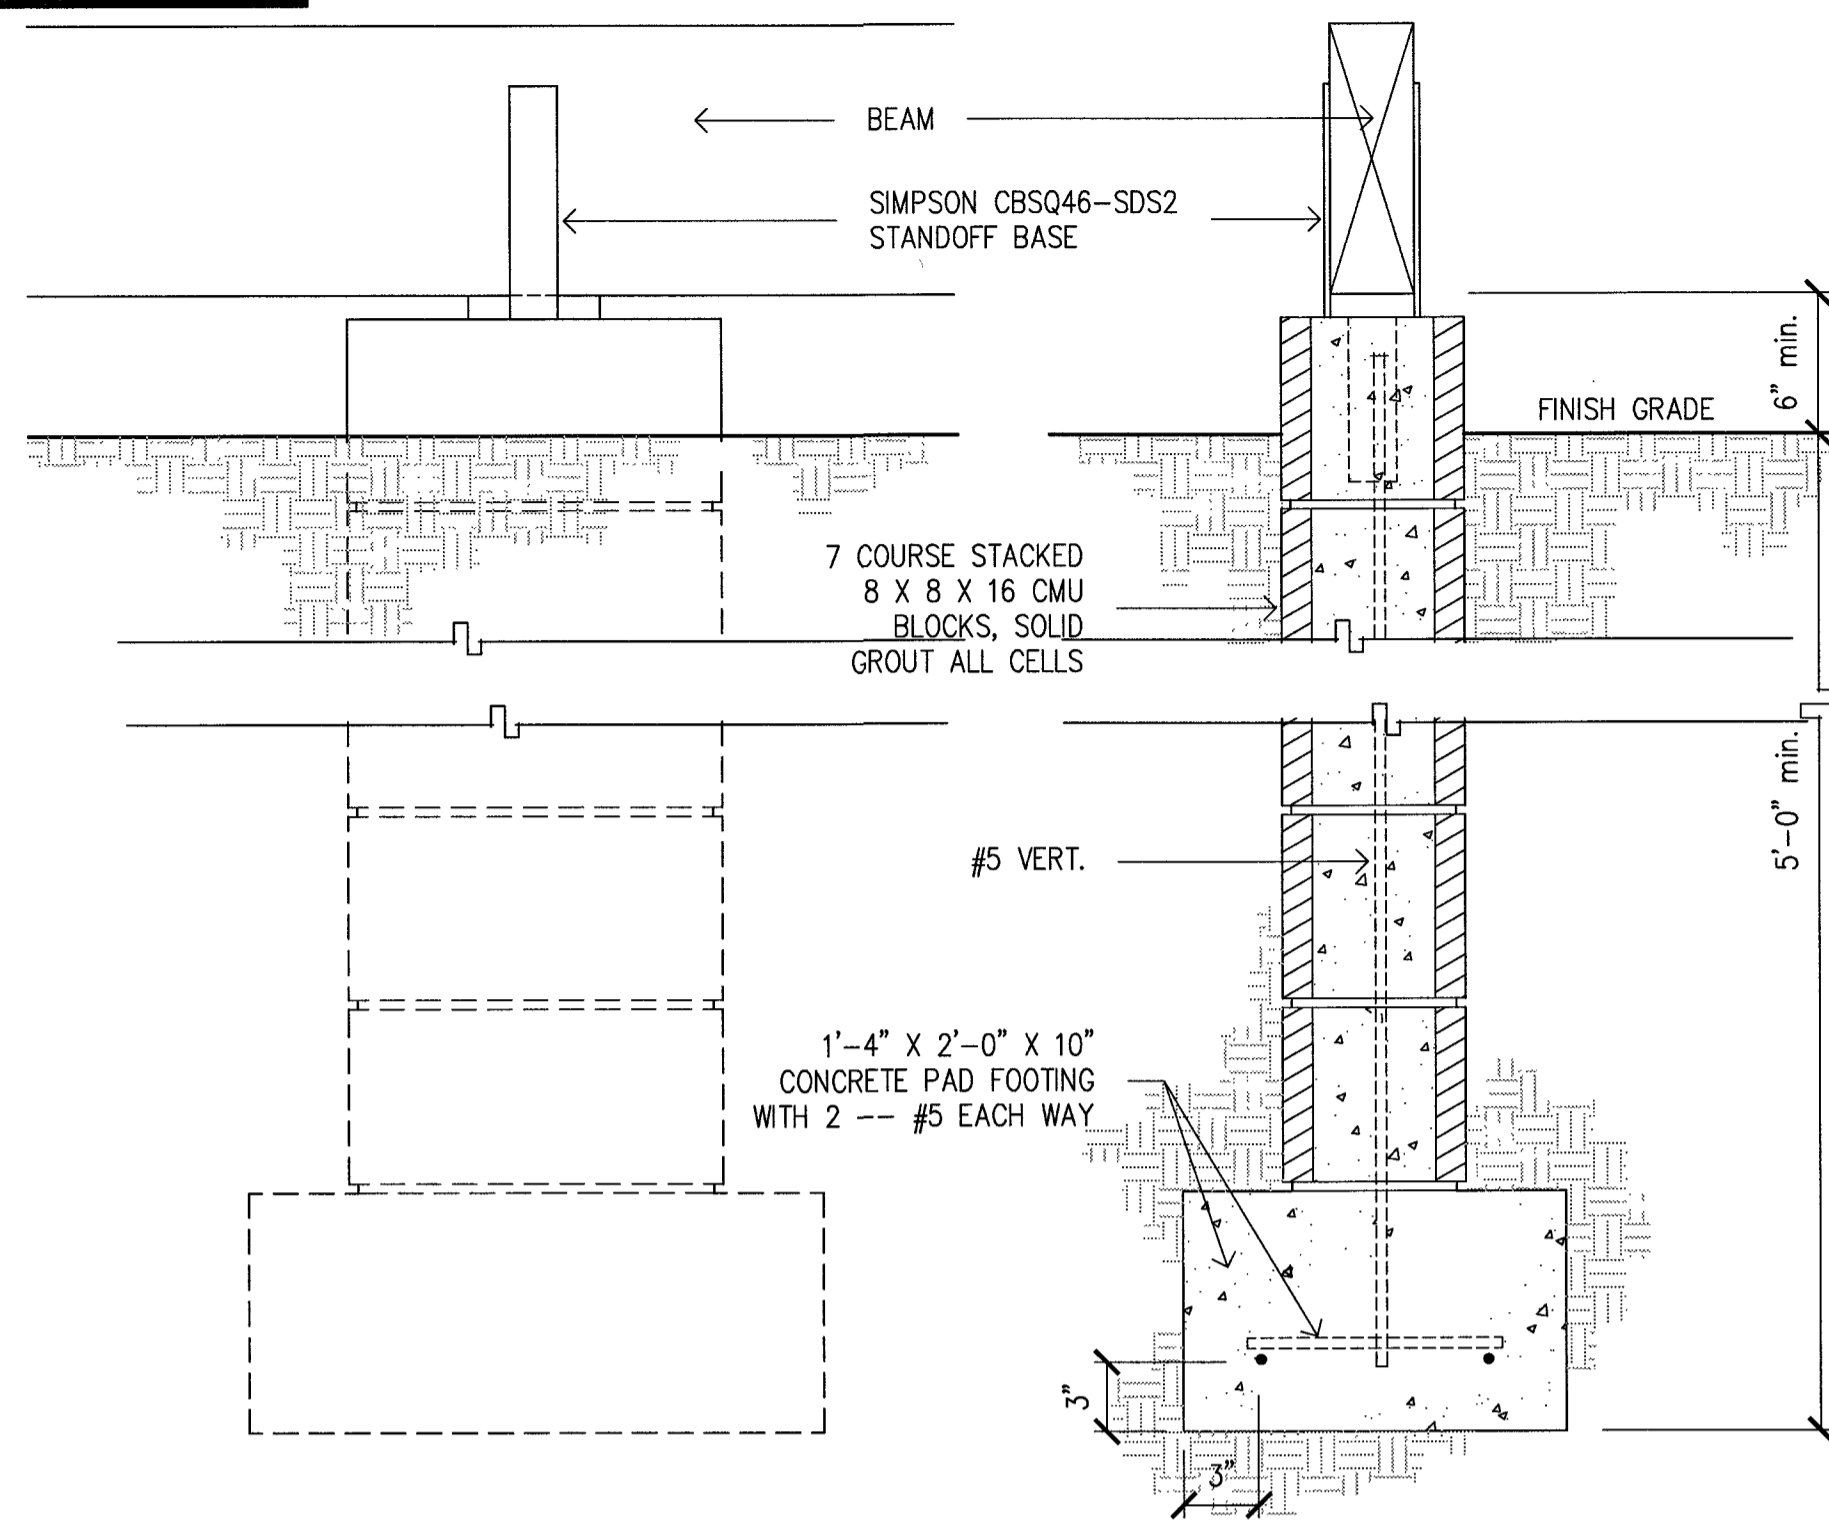

Deck Foundation (10)

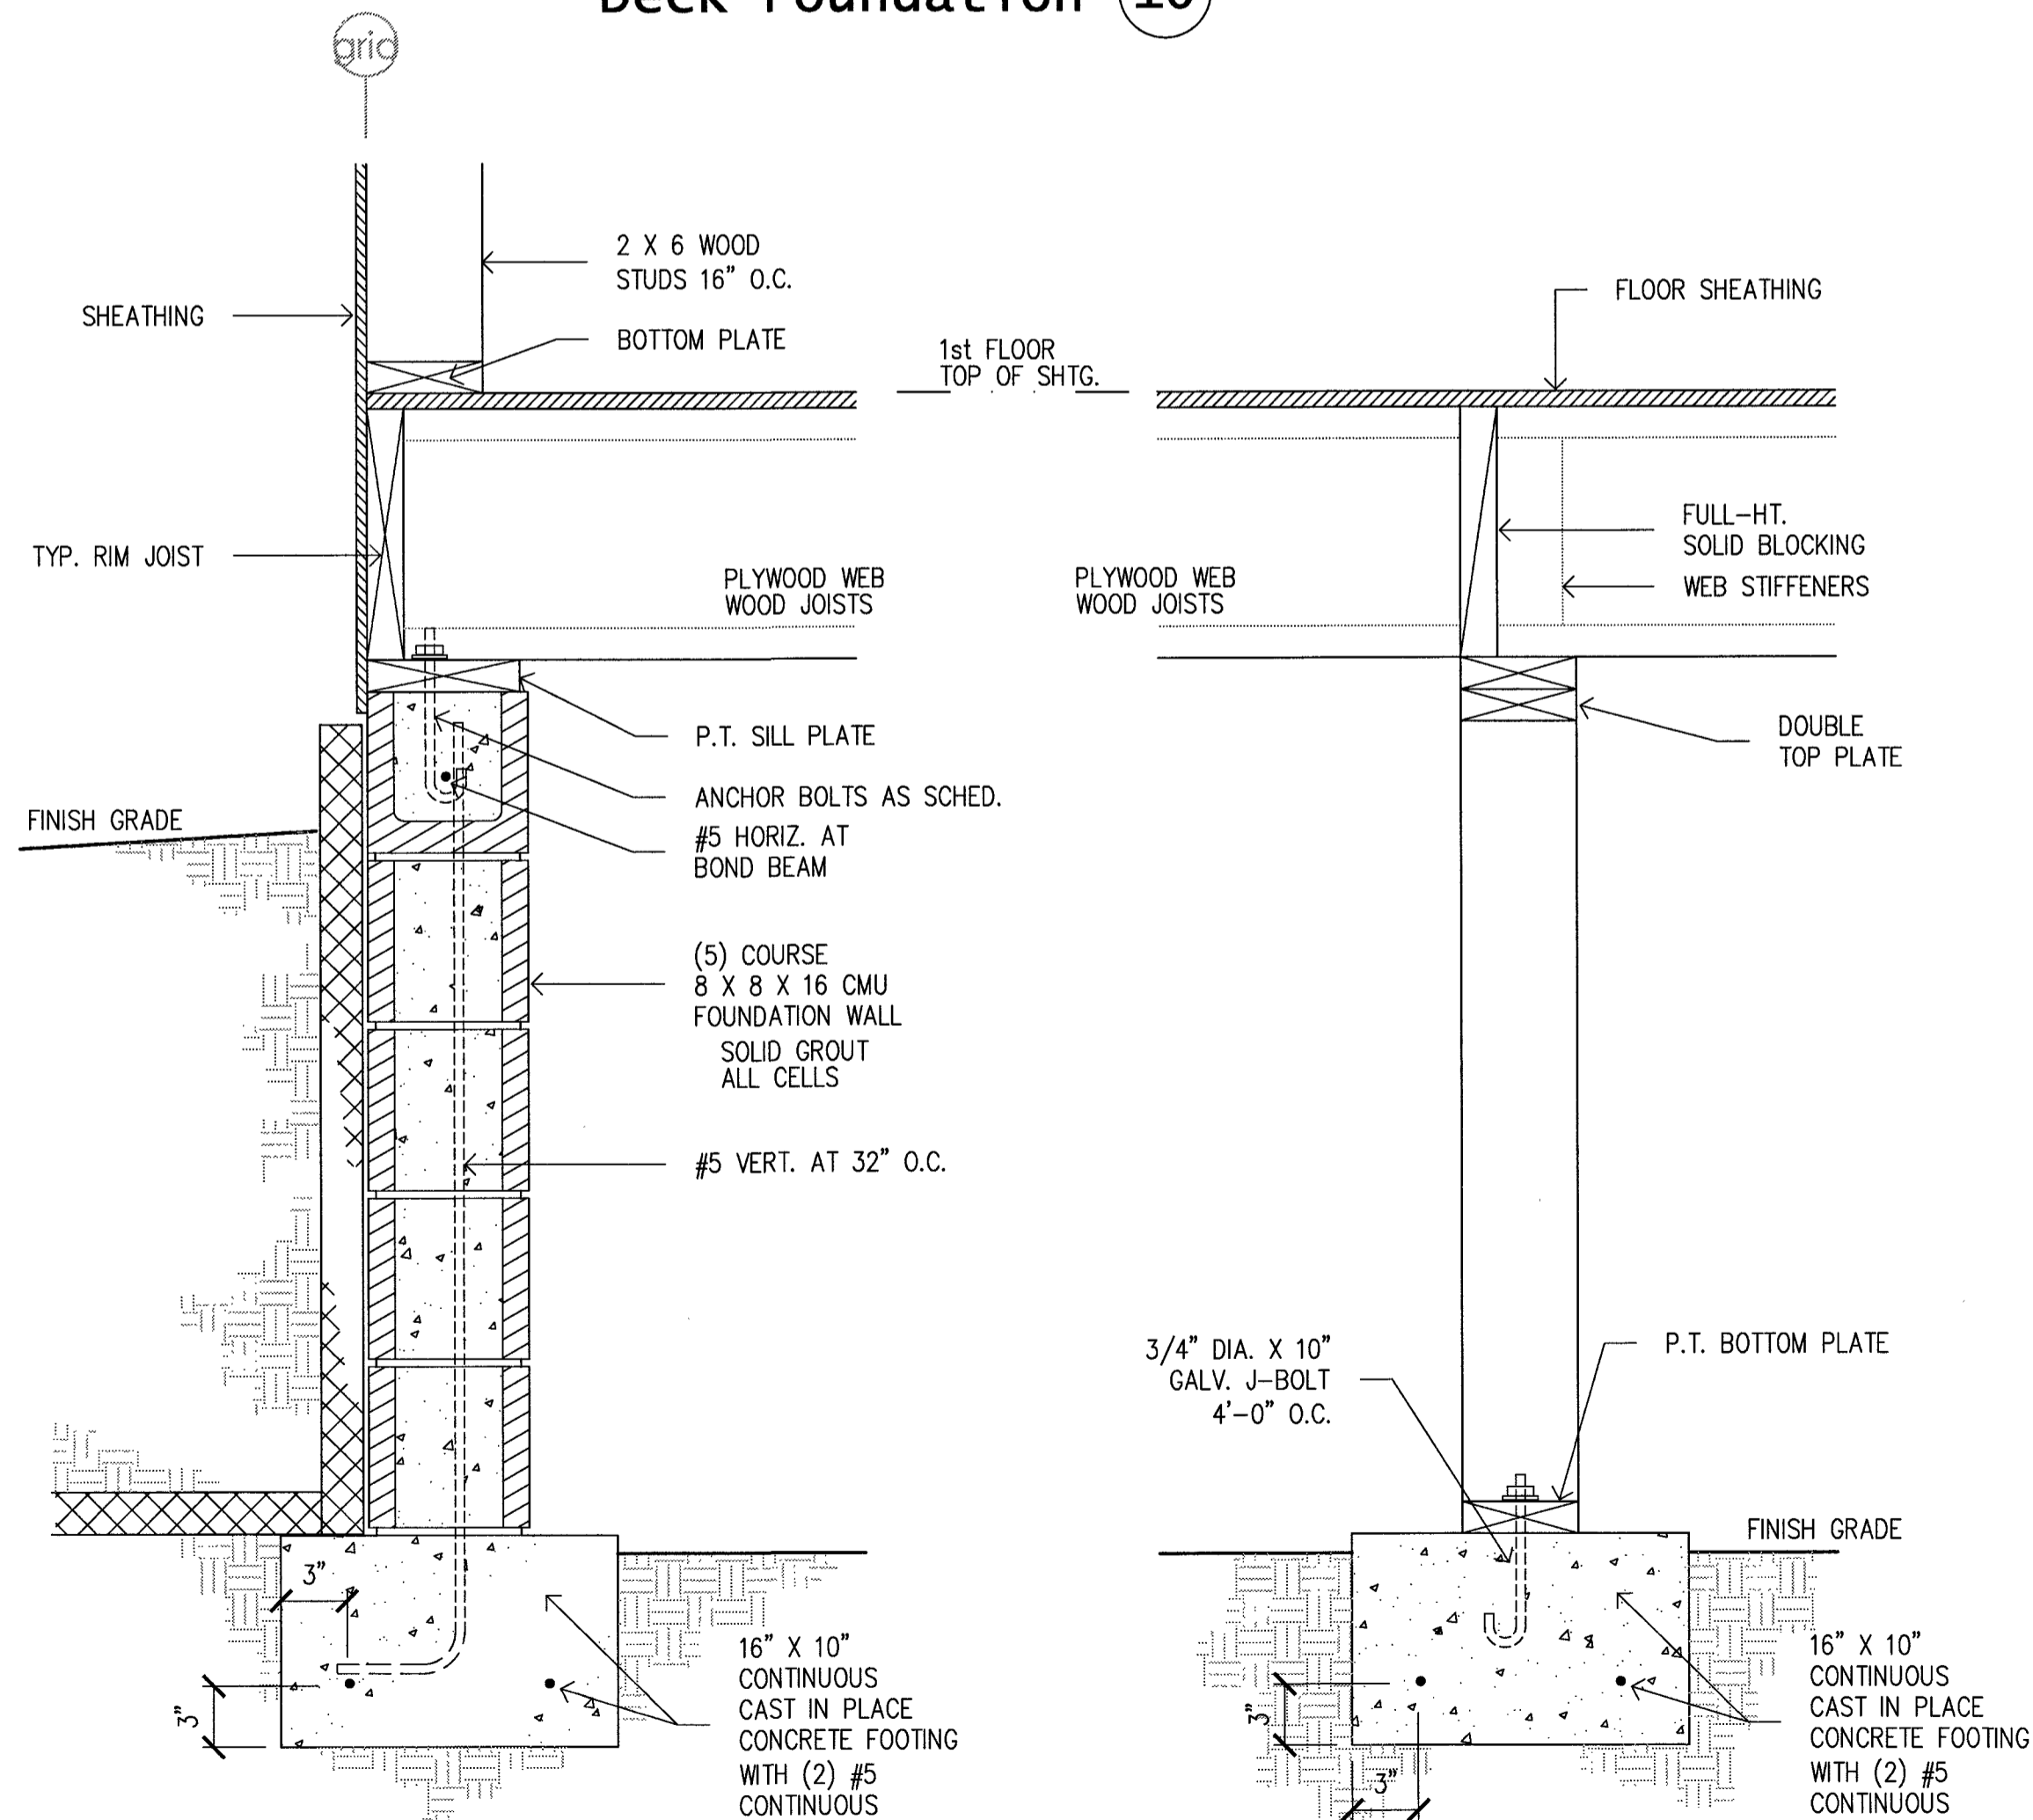


Typical Foundation Wall (9)

SEE DTL 6/A14 FOR  
ADDITIONAL INFORMATION

Typical Pony Wall (7)

SEE DTL 4/A14 FOR  
ADDITIONAL INFORMATION

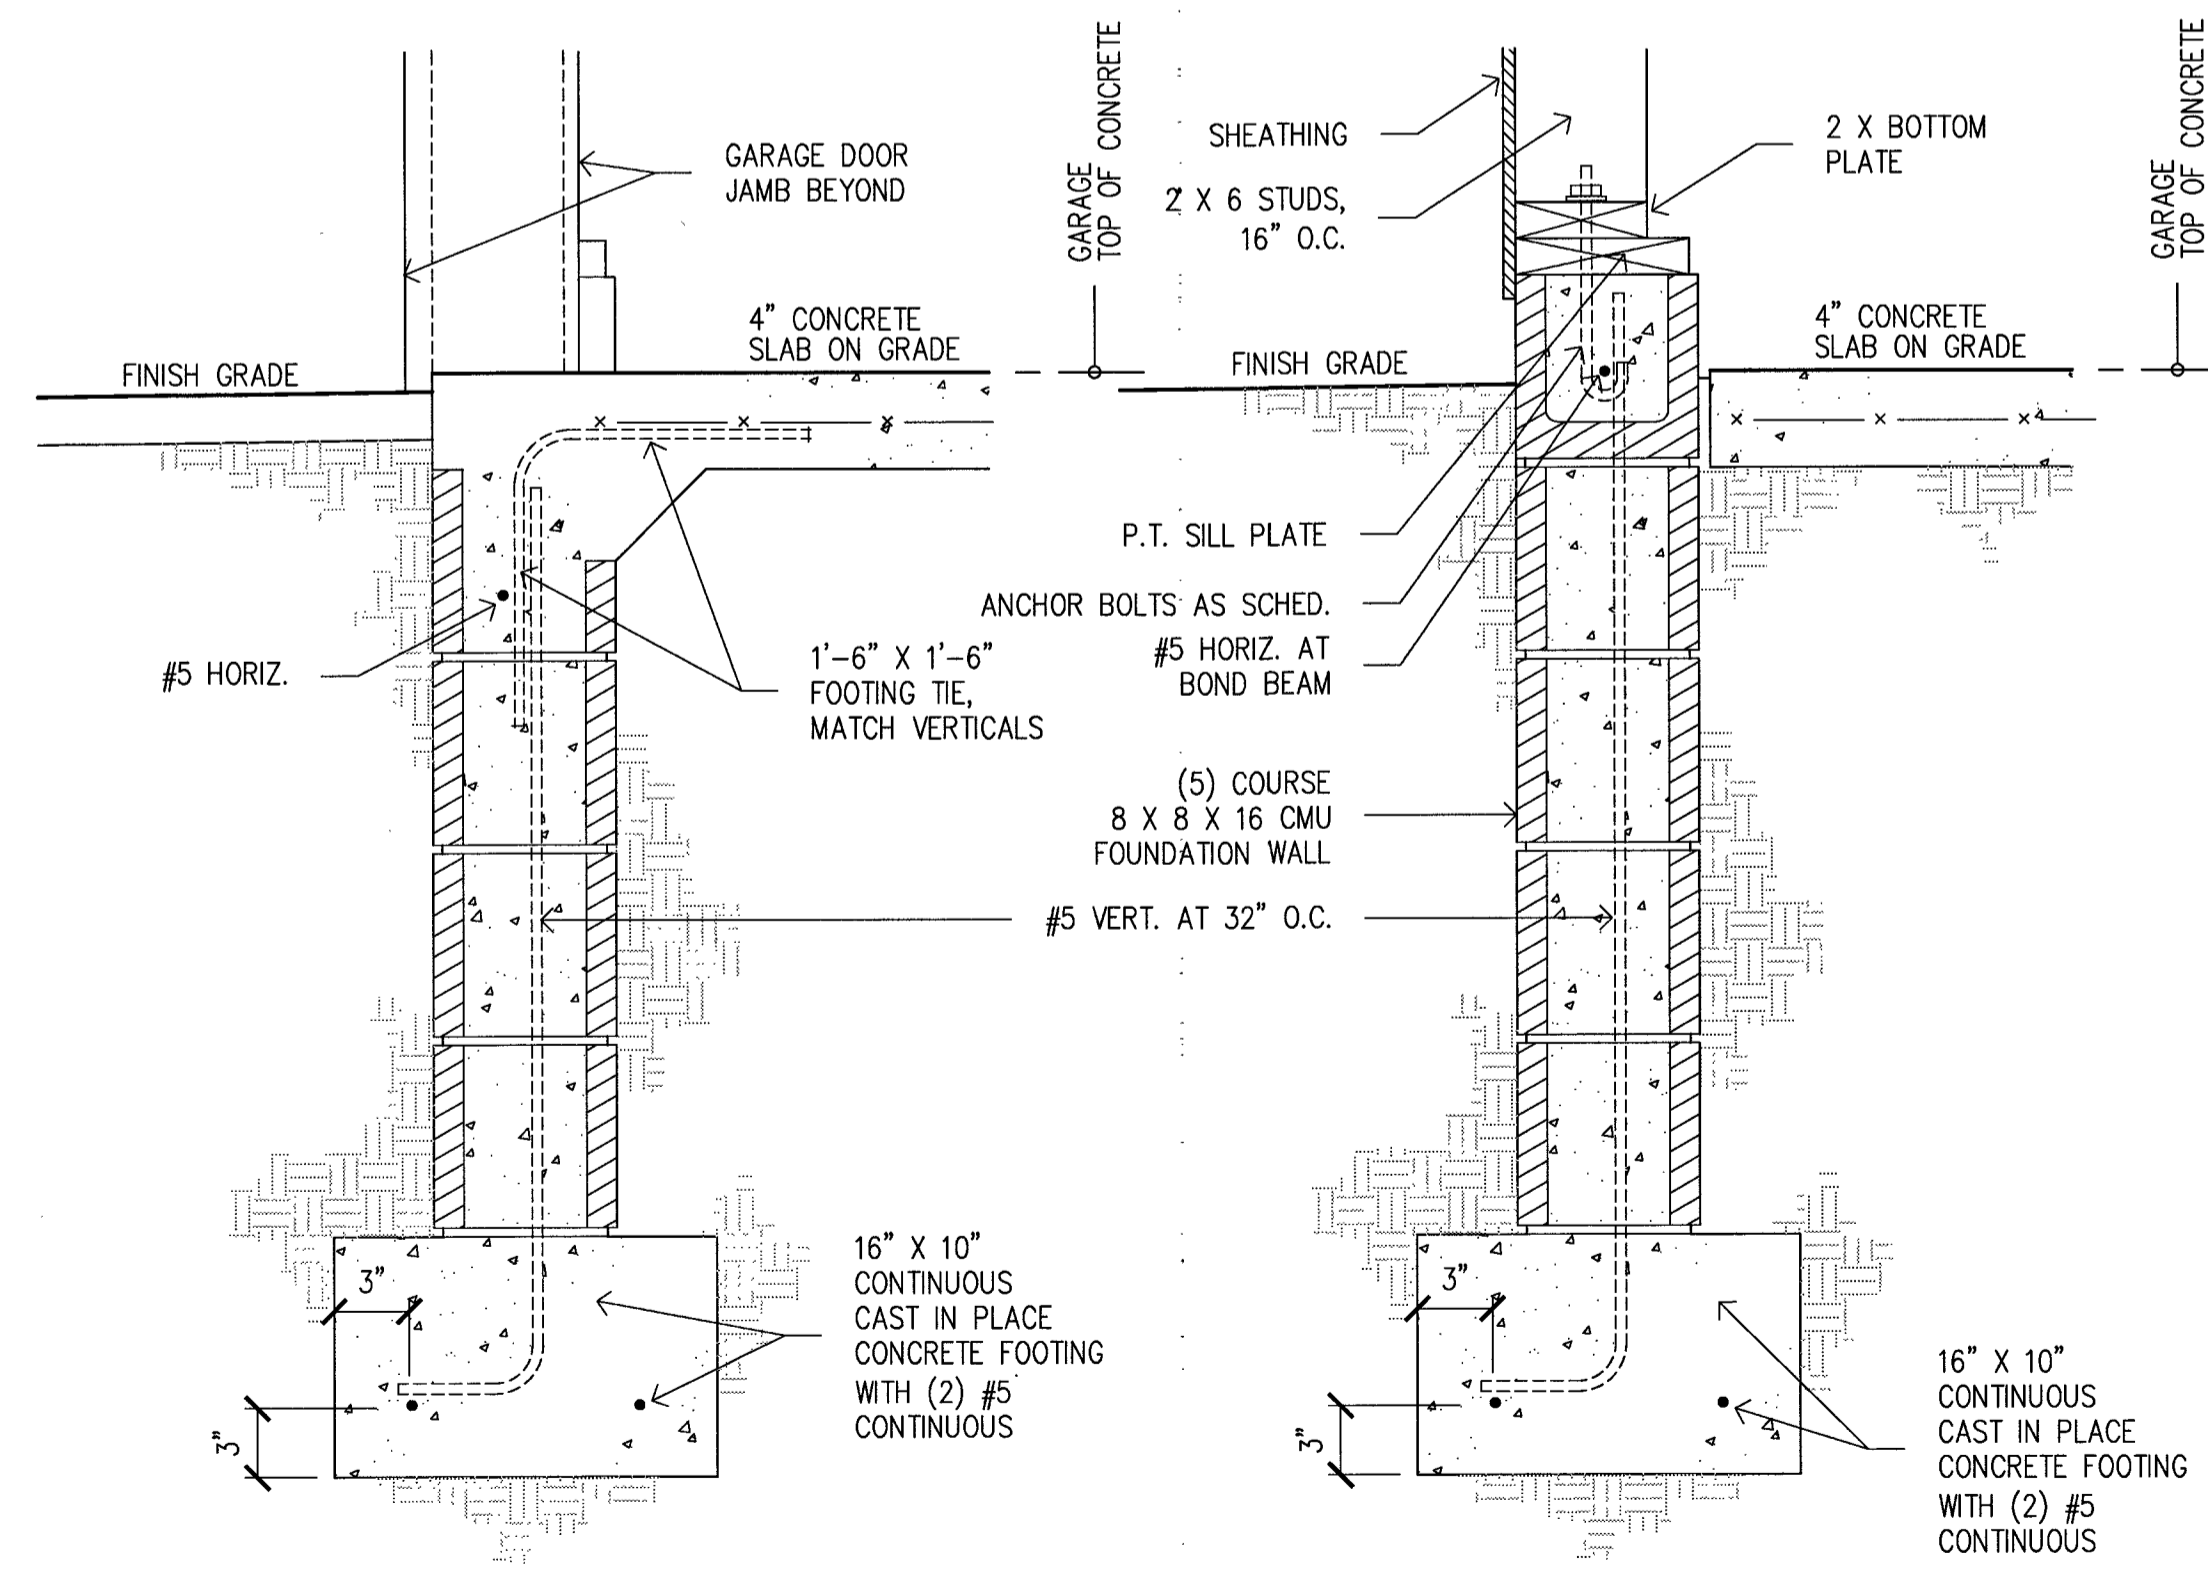

Foundation at Garage Door (5)

SEE DTL 3/A14 FOR  
ADDITIONAL INFORMATION

Foundation at Garage (3)

SEE DTL 1/A14 FOR  
ADDITIONAL INFORMATION

Reviewed for Code Compliance

SEP 16 2022



Ralph Jordan  
Building Safety

COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
lot 4, Spenard East Subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA


DR. BY: CLARK  
DATE: 18 JUL 22

S5


22 OF 23

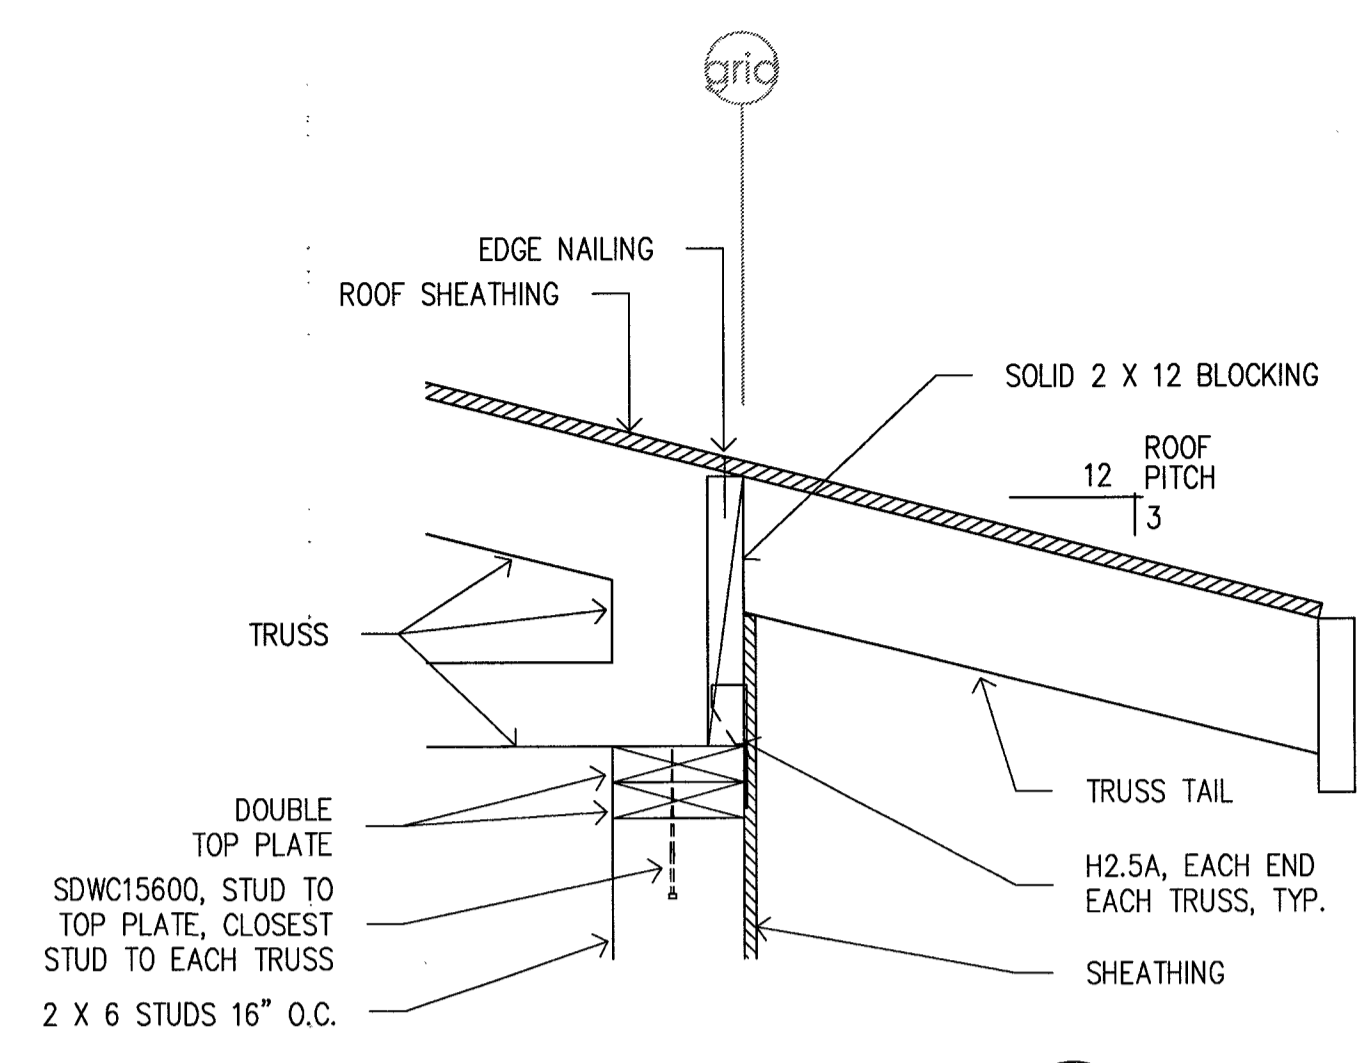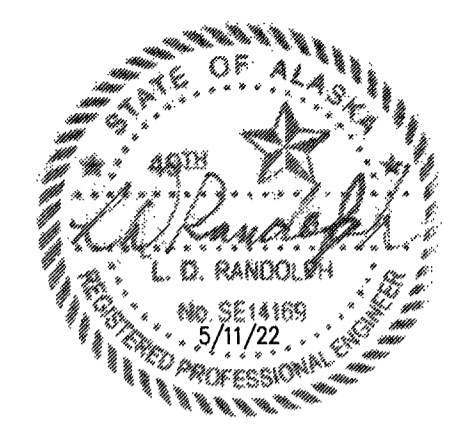


**Typical Eave 6**  
SEE DTL 6/A15 FOR ADDITIONAL INFORMATION

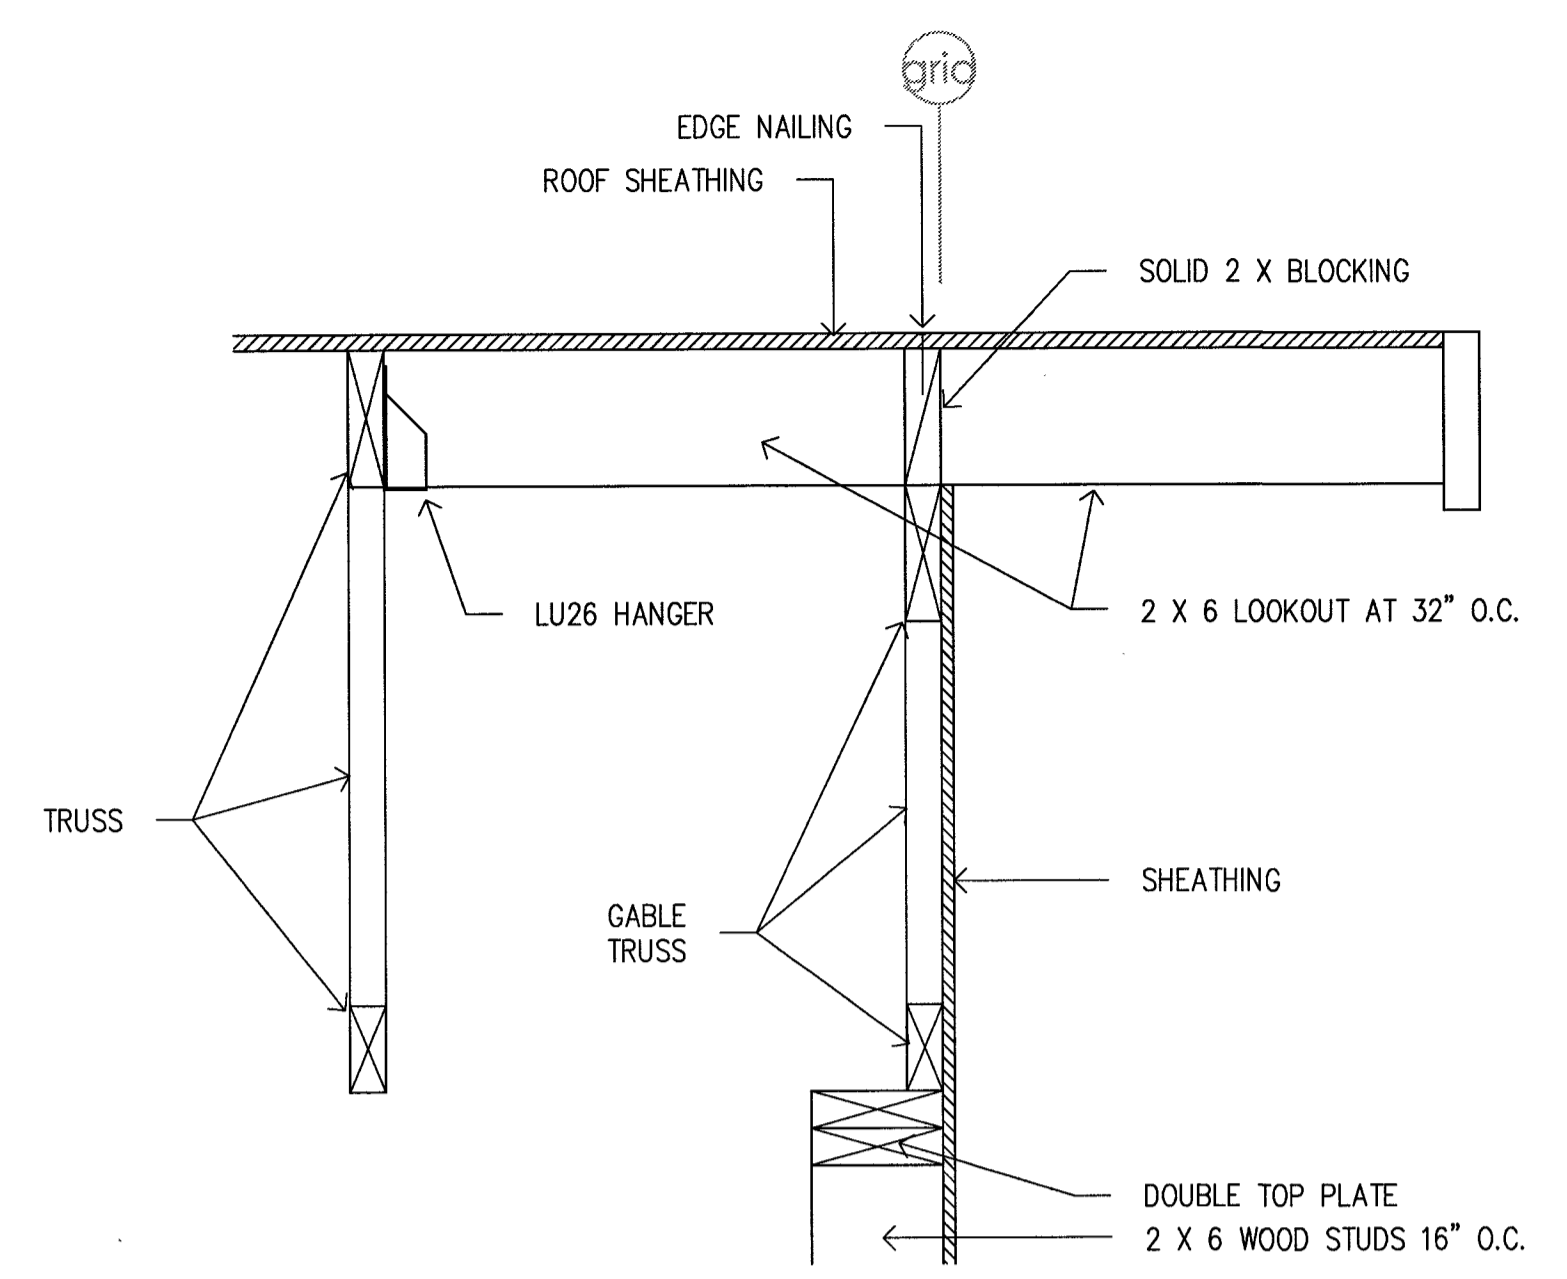


**Typical Rake 3**  
SEE DTL 4/A15 FOR ADDITIONAL INFORMATION

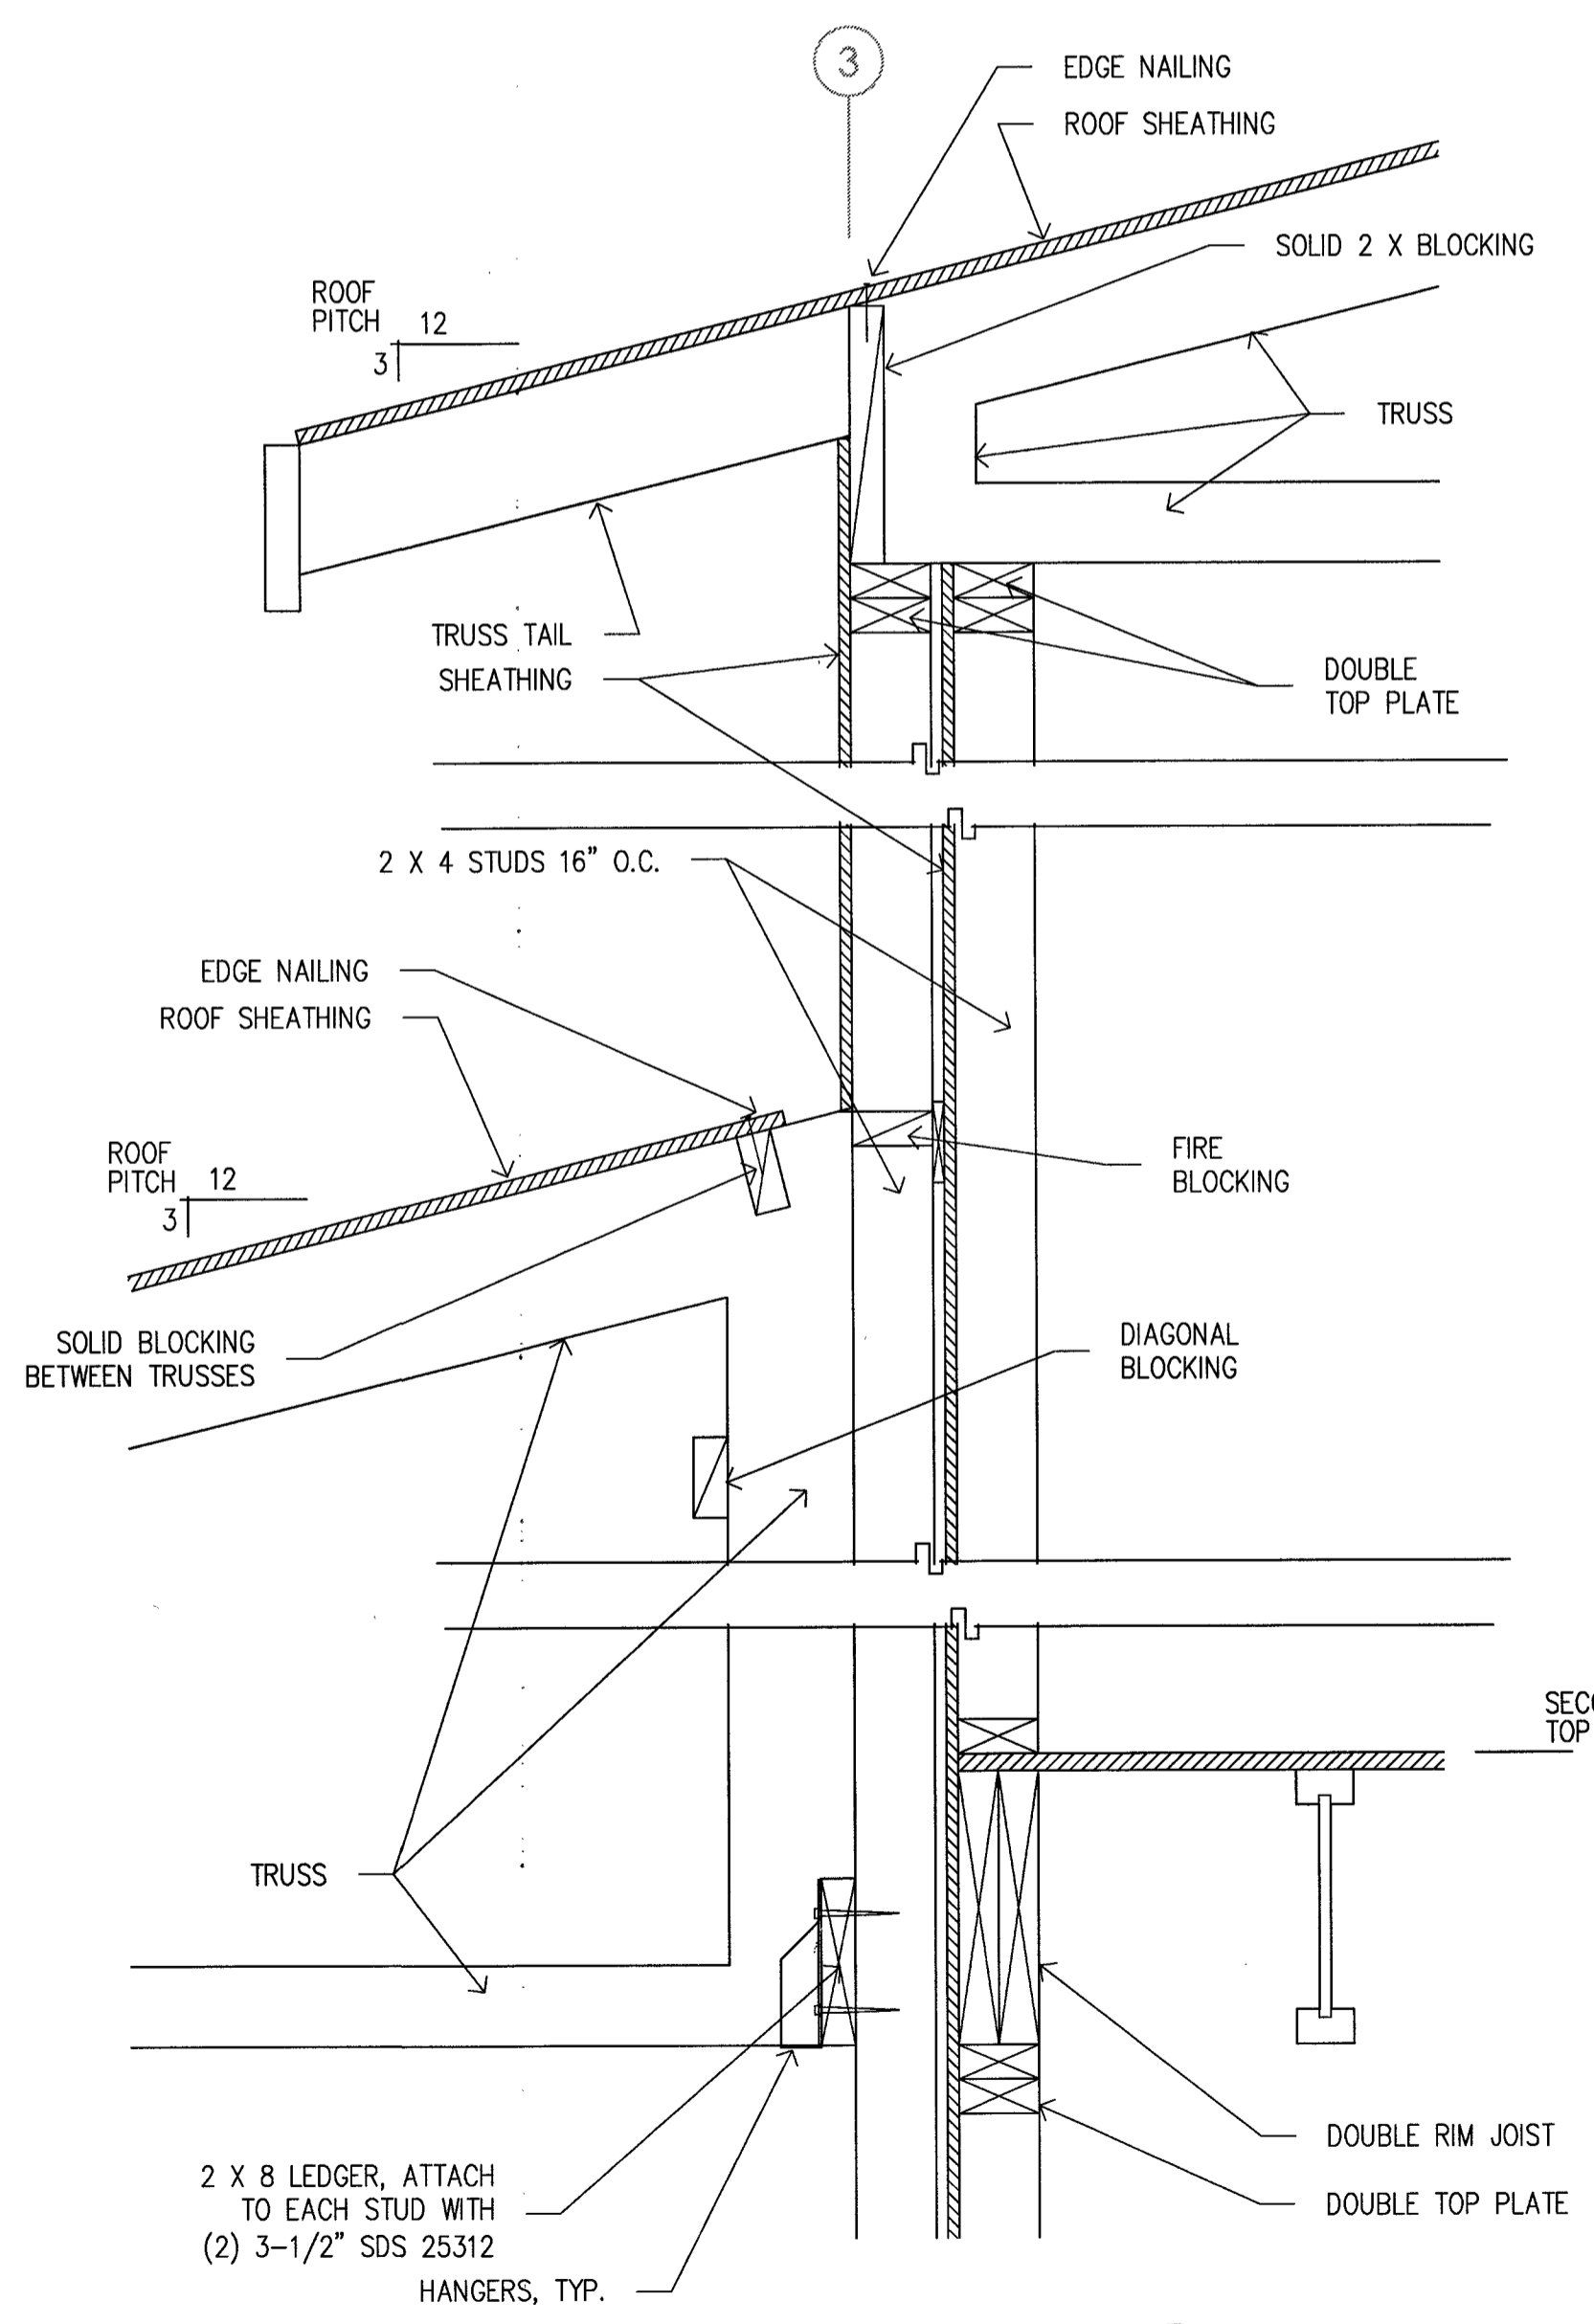

**Headwall 4**  
SEE DTL 3/A15 FOR ADDITIONAL INFORMATION

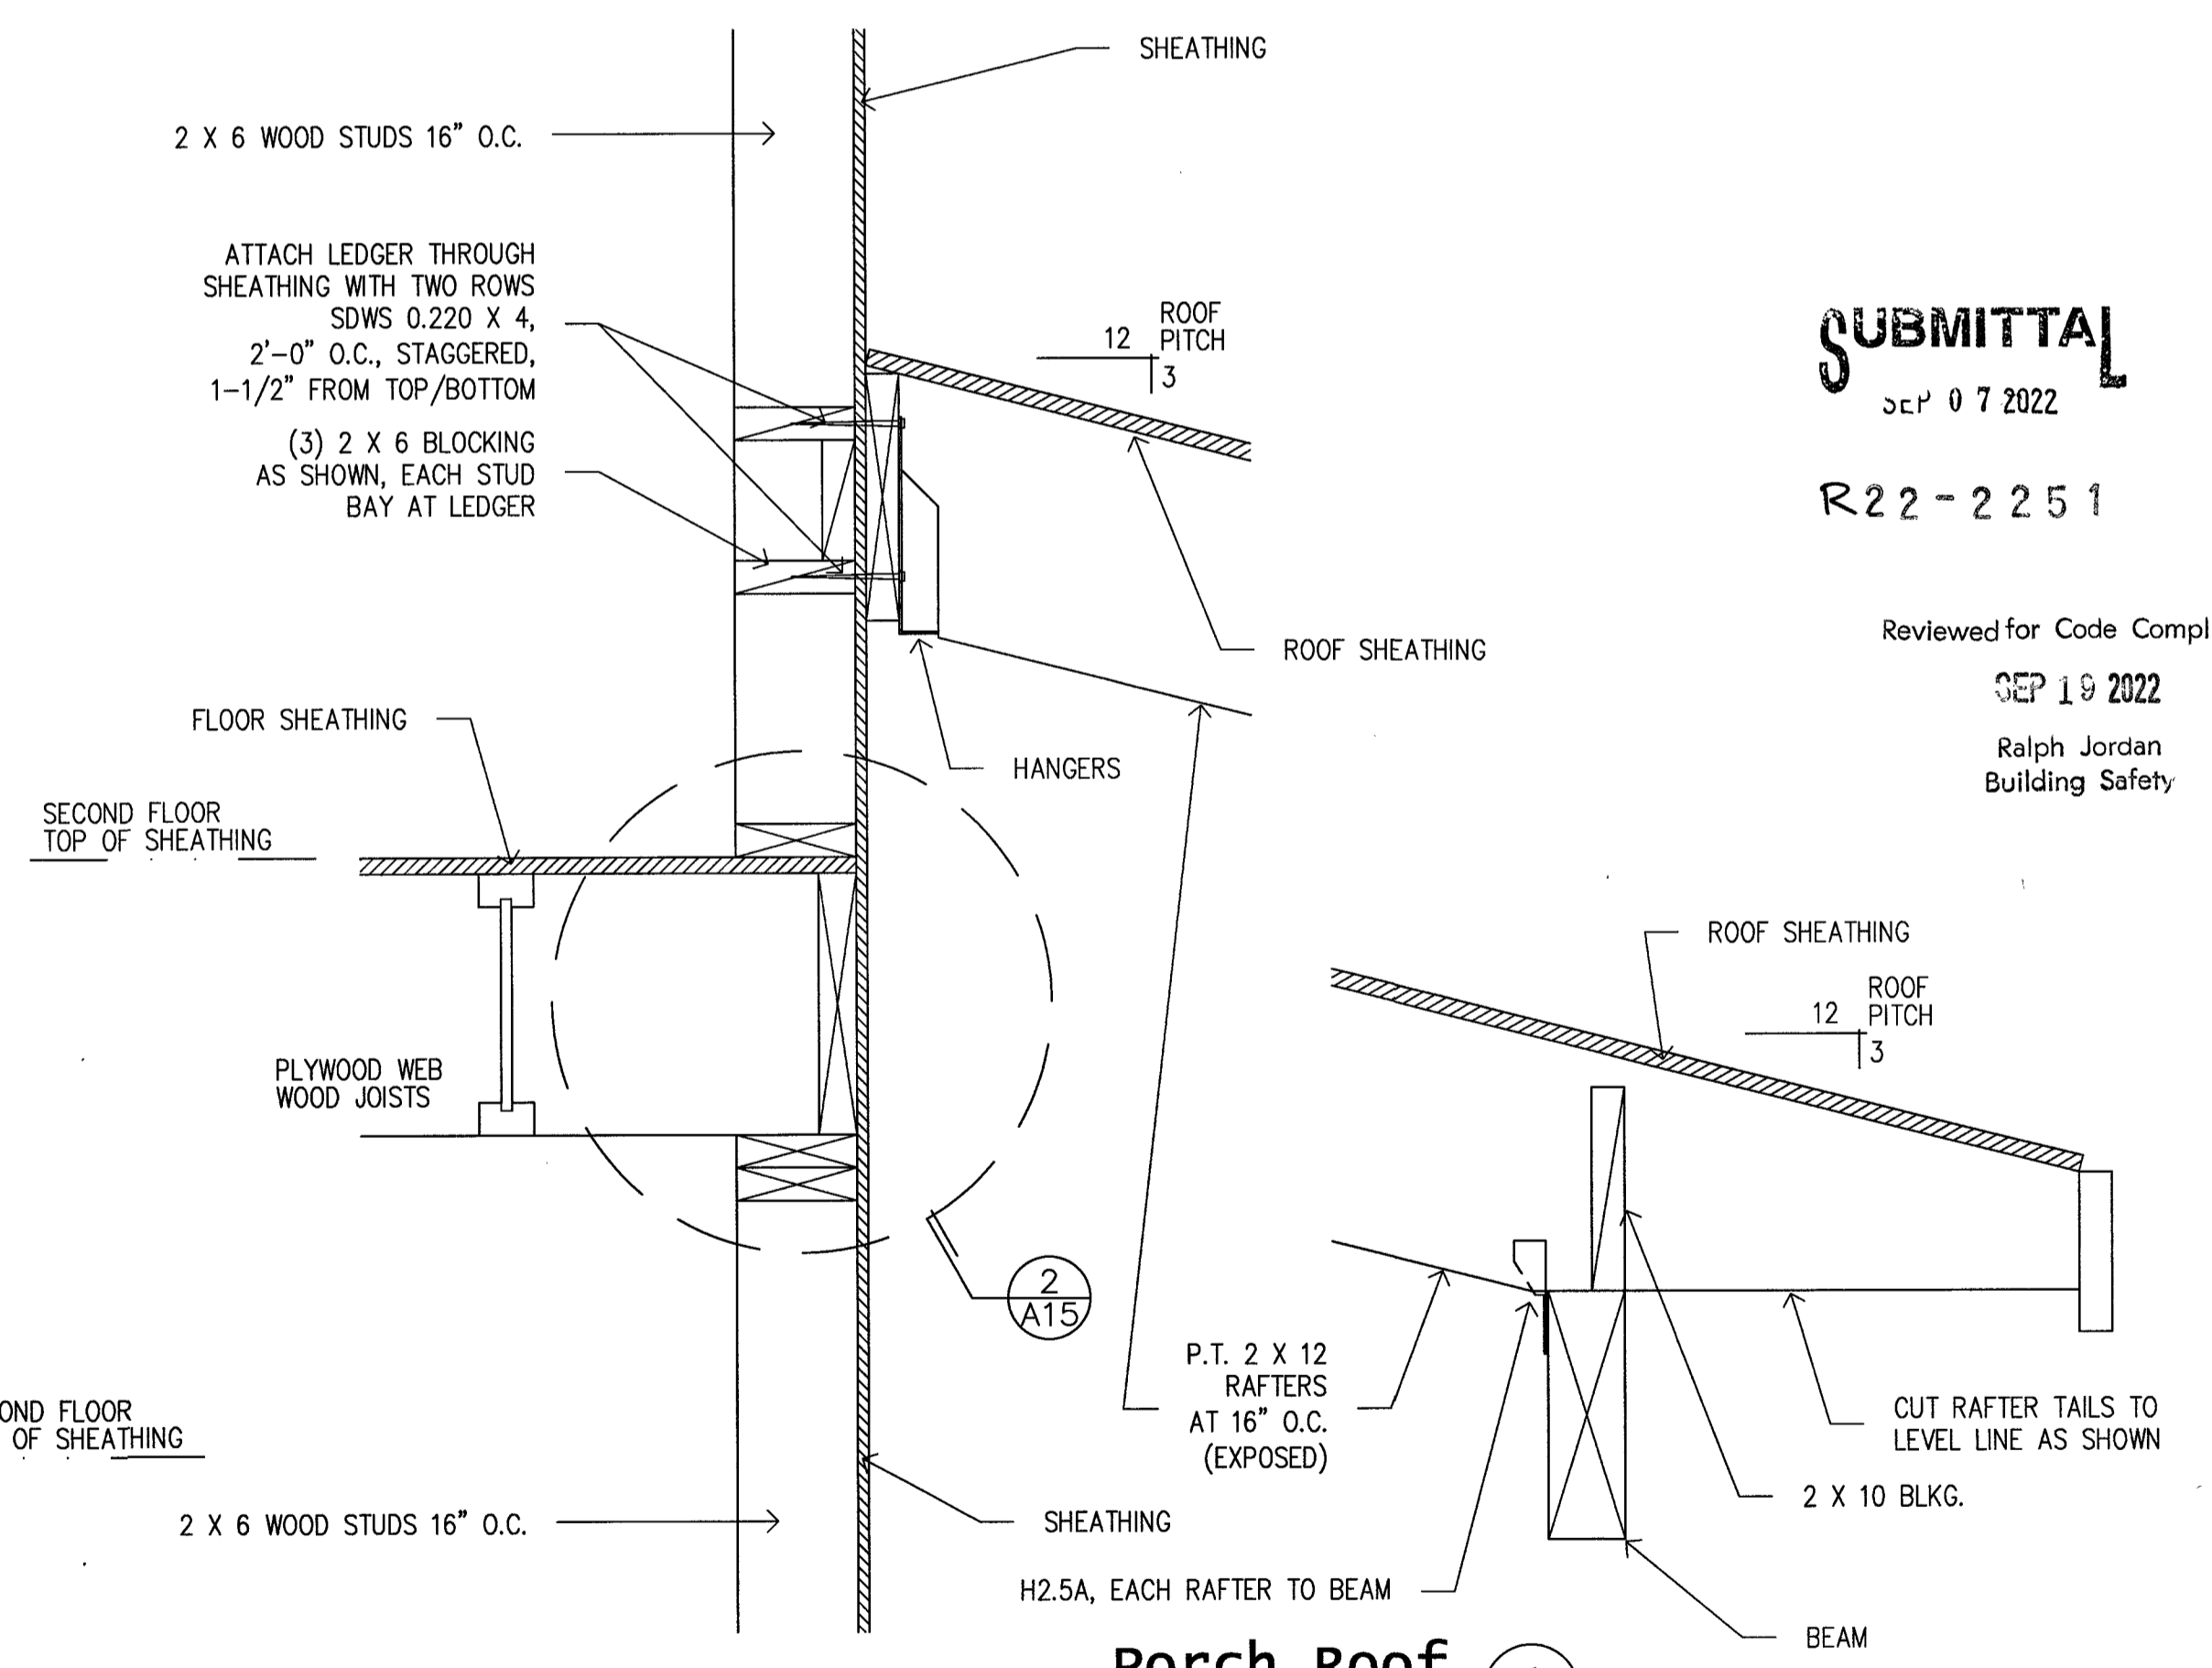

**Porch Roof Eave/Headwall 1**  
UNIT B, SHOWN  
UNIT A, SIMILAR/OPPOSITE HAND  
SEE DTL 8/A15 FOR ADDITIONAL INFORMATION

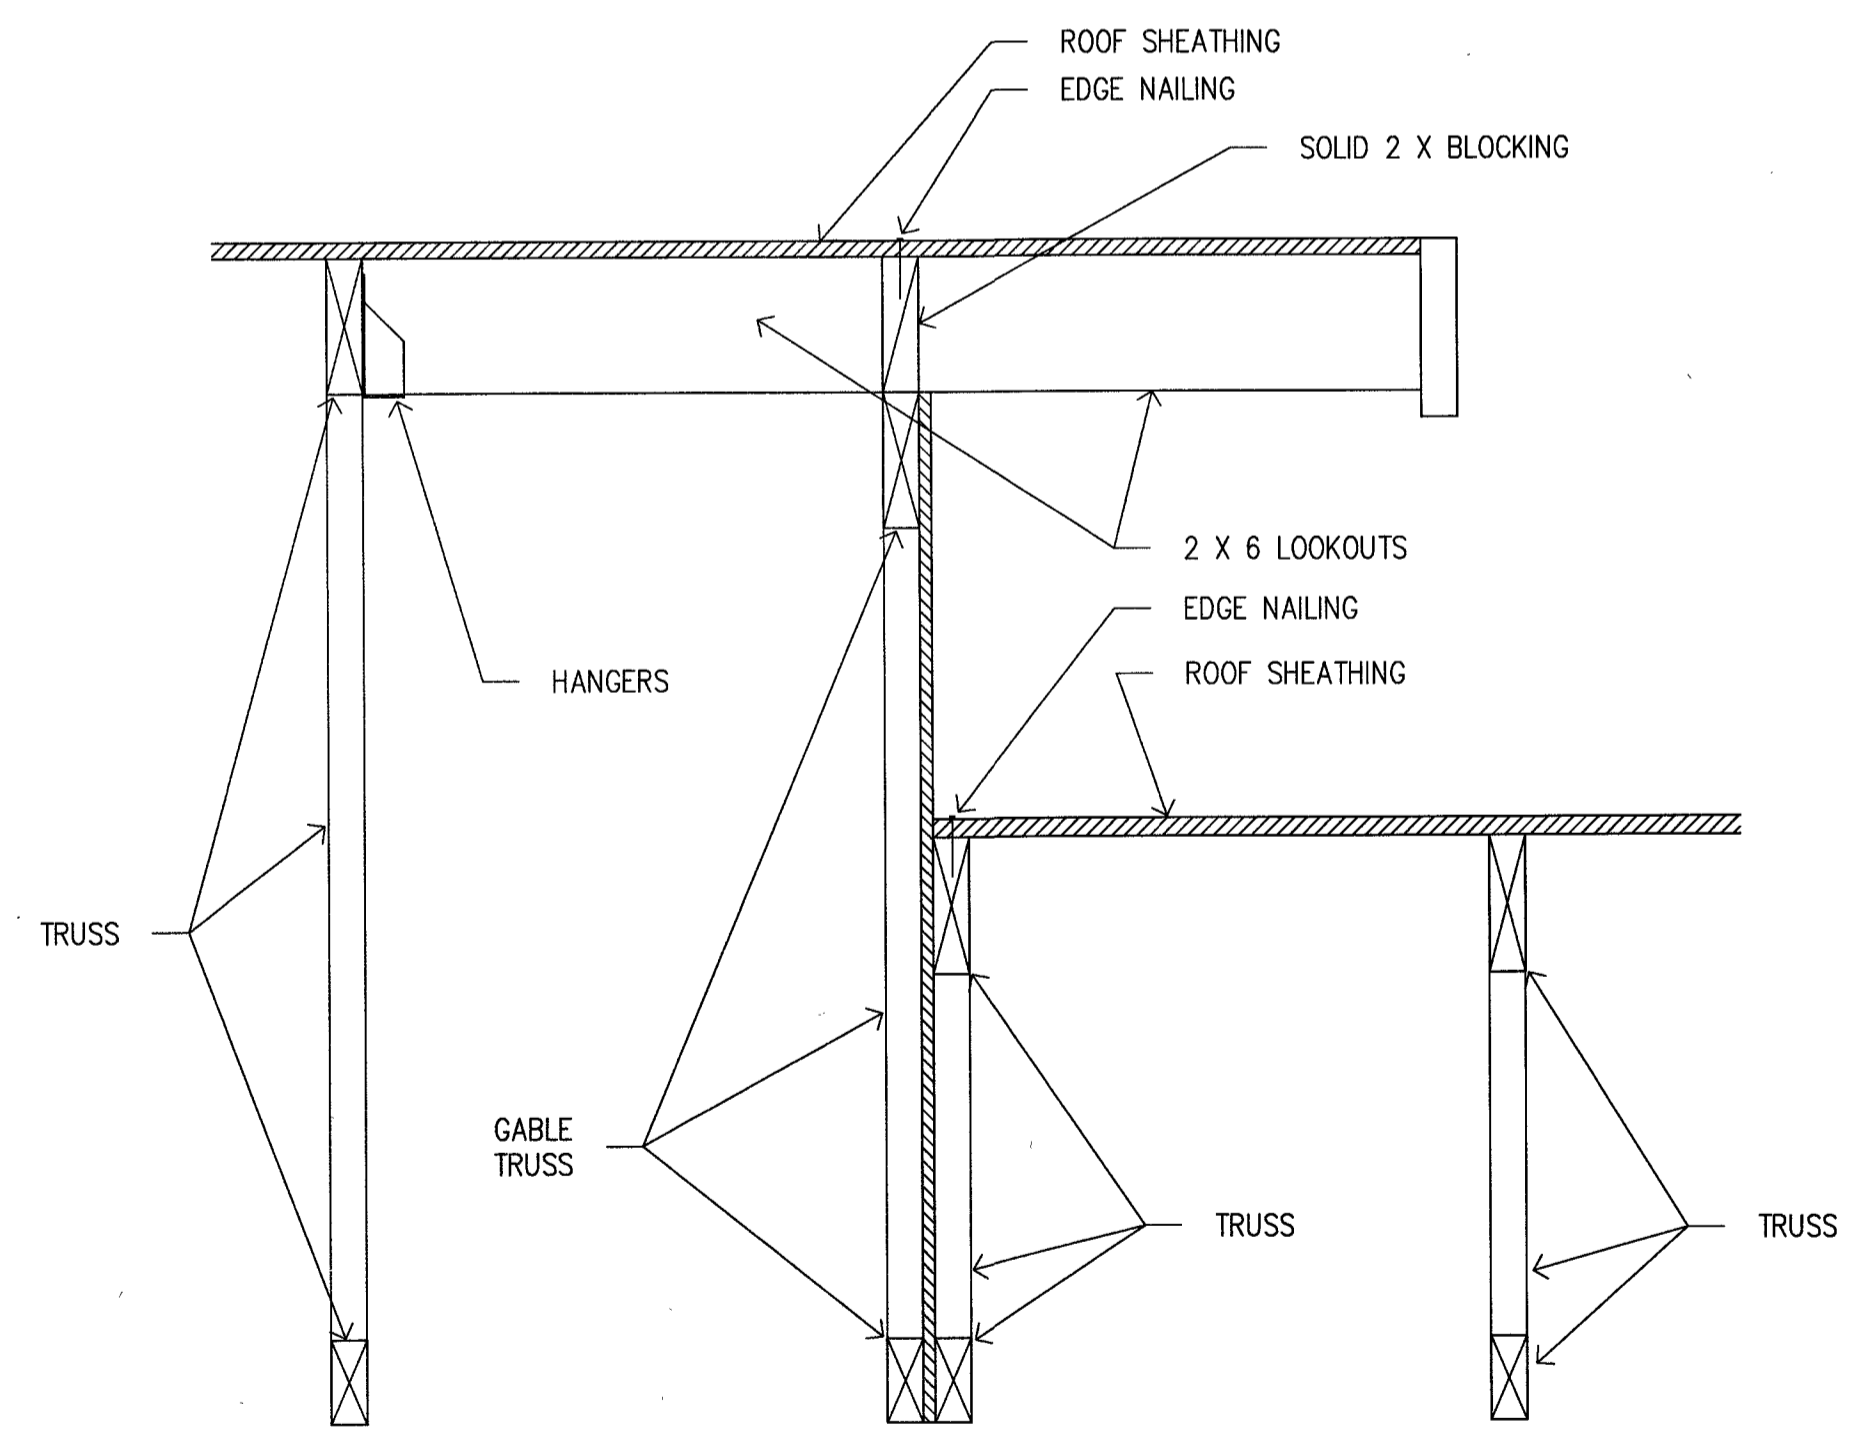

**Sidewall 5**  
SEE DTL 1/A15 FOR ADDITIONAL INFORMATION

**SUBMITTAL**  
SEP 07 2022  
R22-2251

Reviewed for Code Compliance  
SEP 19 2022  
Ralph Jordan  
Building Safety

**COOK INLET HOUSING AUTHORITY  
WILSHIRE AVE. DUPLEX  
Lot 4, Spenard East subdivision  
1106 Wilshire Ave.  
ANCHORAGE, ALASKA**

DR. BY: CLARK  
DATE: 18 JUL 22